

SIEMENS



Installation manual

# SINAMICS

## SINAMICS G120 frequency converters

PM240-2 Power Modules,  
IP20 / push-through technology (PT)

Edition

01/2020

[www.siemens.com/drives](http://www.siemens.com/drives)



## SINAMICS

### SINAMICS G120 Power Module PM240-2

#### Hardware Installation Manual

#### Preface

#### Fundamental safety instructions

**1**

#### Introduction

**2**

#### Installing

**3**

#### Connecting

**4**

#### Service and maintenance

**5**

#### Technical data

**6**

#### Spare parts

**7**

#### Accessories

**8**

#### Appendix

**A**

Updated from 01/2019 to 01/2020

## Legal information

### Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

#### **DANGER**

indicates that death or severe personal injury **will** result if proper precautions are not taken.

#### **WARNING**

indicates that death or severe personal injury **may** result if proper precautions are not taken.

#### **CAUTION**

indicates that minor personal injury can result if proper precautions are not taken.

#### **NOTICE**

indicates that property damage can result if proper precautions are not taken.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

### Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

### Proper use of Siemens products

Note the following:

#### **WARNING**

Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

### Trademarks

All names identified by ® are registered trademarks of Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

### Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

# Preface

## Changes with respect to Edition 01/2019

Added the information about the new option "Control Unit Adapter Kit CUA20"



Control Unit Adapter Kit CUA20 (Page 123)

Added the technical data and dimension information of dv/dt filters



dv/dt filter plus VPL (Page 154)

Removed the dv/dt filter information for 400 V FSA to FSC



dv/dt filter plus VPL (Page 154)

Added the service life data for PM240-2



Service life (Page 113)

Updated dimension and weight data for braking resistor 200 V FSA to FSC



Braking resistor (Page 133)

Updated article numbers for IP20 fan kits for FSD to FSF



Spare parts (Page 115)

Updated the weight data (with and without filter) of PM240-2 all frame sizes



Technical data (Page 73)



# Table of contents

	<b>Preface .....</b>	<b>3</b>
<b>1</b>	<b>Fundamental safety instructions .....</b>	<b>9</b>
1.1	General safety instructions .....	9
1.2	Equipment damage due to electric fields or electrostatic discharge .....	14
1.3	Warranty and liability for application examples .....	14
1.4	Security information .....	15
1.5	Residual risks of power drive systems.....	16
<b>2</b>	<b>Introduction .....</b>	<b>17</b>
<b>3</b>	<b>Installing .....</b>	<b>19</b>
3.1	Installation conditions.....	19
3.2	EMC-compliant installation of a machine or system.....	22
3.2.1	Control cabinet.....	23
3.2.2	Cables .....	25
3.2.3	Electromechanical components.....	27
3.3	Power losses and air cooling requirements .....	28
3.4	Mounting the Power Modules .....	29
3.4.1	Sequence for installing the Power Module .....	30
3.4.2	Dimension drawings and drilling dimensions for built-in units - IP20 devices .....	31
3.4.3	Dimension drawings and drilling dimensions for PT Power Modules.....	33
3.4.4	Mounting the shield plates .....	36
3.4.5	Hoisting gear FSD ... FSG .....	41
3.4.6	Additional components.....	42
<b>4</b>	<b>Connecting .....</b>	<b>43</b>
4.1	Permissible line supplies .....	46
4.1.1	TN line system .....	47
4.1.2	TT line system.....	48
4.1.3	IT system .....	49
4.1.4	Requirements for the protective conductor.....	50
4.1.5	Using several single-phase converters in machines and plants.....	51
4.2	Connecting the line and motor cable at the converter .....	53
4.2.1	Connection overview.....	53
4.2.2	Length of the motor cable .....	56
4.2.3	Connection terminals at the converter .....	57
4.2.4	Establishing connections .....	58
4.3	STO via Power Module terminals .....	63
4.4	Connecting the motor to the converter in a star or delta connection .....	64

<b>5</b>	<b>Service and maintenance.....</b>	<b>67</b>
5.1	Maintenance.....	68
5.2	Commissioning after a long storage time .....	69
5.3	Replacing a fan .....	70
5.3.1	Fan replacement FSA ... FSC .....	70
5.3.2	Fan replacement FSD ... FSF .....	71
5.3.3	FSG fan replacement.....	72
<b>6</b>	<b>Technical data .....</b>	<b>73</b>
6.1	Electromagnetic compatibility - Overview .....	74
6.2	Ambient conditions.....	75
6.3	Overload capability of the converter .....	76
6.4	200 V converters .....	77
6.4.1	General data, 200 V converters .....	78
6.4.2	Specific technical data, 200 V converters .....	79
6.4.3	Current derating depending on the pulse frequency, 200 V converters .....	86
6.5	400 V converters .....	87
6.5.1	General data, 400 V converters .....	88
6.5.2	Specific technical data, 400 V converters .....	89
6.5.3	Current derating depending on the pulse frequency, 400 V converters .....	98
6.6	690 V converters .....	99
6.6.1	General data, 690 V converters .....	100
6.6.2	Specific technical data, 690 V converters .....	101
6.6.3	Current derating depending on the pulse frequency, 690 V converters .....	104
6.7	Restrictions for special ambient conditions.....	105
6.8	Electromagnetic compatibility of variable-speed drives .....	107
6.8.1	Converter applications .....	108
6.8.1.1	Operation in the Second Environment.....	109
6.8.1.2	Operation in the First Environment .....	110
6.8.2	Typical harmonic currents.....	111
6.8.3	Harmonics at the power supply connection point according to IEC 61000-2-2 .....	112
6.8.4	EMC limit values in South Korea .....	112
6.9	Service life.....	113
<b>7</b>	<b>Spare parts .....</b>	<b>115</b>
<b>8</b>	<b>Accessories .....</b>	<b>117</b>
8.1	Top shield plate - FSD ... FSG .....	117
8.2	Mounting frames for PT power modules .....	118
8.3	Mounting grips for PT Power Modules.....	122
8.4	Control Unit Adapter Kit CUA20.....	123
8.5	Line filter.....	125
8.6	Line harmonics filter .....	126
8.7	Line reactor .....	130

---

8.8	Braking resistor .....	133
8.8.1	Connecting a braking resistor .....	136
8.8.2	Technical data of the braking resistor .....	138
8.9	Braking relay .....	141
8.9.1	Technical data of the brake relay .....	141
8.9.2	Connections and circuit diagrams .....	142
8.9.3	Mounting and connecting the brake relay .....	143
8.10	Output reactor .....	144
8.11	Sine-wave filter .....	150
8.12	dv/dt filter plus VPL .....	154
<b>A</b>	<b>Appendix.....</b>	<b>163</b>
A.1	Manuals and technical support .....	163
A.1.1	Manuals for your converter .....	163
A.1.2	Download a Manual .....	165
A.1.3	Configuring support.....	165
A.1.4	Product Support .....	167
A.2	Directives and standards .....	168
A.3	Abbreviations .....	170
	<b>Index.....</b>	<b>171</b>



# Fundamental safety instructions

## 1.1 General safety instructions



### **! WARNING**

#### **Electric shock and danger to life due to other energy sources**

Touching live components can result in death or severe injury.

- Only work on electrical devices when you are qualified for this job.
- Always observe the country-specific safety rules.

Generally, the following steps apply when establishing safety:

1. Prepare for disconnection. Notify all those who will be affected by the procedure.
2. Isolate the drive system from the power supply and take measures to prevent it being switched back on again.
3. Wait until the discharge time specified on the warning labels has elapsed.
4. Check that there is no voltage between any of the power connections, and between any of the power connections and the protective conductor connection.
5. Check whether the existing auxiliary supply circuits are de-energized.
6. Ensure that the motors cannot move.
7. Identify all other dangerous energy sources, e.g. compressed air, hydraulic systems, or water. Switch the energy sources to a safe state.
8. Check that the correct drive system is completely locked.

After you have completed the work, restore the operational readiness in the inverse sequence.



### **! WARNING**

#### **Risk of electric shock and fire from supply networks with an excessively high impedance**

Excessively low short-circuit currents can lead to the protective devices not tripping or tripping too late, and thus causing electric shock or a fire.

- In the case of a conductor-conductor or conductor-ground short-circuit, ensure that the short-circuit current at the point where the inverter is connected to the line supply at least meets the minimum requirements for the response of the protective device used.
- You must use an additional residual-current device (RCD) if a conductor-ground short circuit does not reach the short-circuit current required for the protective device to respond. The required short-circuit current can be too low, especially for TT supply systems.



**! WARNING**

**Risk of electric shock and fire from supply networks with an excessively low impedance**

Excessively high short-circuit currents can lead to the protective devices not being able to interrupt these short-circuit currents and being destroyed, and thus causing electric shock or a fire.

- Ensure that the prospective short-circuit current at the line terminal of the inverter does not exceed the breaking capacity (SCCR or I<sub>cc</sub>) of the protective device used.



**! WARNING**

**Electric shock if there is no ground connection**

For missing or incorrectly implemented protective conductor connection for devices with protection class I, high voltages can be present at open, exposed parts, which when touched, can result in death or severe injury.

- Ground the device in compliance with the applicable regulations.



**! WARNING**

**Electric shock due to connection to an unsuitable power supply**

When equipment is connected to an unsuitable power supply, exposed components may carry a hazardous voltage. Contact with hazardous voltage can result in severe injury or death.

- Only use power supplies that provide SELV (Safety Extra Low Voltage) or PELV- (Protective Extra Low Voltage) output voltages for all connections and terminals of the electronics modules.



**! WARNING**

**Electric shock due to equipment damage**

Improper handling may cause damage to equipment. For damaged devices, hazardous voltages can be present at the enclosure or at exposed components; if touched, this can result in death or severe injury.

- Ensure compliance with the limit values specified in the technical data during transport, storage and operation.
- Do not use any damaged devices.



**! WARNING**

**Electric shock due to unconnected cable shield**

Hazardous touch voltages can occur through capacitive cross-coupling due to unconnected cable shields.

- As a minimum, connect cable shields and the conductors of power cables that are not used (e.g. brake cores) at one end at the grounded housing potential.



### **! WARNING**

#### **Arcing when a plug connection is opened during operation**

Opening a plug connection when a system is operation can result in arcing that may cause serious injury or death.

- Only open plug connections when the equipment is in a voltage-free state, unless it has been explicitly stated that they can be opened in operation.



### **! WARNING**

#### **Electric shock due to residual charges in power components**

Because of the capacitors, a hazardous voltage is present for up to 5 minutes after the power supply has been switched off. Contact with live parts can result in death or serious injury.

- Wait for 5 minutes before you check that the unit really is in a no-voltage condition and start work.

### **NOTICE**

#### **Damage to equipment due to unsuitable tightening tools.**

Unsuitable tightening tools or fastening methods can damage the screws of the equipment.

- Be sure to only use screwdrivers which exactly match the heads of the screws.
- Tighten the screws with the torque specified in the technical documentation.
- Use a torque wrench or a mechanical precision nut runner with a dynamic torque sensor and speed limitation system.

### **NOTICE**

#### **Property damage due to loose power connections**

Insufficient tightening torques or vibration can result in loose power connections. This can result in damage due to fire, device defects or malfunctions.

- Tighten all power connections to the prescribed torque.
- Check all power connections at regular intervals, particularly after equipment has been transported.

### **! WARNING**

#### **Spread of fire from built-in devices**

In the event of fire outbreak, the enclosures of built-in devices cannot prevent the escape of fire and smoke. This can result in serious personal injury or property damage.

- Install built-in units in a suitable metal cabinet in such a way that personnel are protected against fire and smoke, or take other appropriate measures to protect personnel.
- Ensure that smoke can only escape via controlled and monitored paths.

 **WARNING**

**Active implant malfunctions due to electromagnetic fields**

Inverters generate electromagnetic fields (EMF) in operation. Electromagnetic fields may interfere with active implants, e.g. pacemakers. People with active implants in the immediate vicinity of an inverter are at risk.

- As the operator of an EMF-emitting installation, assess the individual risks of persons with active implants.
- Observe the data on EMF emission provided in the product documentation.

 **WARNING**

**Unexpected movement of machines caused by radio devices or mobile phones**

Using radio devices or mobile telephones in the immediate vicinity of the components can result in equipment malfunction. Malfunctions may impair the functional safety of machines and can therefore put people in danger or lead to property damage.

- Therefore, if you move closer than 20 cm to the components, be sure to switch off radio devices or mobile telephones.
- Use the "SIEMENS Industry Online Support app" only on equipment that has already been switched off.

**NOTICE**

**Damage to motor insulation due to excessive voltages**

When operated on systems with grounded line conductor or in the event of a ground fault in the IT system, the motor insulation can be damaged by the higher voltage to ground. If you use motors that have insulation that is not designed for operation with grounded line conductors, you must perform the following measures:

- IT system: Use a ground fault monitor and eliminate the fault as quickly as possible.
- TN or TT systems with grounded line conductor: Use an isolating transformer on the line side.

 **WARNING**

**Fire due to inadequate ventilation clearances**

Inadequate ventilation clearances can cause overheating of components with subsequent fire and smoke. This can cause severe injury or even death. This can also result in increased downtime and reduced service lives for devices/systems.

- Ensure compliance with the specified minimum clearance as ventilation clearance for the respective component.

**NOTICE****Overheating due to inadmissible mounting position**

The device may overheat and therefore be damaged if mounted in an inadmissible position.

- Only operate the device in admissible mounting positions.

**WARNING****Unrecognized dangers due to missing or illegible warning labels**

Dangers might not be recognized if warning labels are missing or illegible. Unrecognized dangers may cause accidents resulting in serious injury or death.

- Check that the warning labels are complete based on the documentation.
- Attach any missing warning labels to the components, where necessary in the national language.
- Replace illegible warning labels.

**NOTICE****Device damage caused by incorrect voltage/insulation tests**

Incorrect voltage/insulation tests can damage the device.

- Before carrying out a voltage/insulation check of the system/machine, disconnect the devices as all converters and motors have been subject to a high voltage test by the manufacturer, and therefore it is not necessary to perform an additional test within the system/machine.

**WARNING****Unexpected movement of machines caused by inactive safety functions**

Inactive or non-adapted safety functions can trigger unexpected machine movements that may result in serious injury or death.

- Observe the information in the appropriate product documentation before commissioning.
- Carry out a safety inspection for functions relevant to safety on the entire system, including all safety-related components.
- Ensure that the safety functions used in your drives and automation tasks are adjusted and activated through appropriate parameterizing.
- Perform a function test.
- Only put your plant into live operation once you have guaranteed that the functions relevant to safety are running correctly.

**Note****Important safety notices for Safety Integrated functions**

If you want to use Safety Integrated functions, you must observe the safety notices in the Safety Integrated manuals.

## 1.2 Equipment damage due to electric fields or electrostatic discharge

Electrostatic sensitive devices (ESD) are individual components, integrated circuits, modules or devices that may be damaged by either electric fields or electrostatic discharge.



### NOTICE

#### Equipment damage due to electric fields or electrostatic discharge

Electric fields or electrostatic discharge can cause malfunctions through damaged individual components, integrated circuits, modules or devices.

- Only pack, store, transport and send electronic components, modules or devices in their original packaging or in other suitable materials, e.g. conductive foam rubber or aluminum foil.
- Only touch components, modules and devices when you are grounded by one of the following methods:
  - Wearing an ESD wrist strap
  - Wearing ESD shoes or ESD grounding straps in ESD areas with conductive flooring
- Only place electronic components, modules or devices on conductive surfaces (table with ESD surface, conductive ESD foam, ESD packaging, ESD transport container).

## 1.3 Warranty and liability for application examples

Application examples are not binding and do not claim to be complete regarding configuration, equipment or any eventuality which may arise. Application examples do not represent specific customer solutions, but are only intended to provide support for typical tasks.

As the user you yourself are responsible for ensuring that the products described are operated correctly. Application examples do not relieve you of your responsibility for safe handling when using, installing, operating and maintaining the equipment.

## 1.4 Security information

Siemens provides products and solutions with industrial security functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial security concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial security measures that may be implemented, please visit

<https://www.siemens.com/industrialsecurity> (<https://www.siemens.com/industrialsecurity>).

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Security RSS Feed under

<https://www.siemens.com/industrialsecurity>  
(<https://new.siemens.com/global/en/products/services/cert.html#Subscriptions>).

Further information is provided on the Internet:

Industrial Security Configuration Manual  
(<https://support.industry.siemens.com/cs/ww/en/view/108862708>)

### WARNING

#### Unsafe operating states resulting from software manipulation

Software manipulations, e.g. viruses, Trojans, or worms, can cause unsafe operating states in your system that may lead to death, serious injury, and property damage.

- Keep the software up to date.
- Incorporate the automation and drive components into a holistic, state-of-the-art industrial security concept for the installation or machine.
- Make sure that you include all installed products into the holistic industrial security concept.
- Protect files stored on exchangeable storage media from malicious software by with suitable protection measures, e.g. virus scanners.
- On completion of commissioning, check all security-related settings.
- Protect the drive against unauthorized changes by activating the "Know-how protection" converter function.

## 1.5 Residual risks of power drive systems

When assessing the machine- or system-related risk in accordance with the respective local regulations (e.g., EC Machinery Directive), the machine manufacturer or system installer must take into account the following residual risks emanating from the control and drive components of a drive system:

1. Unintentional movements of driven machine or system components during commissioning, operation, maintenance, and repairs caused by, for example,
  - Hardware and/or software errors in the sensors, control system, actuators, and cables and connections
  - Response times of the control system and of the drive
  - Operation and/or environmental conditions outside the specification
  - Condensation/conductive contamination
  - Parameterization, programming, cabling, and installation errors
  - Use of wireless devices/mobile phones in the immediate vicinity of electronic components
  - External influences/damage
  - X-ray, ionizing radiation and cosmic radiation
2. Unusually high temperatures, including open flames, as well as emissions of light, noise, particles, gases, etc., can occur inside and outside the components under fault conditions caused by, for example:
  - Component failure
  - Software errors
  - Operation and/or environmental conditions outside the specification
  - External influences/damage
3. Hazardous shock voltages caused by, for example:
  - Component failure
  - Influence during electrostatic charging
  - Induction of voltages in moving motors
  - Operation and/or environmental conditions outside the specification
  - Condensation/conductive contamination
  - External influences/damage
4. Electrical, magnetic and electromagnetic fields generated in operation that can pose a risk to people with a pacemaker, implants or metal replacement joints, etc., if they are too close
5. Release of environmental pollutants or emissions as a result of improper operation of the system and/or failure to dispose of components safely and correctly
6. Influence of network-connected communication systems, e.g. ripple-control transmitters or data communication via the network

For more information about the residual risks of the drive system components, see the relevant sections in the technical user documentation.

# Introduction

## Overview

The Power Modules belong to the modular family of SINAMICS G120 converters. A modular converter comprises a Control Unit and a Power Module.

Depending on the power rating in frame sizes FSA ... FSG, the following Power Module versions are supplied:

- 1 AC 200 V    0.55 kW ... 4 kW        for line voltages from 1 AC 200 V ... 240 V
- 3 AC 200 V    0.55 kW ... 55 kW        for line voltages from 3 AC 200 V ... 240 V
- 3 AC 400 V    0.55 kW ... 250 kW        for line voltages from 3 AC 380 V ... 480 V
- 3 AC 690 V    11 kW ... 250 kW        for line voltages from 3 AC 500 V ... 690 V

## Control Units for the Power Modules

You can operate the Power Modules with a Control Unit from one of the following listed families:

- CU230P-2
- CU240B-2
- CU240E-2
- CU250S-2

For Power Modules FSA ... FSC, you require a Control Unit with firmware version V4.4 or higher.

For Power Modules FSD ... FSF, you require a Control Unit with firmware version V4.7 HF8 or higher.

For Power Modules FSG, you require a Control Unit with firmware version V4.7 SP9 or higher.

---

### Note

#### Commissioning the converter

You must first commission the converter before you can use it. Commissioning is described in the Operating Instructions of the relevant Control Unit.



Manuals for your converter (Page 163)

---

## STO independent of the Control Unit

Using the PM240-2 Power Modules, frame sizes FSD, FSE, FSF and FSG, you can implement the "Safe Torque Off" safety function (STO), corresponding to PL e according to EN 13849-1 and SIL 3 according to IEC61508.



STO via Power Module terminals (Page 63)

Note that when using the STO function, the mission time of the converter is restricted. For more information, see the "Safety Integrated" Function Manual.



Manuals for your converter (Page 163)

## Permissible motors

---

### Note

#### Motors for converter operation

Only use motors that are suitable for operation with converters with a DC link.

---

#### Motors for 200 V Power Modules

For the 200 V Power Modules, induction motors are permissible in the range from 25% ... 150% of the converter power without any restrictions.

#### Motors for 400 V Power Modules

For the 400 V Power Modules, induction motors are permissible in the range from 25 % ... 150 % of the converter power without any restrictions.

#### Motors for 690 V Power Modules

For the 690 V Power Modules, induction motors are permissible in the range from 50 % ... 150 % of the converter power without any restrictions.

## Continuous development within the scope of product maintenance

Converter components are being continuously developed within the scope of product maintenance. Product maintenance includes, for example, measures to increase the ruggedness or hardware changes which become necessary as components are discontinued.

These further developments are "spare parts-compatible" and do not change the article number.





In the scope of such spare parts-compatible ongoing development, plug connector or connection positions are sometimes slightly modified. This does not cause any problems when the components are properly used. Please take this fact into consideration in special installation situations (e.g. allow sufficient reserve regarding the cable length).

# Installing



## 3.1 Installation conditions

### General installation conditions

When installing the Power Modules carefully observe the conditions listed below in order to guarantee reliable, continuous and disturbance-free operation.

- The Power Modules are designed for installation in a control cabinet.
- The Power Modules are certified for use in environments with degree of pollution 2 without condensation; i.e. in environments where no conductive pollution/dirt occurs.
- The built-in units fulfill IP20 degree of protection at delivery status with the maximum cross section for the connected cables.
- Fast temperature changes of the air drawn in (e.g. by using cooling units) are not permitted due to the risk of condensation.
- Condensation is not permissible when switching on.
- You can find the permissible conductor cross-sections for the terminals in:
  -  Connection terminals at the converter (Page 57)
- The following section describes how you can install the Power Module in compliance with EMC regulations:
  -  EMC-compliant installation of a machine or system (Page 22)
- Devices in push-through technology – PT devices
  - PT devices have IP20 degree of protection and at the rear of the control cabinet they fulfil IP55.
  - PT devices, FSF: A pressure compensation valve is necessary for the cabinet in order to prevent underpressure in the cabinet.
- For a system configuration in conformance with IEC, use the fuse types approved for IEC, specified in the Technical data, or the circuit breakers under the following Internet address.
  -  Fuse types: Technical data (Page 73)
  -  Circuit breaker  
<https://support.industry.siemens.com/cs/ww/en/view/109486009>

### Converters for systems in the United States / Canada (UL/cUL)

- For a system configuration in conformance with UL/cUL, use the fuse types approved for UL/cUL, specified in the Technical data, or the circuit breakers under the following Internet address.
  -  Fuse types: Technical data (Page 73)
  -  Circuit breaker  
[\(https://support.industry.siemens.com/cs/ww/en/view/109486009\)](https://support.industry.siemens.com/cs/ww/en/view/109486009)
- The integrated semiconductor short-circuit protection does not provide cable protection.
- On the system side, provide **cable protection** in conformance with NEC or CEC, Part 1 and the local regulations.
- The converters provide internal motor protection corresponding to UL61800-5-1.  
 Protection threshold:
  - 115% of the rated motor current entered for frame sizes FSA ... FSF
  - 120% of the rated motor current entered for frame size FSG
 You enter the motor data values and the protection functions when commissioning the converter. Please observe the details in the associated operating instructions.
- Use suitable UL-listed (ZMVV) ring lugs to connect the power terminals of frame sizes FSF and FSG.
- Carefully note that for plants and systems in conformance with UL/cUL, the line and output voltage may not be higher than 600 V.
- Only use copper cables rated for 60 °C or 75 °C.
- FSE, IP20: Only use cables that are certified for temperatures of 75 °C to connect the braking resistor.
- FSE, PT: Only use cables that are certified for temperatures of 75 °C to connect the line supply, motor and braking resistor.
- The converters are Open Type devices.
- The push-through FSD ... FSF converters are Open Type devices. At the rear of the control cabinet they fulfil Enclosure Type 1.

### Additional requirements for CSA compliance, frame sizes FSA ... FSC

Install the converter with an external suppression device with the following properties:

- Surge protection device with the appropriate certification (category checking numbers VZCA and VZCA7)
- Rated supply voltage
  - 240 V (phase with respect to ground), 240 V (phase to phase) for 200 V converters
  - 480 V (phase to phase) for 400 V converters

- Terminal voltage,  $V_{PR}$ 
  - max. 2000 V for 200 V converters
  - max. 2500 V for 400 V converters
- Overvoltage category III
- Pollution degree 2
- Suitable for SPD applications, type 1 or type 2

Alternatively, use a surge protection device, article number 5SD7 424-1 from Siemens AG.

### Additional requirements relating to CSA conformance, frame sizes FSD ... FSG

Overvoltage category OVC III must be ensured for all connections of the power circuit. This can mean that a surge suppressor must be connected upstream on the line side. The rated voltage of the surge suppressor must not exceed the line voltage, and must guarantee the limit values ( $V_{PR}$ ) specified here.

Line voltage	Conductor	Phase to ground		Phase to phase	
		Rated voltage	$V_{PR}$	Rated voltage	$V_{PR}$
3 AC 200 V ... 240 V	Grounded neutral conductor	139 V	2.5 kV	240 V	4 kV
	Grounded line conductor	240 V	4 kV	240 V	4 kV
3 AC 380 V ... 480 V	Grounded neutral conductor	277 V	4 kV	480 V	4 kV
	Grounded line conductor	480 V	6 kV	480 V	4 kV
3 AC 500 V ... 600 V	Grounded neutral conductor	347 V	6 kV	600 V	4 kV
	Grounded line conductor	600 V	6 kV	600 V	4 kV

## 3.2 EMC-compliant installation of a machine or system

The converter is designed for operation in industrial environments where strong electromagnetic fields are to be expected.

Reliable and disturbance-free operation is only ensured for EMC-compliant installation.

To achieve this, subdivide the control cabinet and the machine or system into EMC zones:

### EMC zones

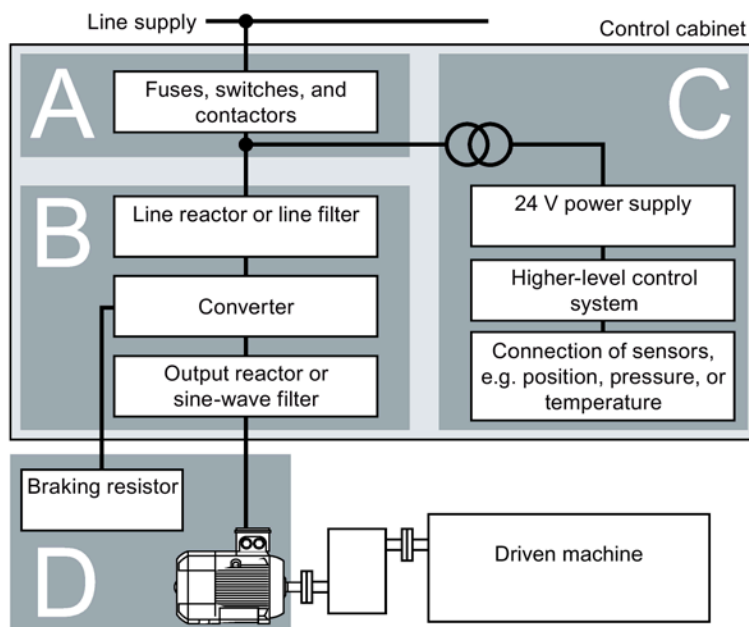


Figure 3-1 Example of the EMC zones of a plant or machine

#### Inside the control cabinet

- Zone A: Line supply connection
- Zone B: Power electronics

Devices in Zone B generate energy-rich electromagnetic fields.

- Zone C: Control and sensors

Devices in Zone C do not generate any energy-rich electromagnetic fields themselves, but their functions can be impaired by electromagnetic fields.

#### Outside the control cabinet

- Zone D: Motors, braking resistors

Devices in Zone D generate electromagnetic fields with a significant amount of energy

### 3.2.1 Control cabinet

- Assign the various devices to zones in the control cabinet.
- Electromagnetically uncouple the zones from each other by means of one of the following actions:
  - Side clearance  $\geq 25$  cm
  - Separate metal enclosure
  - Large-area partition plates
- Route cables of various zones in separate cable harnesses or cable ducts.
- Install filters or isolation amplifiers at the interfaces of the zones.

#### Control cabinet assembly

- Connect the door, side panels, top and base plate of the control cabinet with the control cabinet frame using one of the following methods:
  - Electrical contact surface of several  $\text{cm}^2$  for each contact location
  - Several screw connections
  - Short, finely stranded, braided copper wires with cross-sections  $\geq 95 \text{ mm}^2 / 000 (3/0) (-2) \text{ AWG}$
- Install a shield support for shielded cables that are routed out of the control cabinet.
- Connect the PE bar and the shield support to the control cabinet frame through a large surface area to establish a good electrical connection.
- Mount the control cabinet components on a bare metal mounting plate.
- Connect the mounting plate to the control cabinet frame and PE bar and shield support through a large surface area to establish a good electrical connection.
- For screw connections onto painted or anodized surfaces, establish a good conductive contact using one of the following methods:
  - Use special (serrated) contact washers that cut through the painted or anodized surface.
  - Remove the insulating coating at the contact locations.

### Measures required for several control cabinets

- Install equipotential bonding for all control cabinets.
- Screw the frames of the control cabinets together at several locations through a large surface area using serrated washers to establish a good electrical connection.
- In plants and systems where the control cabinets are lined up next to one another, and which are installed in two groups back to back, connect the PE bars of the two cabinet groups at as many locations as possible.

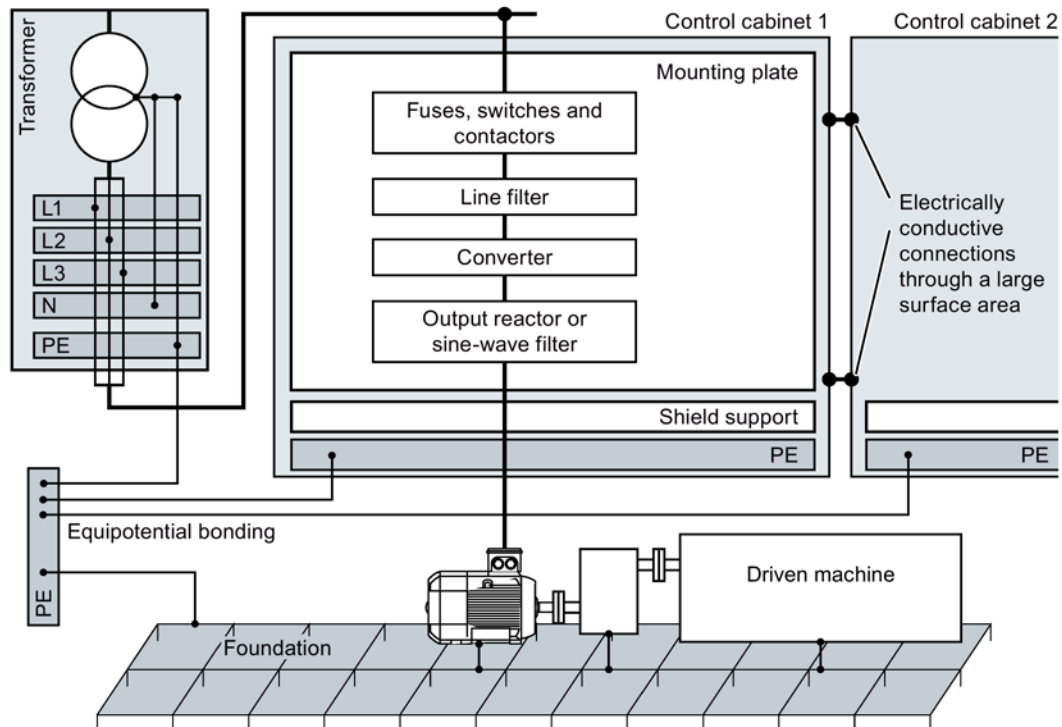


Figure 3-2 Grounding and high-frequency equipotential bonding measures in the control cabinet and in the plant/system

### Further information

Additional information about EMC-compliant installation is available in the Internet:



EMC installation guideline

(<http://support.automation.siemens.com/WW/view/en/60612658>)

### 3.2.2 Cables

Cables with a high level of interference and cables with a low level of interference are connected to the converter:

- Cables with a high level of interference:
  - Cable between the line filter and converter
  - Motor cable
  - Cable at the converter DC link connection
  - Cable between the converter and braking resistor
- Cables with a low level of interference:
  - Cable between the line and line filter
  - Signal and data cables

#### Cable routing inside the cabinet

- Route the power cables with a high level of interference so that there is a minimum clearance of 25 cm to cables with a low level of interference.

If the minimum clearance of 25 cm is not possible, insert separating metal sheets between the cables with a high level of interference and cables with a low level of interference. Connect these separating metal sheets to the mounting plate to establish a good electrical connection.
- Cables with a high level of interference and cables with a low level of interference may only cross over at right angles:
- Keep all of the cables as short as possible.
- Route all of the cables close to the mounting plates or cabinet frames.
- Route signal and data cables - as well as the associated equipotential bonding cables - parallel and close to one another.
- Twist incoming and outgoing unshielded individual conductors.

Alternatively, you can route incoming and outgoing conductors in parallel, but close to one another.
- Ground any unused conductors of signal and data cables at both ends.
- Signal and data cables must only enter the cabinet from one side, e.g. from below.
- Use shielded cables for the following connections:
  - Cable between the converter and line filter
  - Cable between the converter and output reactor or sine-wave filter

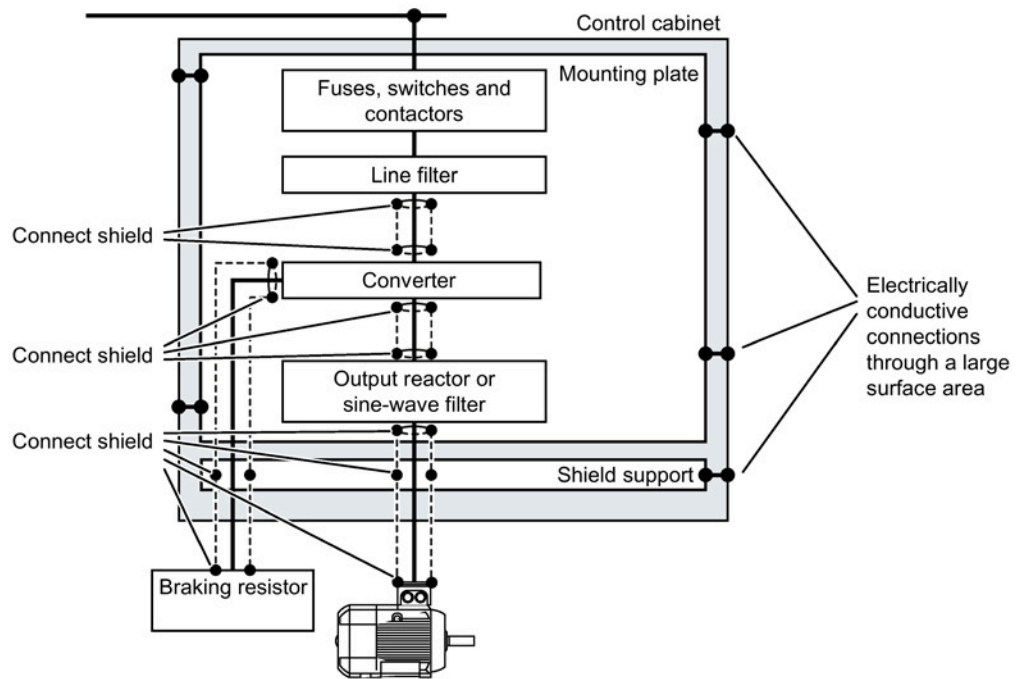


Figure 3-3 Routing converter cables inside and outside a control cabinet

### Routing cables outside the control cabinet

- Maintain a minimum clearance of 25 cm between cables with a high level of interference and cables with a low level of interference.
- Use shielded cables for the following connections:
  - Converter motor cable
  - Cable between the converter and braking resistor
  - Signal and data cables
- Connect the motor cable shield to the motor enclosure using a PG gland that establishes a good electrical connection.

### Requirements relating to shielded cables

- Use cables with finely-stranded, braided shields.
- Connect the shield to at least one end of the cable.

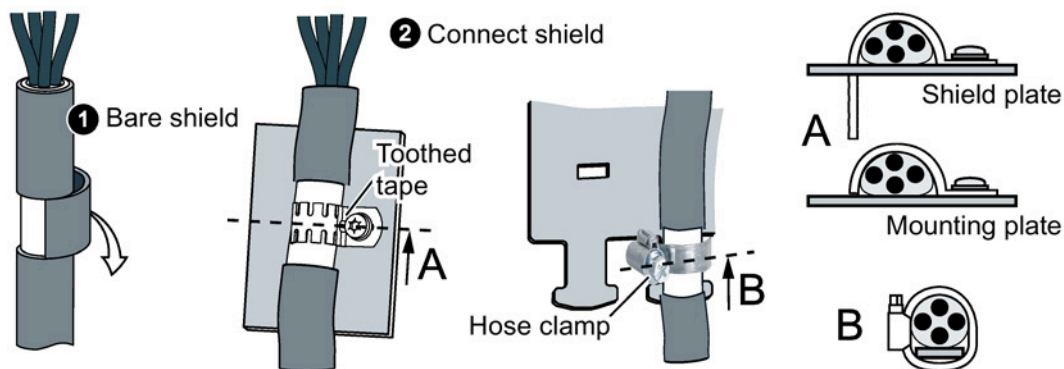


Figure 3-4 Examples for EMC-compliant shield support

- Attach the shield to the shield support directly after the cable enters the cabinet.
- Do not interrupt the shield.
- Only use metallic or metallized plug connectors for shielded data cables.

### 3.2.3 Electromechanical components

#### Surge voltage protection circuit

- Connect surge voltage protection circuits to the following components:
  - Coils of contactors
  - Relays
  - Solenoid valves
  - Motor holding brakes
- Connect the surge voltage protection circuit directly at the coil.
- Use RC elements or varistors for AC-operated coils and freewheeling diodes or varistors for DC-operated coils.

### 3.3 Power losses and air cooling requirements

#### Cooling requirements


To protect the components from overheating, the control cabinet requires a cooling air flow, which depends on the power loss of the individual components.


Formula for calculating the cooling airflow:

$$\text{airflow [l/s]} = \text{power loss [W]} * 0.86 / \Delta T [\text{K}]$$

- Power loss: Total of the power losses of the individual components.
- $\Delta T$ : Permissible temperature rise in the control cabinet

#### Measures in order to ensure that the components are adequately cooled

- Add the power losses of the individual components.
  - Power Module data:  "Technical data (Page 73)".
  - The Control Unit power loss is less than 0.04 kW.
  - Use the manufacturers data for components, for example reactors or filters
- Calculate the air flow required, using the formula above.
- Ensure that the control cabinet is appropriately ventilated and equipped with suitable air filters.
- Ensure that the components maintain the specified clearances with respect to one another.

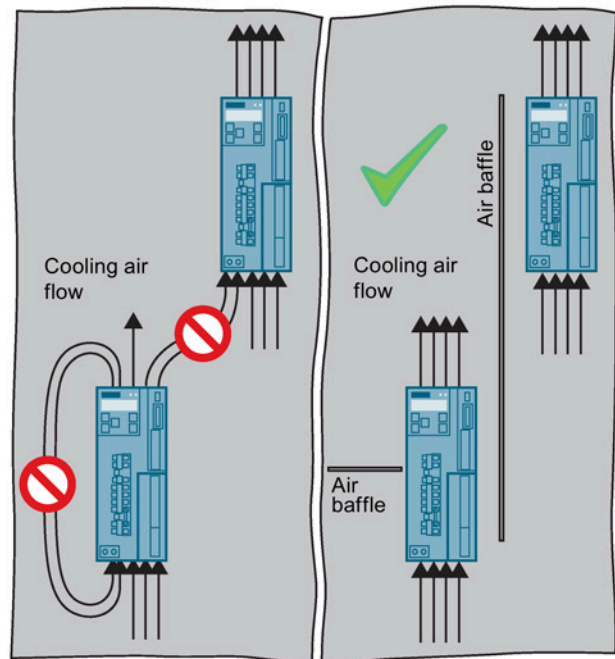

- Ensure that the components are provided with adequate cooling air through the cooling openings.
- Use the appropriate air barriers to prevent cooling air short circuits

#### Power loss for Power Modules with push-through technology - PT devices

When you use PT Power Modules, the majority of the power loss is dissipated through the heatsink located outside the control cabinet.

## 3.4 Mounting the Power Modules

Take note of the following listed specifications when installing the Power Module.

### Protection against the spread of fire

The device may be operated only in closed housings or in control cabinets with protective covers that are closed, and when all of the protective devices are used. The installation of the device in a metal control cabinet or the protection with another equivalent measure must prevent the spread of fire and emissions outside the control cabinet.

### Protection against condensation or electrically conductive contamination


Protect the device, e.g. by installing it in a control cabinet with degree of protection IP54 according to IEC 60529 or NEMA 12. Further measures may be necessary for particularly critical operating conditions.

If condensation or conductive pollution can be excluded at the installation site, a lower degree of control cabinet protection may be permitted.

### Installing

Rules for admissible mounting:

- Only mount the Power Module in a vertical position with the motor connectors at the bottom.

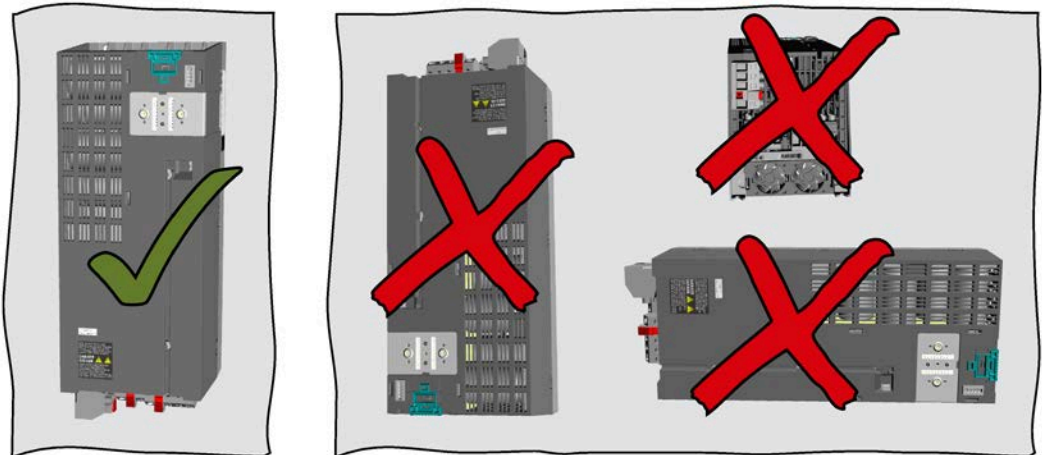

- Maintain the minimum clearances to other components.
- Use the specified installation parts and components.
- Comply with the specified torques.

### **3.4.1 Sequence for installing the Power Module**

During installation, comply with the sequence listed below.

#### **Frame sizes FSA ... FSC**

1. Prepare the cabinet.
2. Mount the shield plates.
3. Install the Power Module.
4. If you are using a Brake Relay or Safe Brake Relay:  
Install the Brake Relay next to the converter.

#### **Frame sizes FSD ... FSG**

1. Prepare the cabinet.
2. If you are using a Brake Relay or Safe Brake Relay:  
Install the Brake Relay on the rear side of the shield plate.
3. Mount the shield plates.
4. Install the Power Module.

### 3.4.2 Dimension drawings and drilling dimensions for built-in units - IP20 devices

The following dimension drawings and drilling patterns are not to scale.

#### Frame sizes FSA ... FSC

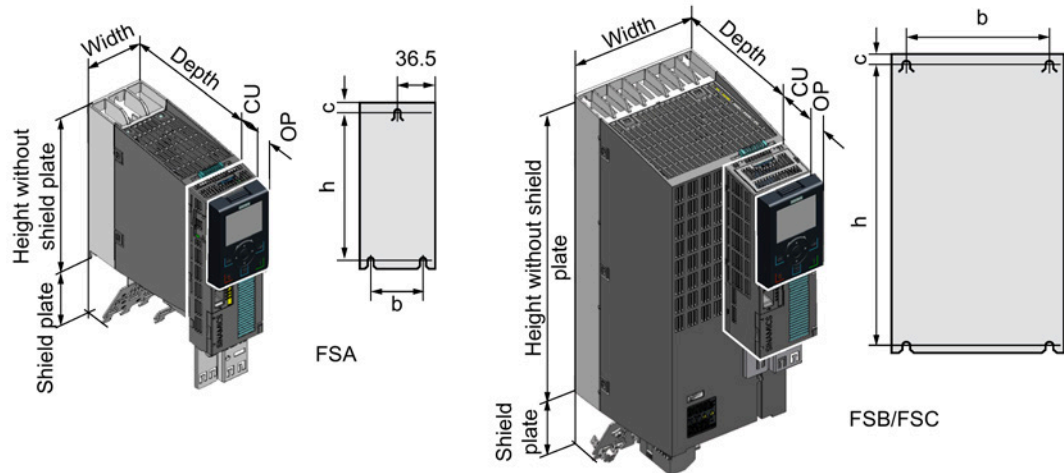


Table 3- 1 Dimensions depend on the Control Unit (CU) and HMI device [mm]

Frame size	Width [mm]	Height [mm]		Depth [mm]			
		without shield plate	with shield plate	without CU	with CU230P-2 <sup>1)</sup>	with CU240B-2 <sup>1)</sup> / CU240E-2 <sup>1)</sup>	with CU250S-2 <sup>1)</sup>
FSA	73	196	276	165	224	206	227
FSB	100	292	370	165	224	206	227
FSC	140	355	432	165	224	206	227

<sup>1)</sup> With a Smart Access Module plus 9 mm  
With blanking cover or with Operator Panel plus 11 mm.

Table 3- 2 Drilling dimensions, cooling clearances and fixing

Frame size	Drilling dimensions [mm]			Cooling air clearances [mm] <sup>1)</sup>			Fixing/torque [Nm]
	h	b	c	Top	Bottom	Front	
FSA	186	62.3	6	80	100	100	3 x M4 / 2.5
FSB	281	80	6	80	100	100	4 x M4 / 2.5
FSC	343	120	6	80	100	100	4 x M5 / 3.5

<sup>1)</sup> The Power Module is designed for mounting without any lateral cooling air clearance. For tolerance reasons, we recommend a lateral clearance of approx. 1 mm.

## Frame sizes FSD ... FSG

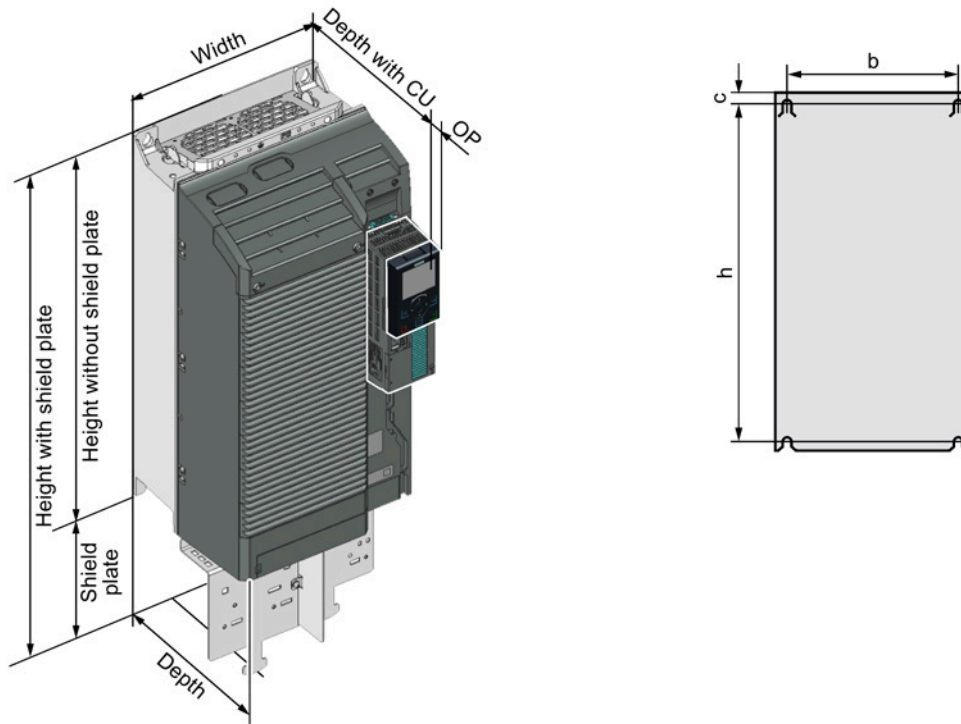


Table 3- 3 Dimensions depend on the Control Unit (CU) and HMI device [mm]

Frame size	Width [mm]	Height [mm]		Depth [mm]			
		without shield plate	with shield plate	without CU	with CU230P-2 <sup>1)</sup>	with CU240B-2 <sup>1)</sup> / CU240E-2 <sup>1)</sup>	with CU250S-2 <sup>1)</sup>
FSD	200	472	624	237	253	237	256
FSE	275	551	728	237	253	237	256
FSF	305	709	966	357	373	357	376
FSG	305	1000	1257	357	373	357	376

- <sup>1)</sup> With a Smart Access Module plus 9 mm  
 With blanking cover or with Operator Panel plus 11 mm.

Table 3- 4 Drilling dimensions, cooling clearances and fixing

Frame size	Drilling dimensions [mm]			Cooling air clearances [mm] <sup>1)</sup>			Fixing/torque [Nm]
	h	b	c	Top <sup>2)</sup>	Bottom <sup>2)</sup>	Front	
FSD	430	170	7	300	350	100	4 x M5 / 6.0
FSE	509	230	8.5	300	350	100	4 x M6 / 10
FSF	680	270	13	300	350	100	4 x M8 / 25
FSG	970.5	265	15	300	350	100	4 x M10 / 50

- <sup>1)</sup> The Power Module is designed for mounting without any lateral cooling air clearance. For tolerance reasons, we recommend a lateral clearance of approx. 1 mm.
- <sup>2)</sup> The top and bottom cooling air clearances refer to the Power Module without shield plate

### 3.4.3 Dimension drawings and drilling dimensions for PT Power Modules

Use the optional mounting frame to mount a Power Module in push-through technology in a control cabinet. The mounting frame includes the necessary seals and frame to ensure compliance with degree of protection IP55.

If you do not use the optional mounting frame, then you must ensure that the required degree of protection is complied with using other appropriate measures. Mounting instructions are provided in the following section:



Mounting frames for PT power modules (Page 118)

The following dimension drawings and drilling patterns are not to scale.

#### Frame sizes FSA ... FSC

Wall thickness of the control cabinet  $\leq 3.5$  mm

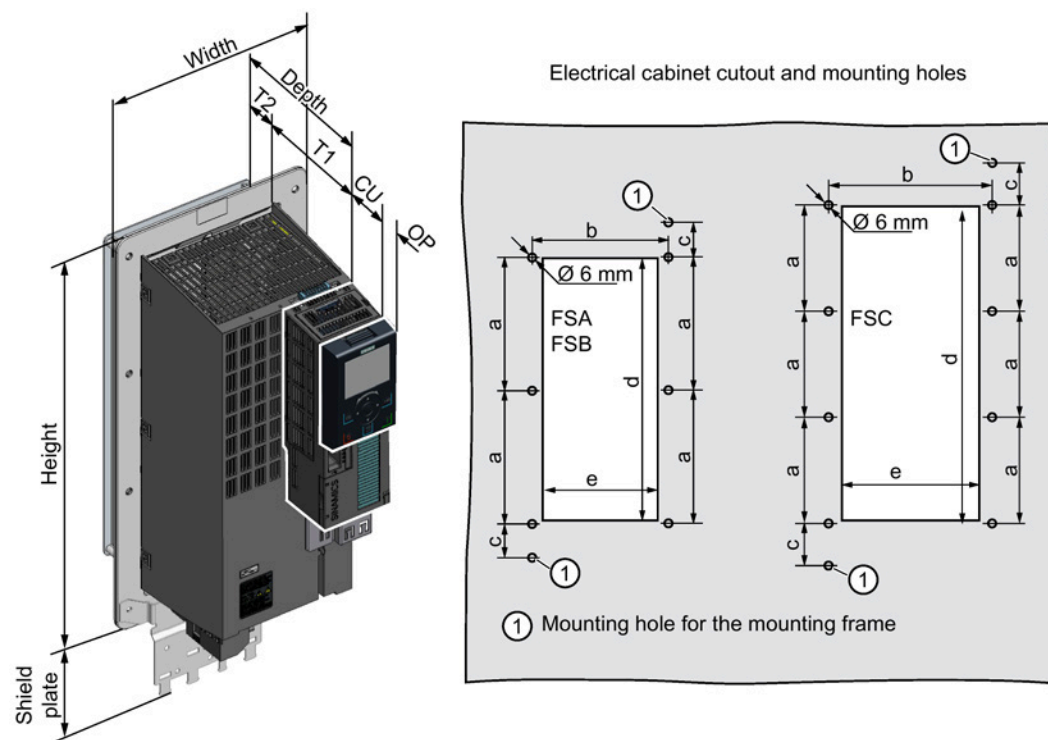


Figure 3-5 Dimension drawing and drilling dimensions for frame sizes FSA ... FSC

## 3.4 Mounting the Power Modules

Table 3- 5 Dimensions depend on the Control Unit (CU) and HMI device [mm]

Frame size	Width [mm]	Height [mm]		Overall depth in the cabinet [mm]			
		Without shield plate	With shield plate	T1	with CU230P-2 <sup>1)</sup>	with CU240B-2 <sup>1)</sup> / CU240E-2 <sup>1)</sup>	with CU250S-2 <sup>1)</sup>
FSA	126	238	322	118	177	159	180
FSB	154	345	430	118	177	159	180
FSC	200	411	500	118	177	159	180

- <sup>1)</sup> With a Smart Access Module plus 9 mm  
 With blanking cover or with Operator Panel plus 11 mm.

Table 3- 6 Cooling air clearances and additional dimensions

Frame size	Power Module depth [mm]			Cooling air clearances [mm] <sup>1)</sup>		
	T1 + T2	T1	T2	Top	Bottom	Front
FSA ... FSC	171	118	53	80	100	100

- <sup>1)</sup> The Power Module is designed for mounting without any lateral cooling air clearance. For tolerance reasons, we recommend a lateral clearance of 1 mm.

Table 3- 7 Electrical cabinet cutout and mounting

Frame size	Control cabinet cutout [mm]					Fixing/torque [Nm]
	a	b	c	d	e	
FSA	103	106	27	198	88	8 × M5 / 3.5
FSB	148	134	34.5	304	116	8 × M5 / 3.5
FSC	123	174	30.5	365	156	10 × M5 / 3.5

## Frame sizes FSD ... FSF

Wall thickness of the control cabinet  $\leq 3.5$  mm

Cutouts of the control cabinet and mounting holes

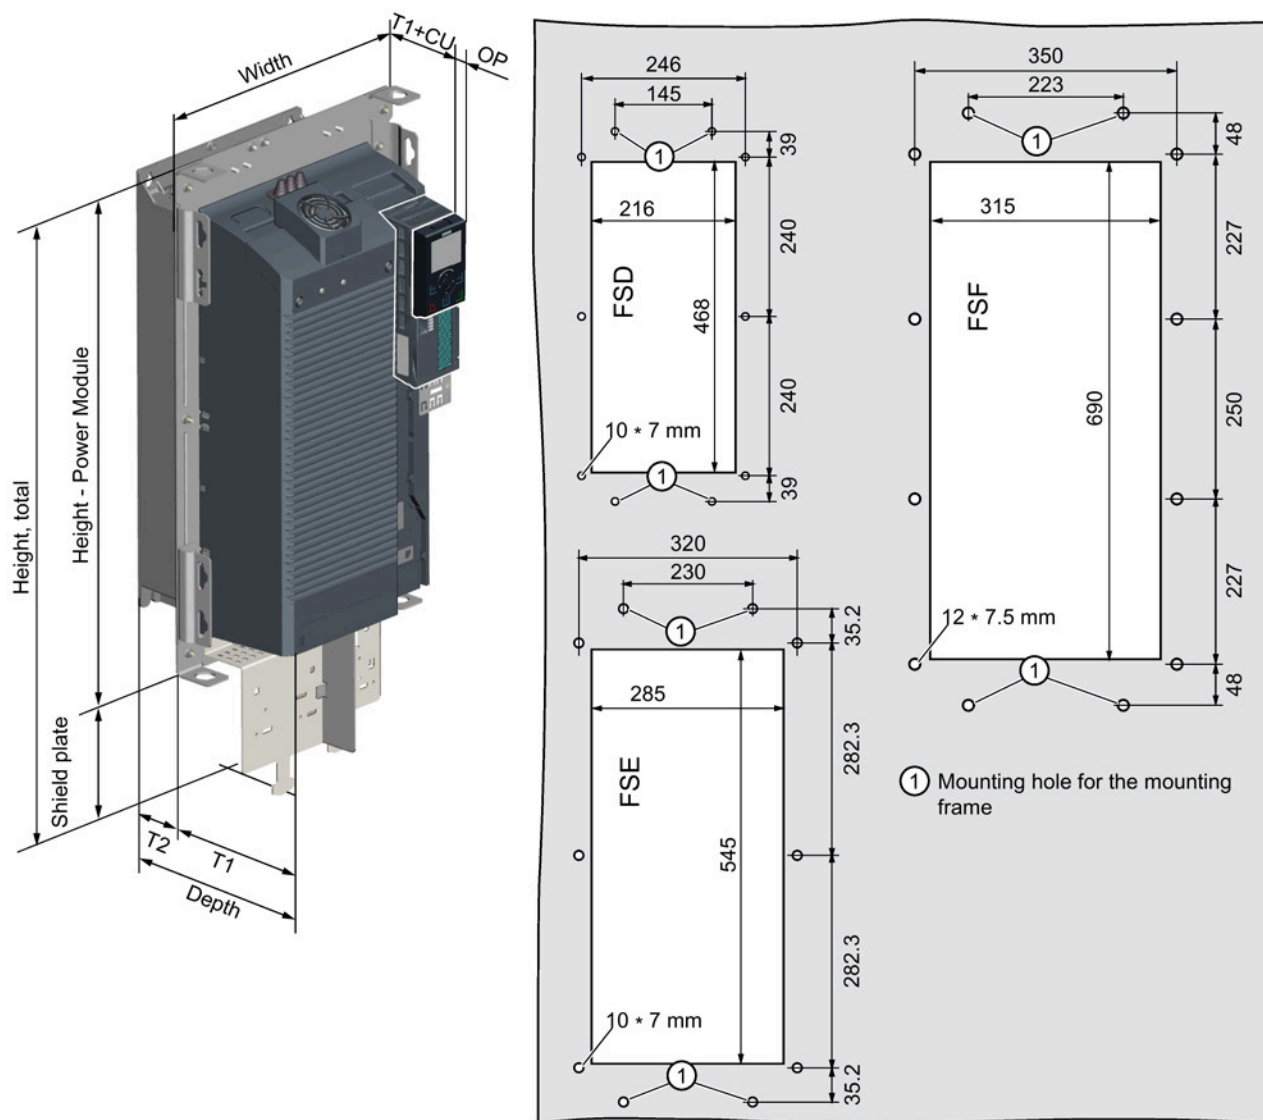


Figure 3-6 Dimension drawing and drilling dimensions for frame sizes FSD ... FSF

Table 3- 8 Dimensions depend on the Control Unit (CU) and HMI device [mm]

Frame size	Width [mm]	Height [mm]		Overall depth in the cabinet [mm]			
		Without shield plate	With shield plate	T1	with CU230P-2 <sup>1)</sup>	with CU240B-2 <sup>1)</sup> / CU240E-2 <sup>1)</sup>	with CU250S-2 <sup>1)</sup>
FSD	275	517	650	141	155	141	158
FSE	354	615	772	141	155	141	158
FSF	384	785	1021	177.5	193	177.5	196

<sup>1)</sup> With a Smart Access Module plus 9 mm  
 With blanking cover or with Operator Panel plus 11 mm.

Table 3- 9 Cooling air clearances, further dimensions and mounting


Frame size	Power Module depth [mm]			Cooling air clearances [mm]			Fixing/torque [Nm]
	T1 + T2	T1	T2	Top	Bottom	Front	
FSD	238.5	141	97.5	350	300	100	10 × M5 / 3.5
FSE	238.5	141	97.5	350	300	100	10 × M5 / 3.5
FSF	358	177.5	180.5	350	300	100	12 × M6 / 5.9

### 3.4.4 Mounting the shield plates


Use the provided shield plate for strain relief of the line and motor cable – as well as the shield support for the motor cable.

The shield plates and fixings screws are included in the converter accessory kit.

#### Mounting the shield plate, FSA ... FSC - Built-in devices

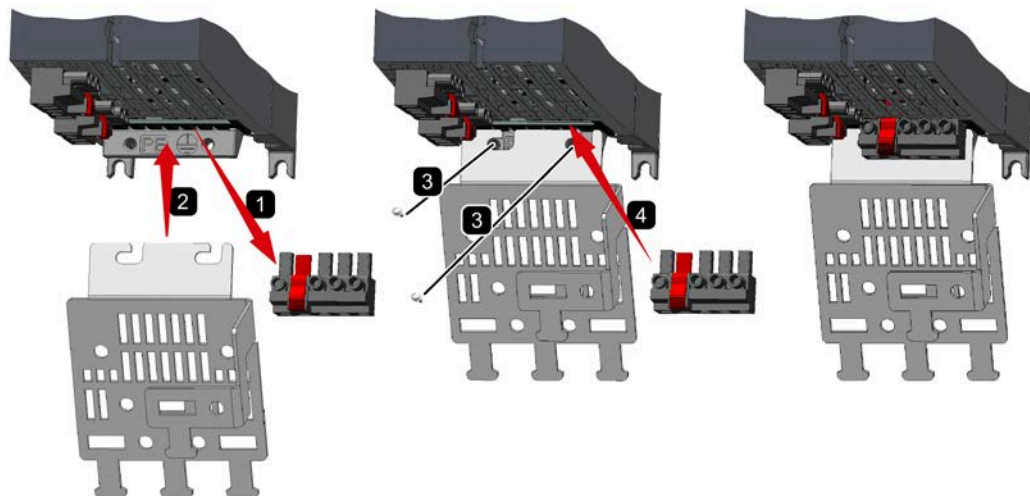

### Mounting the shield plate, FSA ... FSC - PT Power Module

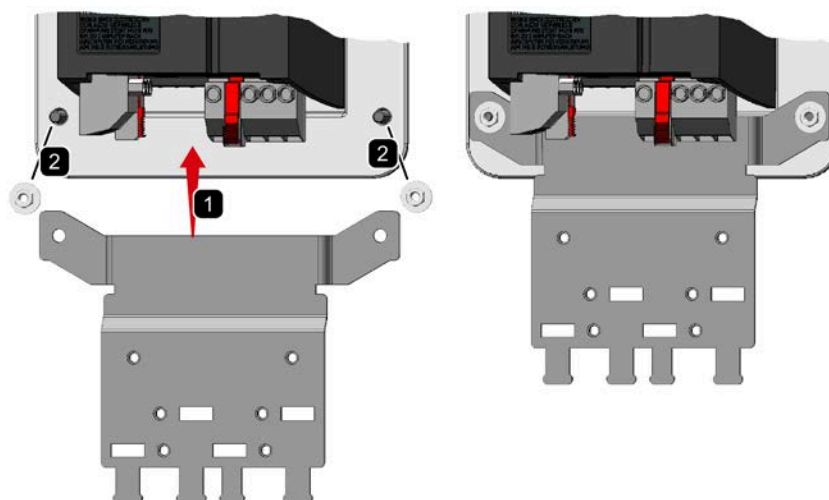

---

#### Note

##### Built-in devices and PT Power Modules

The shield plates are mounted in the same way for PT and IP20 devices.

##### Upper shield plate

The top shield plate is not supplied with the converter. You need it as a shield support when you connect an external braking resistor.



Braking resistor (Page 133)

##### EMC connecting bracket

The EMC connecting bracket is only supplied with converters with integrated filter.

---

## Mounting the shield plate, FSD and FSE

### Procedure



Proceed as follows to mount the shield plate:

- If you are using a Brake Relay to control a motor holding brake, then mount the Brake Relay at the rear of the shield plate.



Mounting and connecting the brake relay (Page 143)

- **If the device has an integrated line filter:**

Fasten the EMC connecting bracket to the shield plate using four screws ①.


Then slide the shield plate with the EMC connecting bracket into the converter, so that it is held in the converter by the clamping spring ②.

The EMC connecting bracket is positioned correctly if there is some resistance when it is withdrawn from the converter.

Having ensured that it is positioned correctly, fasten the shield plate in place using the four screws ③.

- **If the device is unfiltered:**

Having ensured that it is positioned correctly, fasten the shield plate in place using the four screws ③.

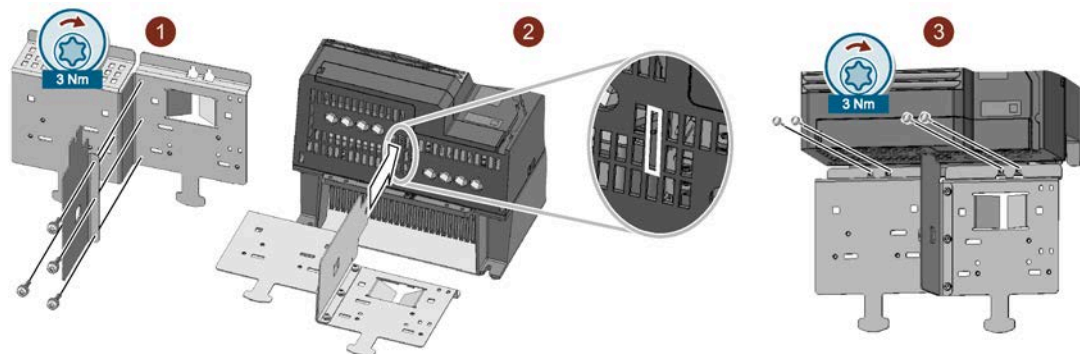

You have mounted the shield plate.

Use the shield plate provided for strain relief of the line and motor cable – as well as the shield support for the motor cable.

If you are using the converter without filter, then you do not require the EMC connecting bracket. In this case, attach the shield plate to the converter without the EMC connecting bracket

If you are using a converter with integrated line filter, then mount the shield plate and EMC connecting bracket as described below.

### Note

#### Brake relay


If you are using a brake relay to control a motor brake, then mount the brake relay at the rear of the lower shield plate before you attach the shield module to the converter.



Mounting and connecting the brake relay (Page 143)

### Procedure - FSD and FSE


- ➔ 1. Proceed as follows to mount the EMC connecting bracket and the shield plate:
1. Attach the EMC connecting bracket to the shield plate ①.
  2. Then slide the shield module into the converter, so that it is held in the converter ② by the clamping spring. The shield module is located correctly if it can be easily withdrawn out of the converter without any resistance.
  3. After you have ensured that it is correctly located, fix the shield module using the four screws ③.

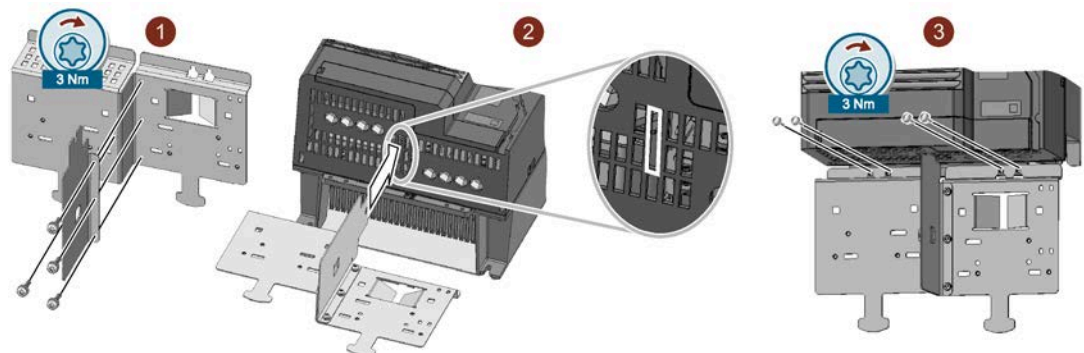

■ You have correctly mounted the EMC connecting bracket and the shield plate.

### Procedure - FSF:

- ➔ 1. Proceed as follows to mount the EMC connecting bracket and the shield plate:
1. Attach the EMC connecting bracket to the shield plate ①.
  2. Screw the shield module to the converter ② using three screws, as shown in the diagram.

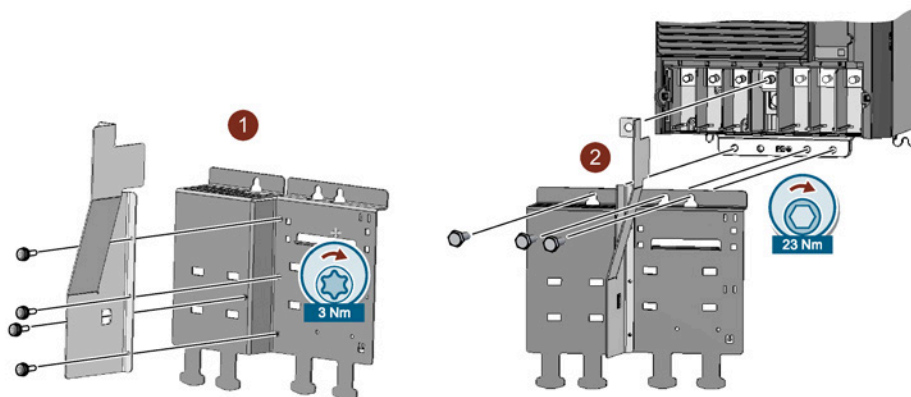

■ You have correctly mounted the EMC connecting bracket and the shield plate.

## Mounting the shield plate, FSG

### Procedure




Proceed as follows to mount the shield plate:

- If you are using a Brake Relay to control a motor holding brake, then mount the Brake Relay at the rear of the shield plate.



Mounting and connecting the brake relay (Page 143)


- Secure each side part to the shield plate with two screws ①.
- Fasten the EMC connecting bracket to the shield plate with four screws ②.
- Screw the shield plate to the converter together with the side parts and EMC connecting bracket using four screws ③

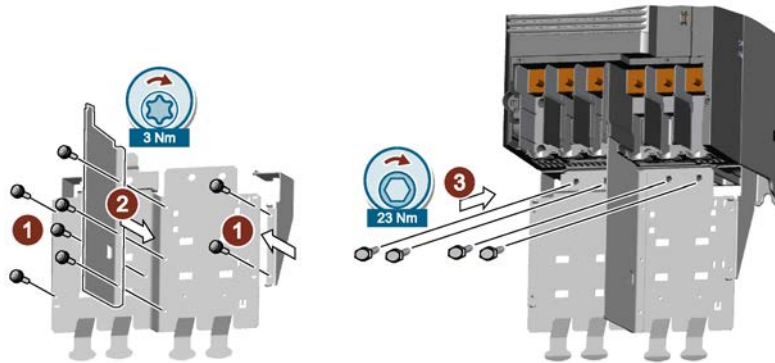

You have mounted the shield plate.

### 3.4.5 Hoisting gear FSD ... FSG

Power Module weights:


 200 V converter (Page 79)

 400 V converter (Page 89)

 690 V converter (Page 101)


#### Hoisting gear - Built-in devices

Use crane lifting lugs and the appropriate hoisting gear when mounting built-in devices.

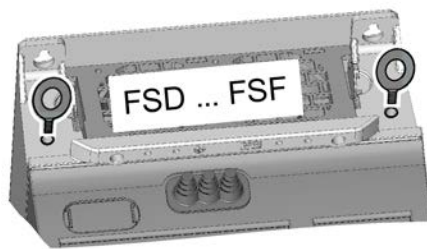


#### Hoisting gear - PT devices

Use the hoisting gear shown below when mounting the Power Modules

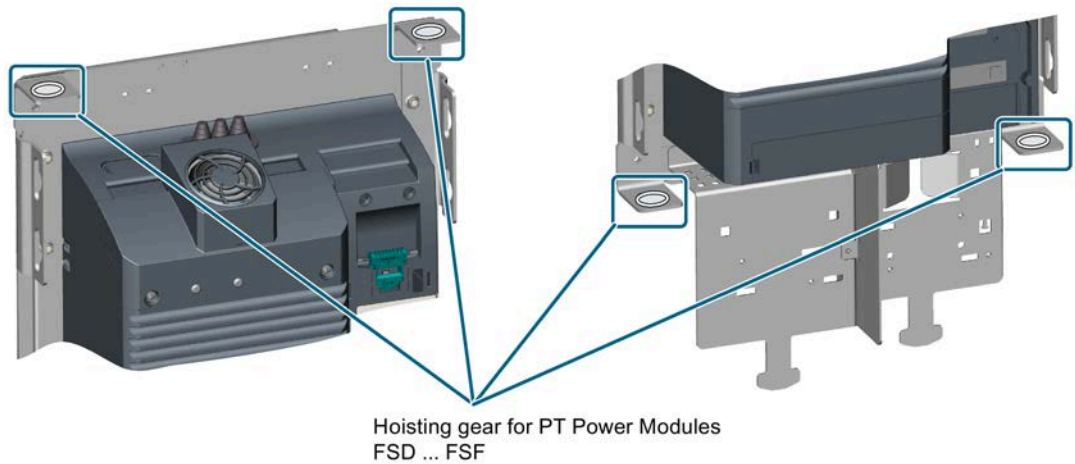

Alternatively, you have the option of attaching mounting grips onto the Power Module.

 Mounting grips for PT Power Modules (Page 122).

### **3.4.6 Additional components**

Depending on the particular application, additional components may be required for your system. Information about additional components is provided in the following Sections:



Connection overview (Page 53)



Accessories (Page 117)

# Connecting

Install the converter so that you are compliant with local regulations for erecting and installing low-voltage systems.

---

## Note

### Safety devices

Install suitable protective equipment between the line supply and converter.



Technical data (Page 73)

---

## Note

### Operating displays for converter operation

If, when switching over a function from ON to OFF, an LED or other similar display is not lit or not active; this does not indicate that the device is switched-off or in a no-current condition.

---

Observe the following product note about protection against indirect contact:

To protect against indirectly touching part of the motor circuit of a converter and to automatically shut down in the case of a fault according to DIN EN 60364-4-41 (VDE 0100-410). (<http://support.automation.siemens.com/WW/view/en/103474630>)



## WARNING

### Electrical shock due to inadequate touch protection

Due to faulty contact protection, the power connections of the converter may be openly accessible. Touching live power connections can result in death or severe injury.

- Make the openings for the converter power connections just large enough for the cables to be routed through.
  - Cover power connections that are not used so that they cannot be touched.
  - Use the dummy plugs provided in the accessory pack for unused terminals.
- 

## Note

### Fault of the wireless services caused by high-frequency faults in residential environments

In a residential environment this product can cause high-frequency interference, which may make interference suppression measures necessary.

- Have qualified personnel carry out the installation and commissioning with suitable interference suppression measures.
-



### **! WARNING**

#### **Fire or electric shock due to unsuitable residual-current protective devices**

The converter may create a current through the protective conductor. The current through the protective conductor can cause the residual current device (RCD) or residual current monitor (RCM) to incorrectly trip (nuisance trip). In the case of a ground fault, the fault current can contain a DC component, which prevents the RCD or RCM from tripping, with the risk of subsequent fire or electric shock.

- Use the protection and monitoring devices recommended in the documentation.

### **! CAUTION**

#### **Burns due to touching hot surfaces**

Certain components (e.g. the heat sink or line reactor) can become very hot during operation. The components can remain hot for some time after operation. Touching hot surfaces can cause burns to the skin.

- Do not touch hot components during operation or immediately following operation.

## **Protection and monitoring equipment**

To provide protection against short-circuit, use the overcurrent devices listed in Technical data (fuses, circuit breakers etc.).

If the earth fault loop impedance of the line supply at the infeed point is too high to ensure that the overcurrent protective device disconnects within the stipulated time in the case of insulation failure (ground fault, fault to frame), then you must use additional residual current protective devices RCD, type B.

In order that an RCD does not unnecessarily trip as a result of operational leakage currents, the following preconditions must be fulfilled:

- The neutral point of the line supply is grounded.
- For converters with rated input currents  $\leq 80$  A referred to LO, use a Siemens SIQUENCE RCCB (series 5SV364.-4), type B, short-time delayed [K] with a rated residual current of 300 mA. Connect the RCCB in series with the overcurrent protective devices.
- For converters with rated input currents  $\leq 160$  A referred to LO, use a Siemens residual current device RCD520B (3VA9113-0RL21) mounted onto a Siemens molded case circuit breaker (series 3VA1).

Recommended settings:

- Response characteristic B
- Residual current trip level 300 mA
- Response delay  $\geq 0.06$  s

- For converters with rated input currents > 160 A referred to LO, use a Siemens modular RCCB device (MRCD type B 5SV8111-4KK) with a current transformer (5SV870.-2K), a circuit breaker (series 3VA1) and a trip element (3VA9988-0BL30).

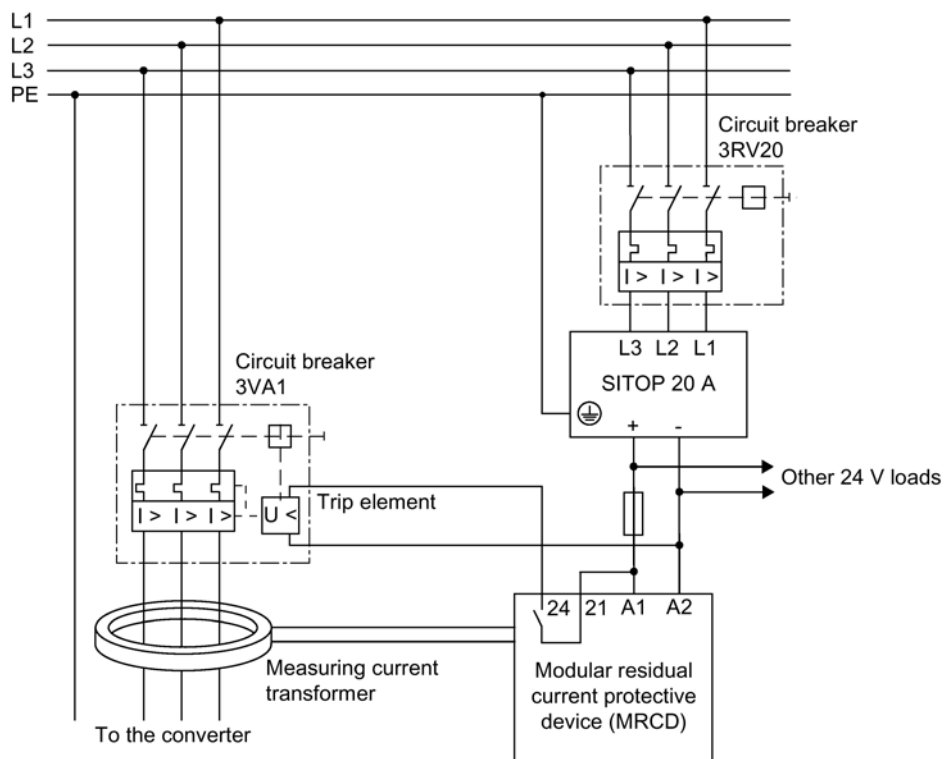



Figure 4-1 MRCD

- A dedicated RCD is used for every converter.
  - The motor cables are shorter than 50 m (164 ft) shielded, or 100 m (328 ft) unshielded.
- Additional information about motor cables:

 Length of the motor cable (Page 56)



Further protection and monitoring equipment

(<https://support.industry.siemens.com/cs/ww/en/view/109486009>)

## 4.1 Permissible line supplies

The converter is designed for the following line supplies according to IEC 60364-1 (2005).

- TN system
- TT system
- IT system

### General requirements on line supply

The plant builder or machine manufacturer must ensure for operation with rated current  $I_{rated}$  that the voltage drop between the transformer input terminals and the converter when operated with its rated values is less than 4% of the transformer rated current

### Restrictions for installation altitudes above 2000 m

Above an installation altitude of 2000 m, the permissible line supplies are restricted.



Restrictions for special ambient conditions (Page 105)

## Screw for functional grounding on the converter, frame size FSG

If you wish to use the converters with integrated C3 line filter, please note the information in the sections "TN line system", "TT line system" and "IT system" below.

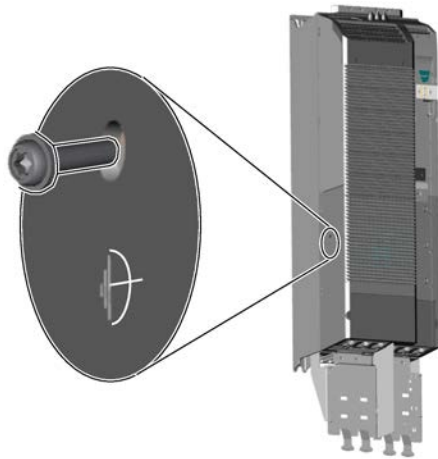



Figure 4-2 Remove screw for functional grounding

### 4.1.1 TN line system

A TN system transfers the PE protective conductor to the installed plant or system using a cable.

Generally, in a TN system the neutral point is grounded. There are versions of a TN system with a grounded line conductor, e.g. with grounded L1.

A TN system can transfer the neutral conductor N and the PE protective conductor either separately or combined.

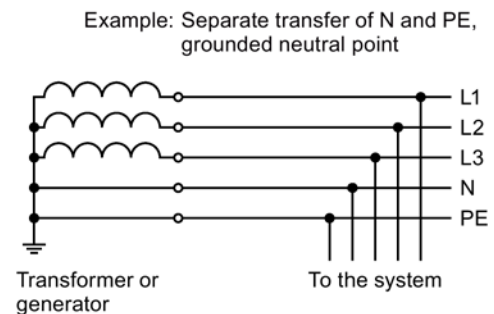

#### Converter connected to a TN system

- Converters with integrated line filter:
  - Operation on TN line systems with grounded neutral point permissible.
  - Operation on TN line systems with grounded line conductor not permissible.

---

#### Note

##### Special feature of FSG converters

FSG converters with integrated C3 line filter can be operated in TN line systems  $\leq 600$  V with a grounded line conductor if you remove the screw for functional grounding.



Figure 4-2 Remove screw for functional grounding (Page 46)

If you remove the screw for functional grounding, the EMC properties deteriorate and the requirements of Class C3 are no longer met.


---

- Converters with external line filter:
  - Operation on TN line systems with grounded neutral point permissible.
  - Operation on TN line systems with grounded line conductor not permissible.
- Converter without line filter:
  - Operation on all TN line systems  $\leq 600$  V permissible.
  - Operation on TN line systems  $> 600$  V and grounded neutral point permissible.
  - Operation on TN line systems  $> 600$  V and grounded line conductor not permissible.

### 4.1.2 TT line system

In a TT line system, the transformer grounding and the installation grounding are independent of one another.

There are TT line supplies where the neutral conductor N is either transferred – or not.

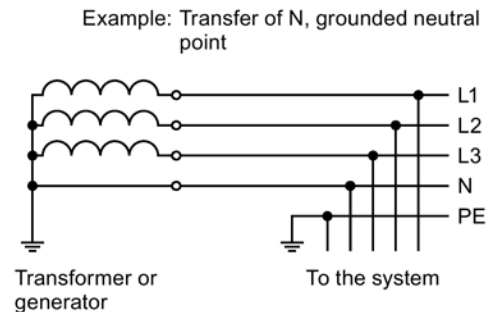

#### Note

##### Operation in IEC or UL systems

For installations in compliance with IEC, operation on TT line systems is permissible. For installations in compliance with UL, operation on TT line systems is not permissible.

### Converters connected to a TT system

- Converters with integrated line filter:
  - Operation on TT line systems with grounded neutral point permissible.
  - Operation on TT line systems without grounded neutral point not permissible.

#### Note

##### Special feature of FSG converters

FSG converters with integrated C3 line filter can be operated in TT line systems without a grounded neutral point if you remove the screw for functional grounding.



Figure 4-2 Remove screw for functional grounding (Page 46)


If you remove the screw for functional grounding, the EMC properties deteriorate and the requirements of Class C3 are no longer met.

- Converters with external line filter:
  - Operation on TT line systems with grounded neutral point permissible.
  - Operation on TT line systems without grounded neutral point not permissible.
- Converters without line filter:
  - Operation on all TT line systems permissible.

### 4.1.3 IT system

In an IT line system, all of the conductors are insulated with respect to the PE protective conductor – or connected to the PE protective conductor through an impedance.

There are IT systems with and without transfer of the neutral conductor N.

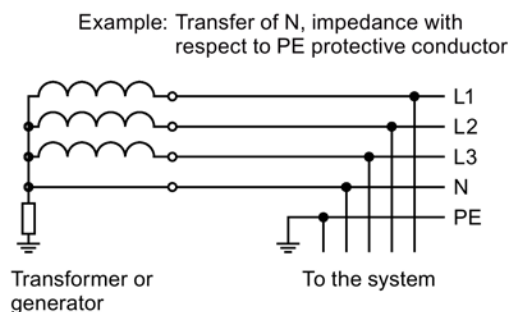

#### Note

##### Behavior of the converter when a ground fault occurs

If the converter is to remain operable even when a ground fault occurs at the converter output, you must install an output reactor. This prevents an overcurrent trip or damage to the drive.

### Converters connected to an IT system

- Converters with integrated line filter:
  - Operation on IT line systems not permissible.

#### Note

##### Special feature of FSG converters

FSG converters with integrated C3 line filter can be operated in IT line systems if you remove the screw for functional grounding.



Figure 4-2 Remove screw for functional grounding (Page 46)

If you remove the screw for functional grounding, the EMC properties deteriorate and the requirements of Class C3 are no longer met.

- Converters without line filter:
  - Operation on all IT line systems permissible.

#### Note

##### 690 V converters: Output reactors for frame sizes FSD and FSE

An output reactor is required for 690 V reactors in frame sizes FSD and FSE.

#### 4.1.4 Requirements for the protective conductor

##### Overview

A high leakage current flows through the protective conductor in converter operation. The protective conductor of the converter must not be interrupted for safe touch protection in converter operation.

This primarily results in requirements for the minimum conductor cross-section of the protective conductor.

No restriction applies to the length of the protective conductor for touch protection. However, short protective conductors are advantageous for EMC-compliant installation.

##### Description




##### WARNING

##### Electric shock due to interrupted protective conductor

The drive components conduct a high leakage current via the protective conductor. Touching conductive parts when the protective conductor is interrupted can result in death or serious injury.

- Comply with the requirements for the protective conductor.

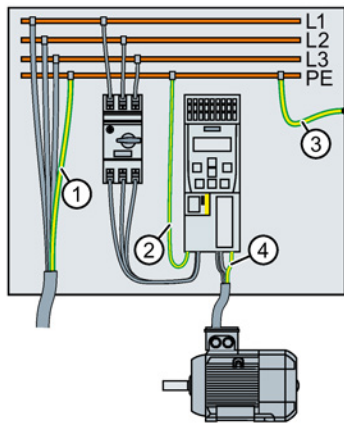

- ① Protective conductor for line feeder cables
- ② Protective conductor for converter line feeder cables
- ③ Protective conductor between PE and the control cabinet
- ④ Protective conductor for motor feeder cables

The minimum cross-section of the protective conductor ① ... ④ depends on the cross-section of the line or motor feeder cable:

- Line or motor feeder cable  $\leq 16 \text{ mm}^2$   
⇒ Minimum cross-section of the protective conductor = cross-section of the line or motor feeder cable
- $16 \text{ mm}^2 < \text{line or motor feeder cable} \leq 35 \text{ mm}^2$   
⇒ Minimum cross-section of the protective conductor =  $16 \text{ mm}^2$
- Line or motor feeder cable  $> 35 \text{ mm}^2$   
⇒ Minimum cross-section of the protective conductor =  $\frac{1}{2}$  cross-section of the line or motor feeder cable

Additional requirements placed on the protective conductor ①:

- For permanent connection, the protective conductor must fulfill at least one of the following conditions:
  - The protective conductor is routed so that it is protected against damage along its complete length.  
Cables routed inside switch cabinets or enclosed machine housings are considered to be adequately protected against mechanical damage.
  - As a conductor of a multi-conductor cable, the protective conductor has a cross-section  $\geq 2.5 \text{ mm}^2 \text{ Cu}$ .
  - For an individual conductor, the protective conductor has a cross-section  $\geq 10 \text{ mm}^2 \text{ Cu}$ .
  - The protective conductor consists of 2 individual conductors with the same cross-section.
- When connecting a multi-core cable using an industrial plug connector according to EN 60309, the protective conductor must have a cross-section of  $\geq 2.5 \text{ mm}^2 \text{ Cu}$ .
- Observe the local regulations for protective conductors subject to a high leakage current at the installation site.

## 4.1.5 Using several single-phase converters in machines and plants

### Overview

Evaluate the input currents of single-phase converters in your machine or plant in terms of harmonics and unbalance.

## Description

In unfavorable cases, the harmonic currents of several converters in the neutral conductor (N) add up to a value greater than the currents of the line conductors (L1, L2, L3). The current carrying capacity of the neutral conductor must be sufficient for this. IEC 60364-5-52:2019, section 524, makes recommendations for sizing the neutral conductor. If no more precise information is available, the standard recommends dimensioning the neutral conductor for 1.45 times the current carrying capacity of the line conductors.

### CAUTION

#### Fire caused by neutral conductor (N) overload

The neutral conductor can heat up due to the load from harmonic currents and cause a fire.

- Consider the harmonic currents when dimensioning the neutral conductor.



### WARNING

#### Electric shock caused by PEN conductor overload

In TN-C supply networks, the protective function of the PEN conductor can be adversely affected by exposure to harmonic currents.

- Consider the harmonic currents when dimensioning the PEN conductor.

## 4.2 Connecting the line and motor cable at the converter

### 4.2.1 Connection overview

#### Note

##### Line reactor

No line reactor is required for FSD ... FSG Power Modules.


##### Line filter

The converters are available with or without integrated line filter (Class A). For frame sizes FSA ... FSC, 3 AC 400 V, there are external filters (Class B regarding conducted emissions) for increased EMC requirements.

 Line filters (Page 125)

##### Line harmonics filter

If you use a line harmonics filter you do not need a line reactor or a line filter.

 Line harmonics filters (Page 126)

##### Output reactor

For frame sizes FSD ... FSG no output reactor is required in many cases on account of the long cable lengths between the converter and the motor.

 Output reactors (Page 144)

##### Braking resistor

Connect a braking resistor to the converter via the R1 and R2 terminals.

 Braking resistors (Page 133)

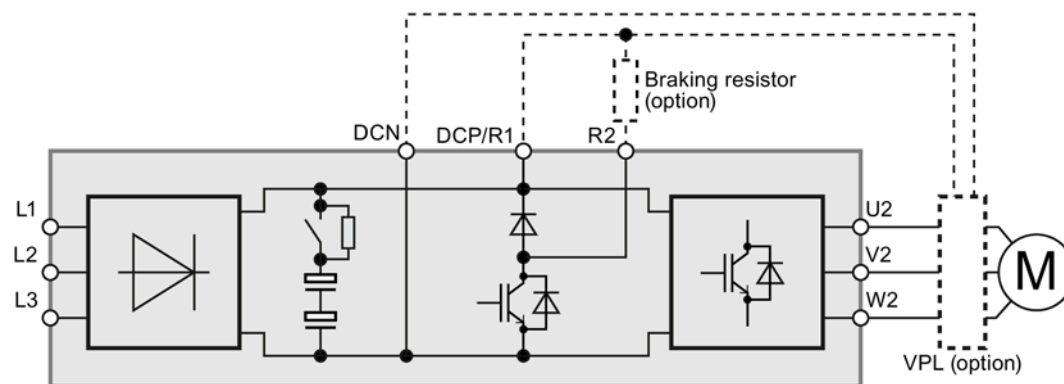


Figure 4-3 Block diagram of the converter, FSA ... FSC

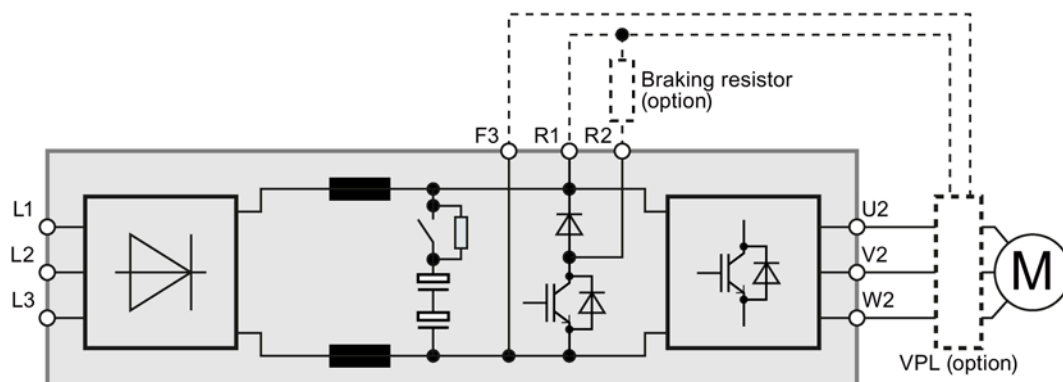


Figure 4-4 Block diagram for the converter, FSD ... FSG

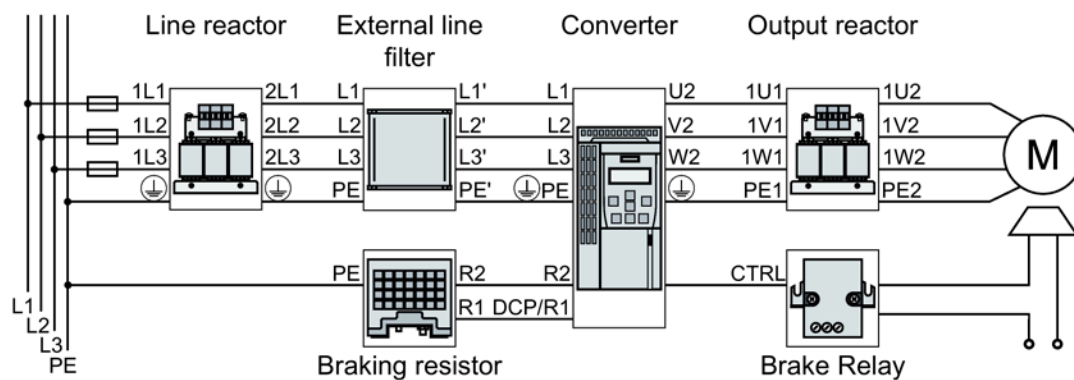


Figure 4-5 Connecting the PM240-2 Power Module, 200 V / 400 V 3 AC, FSA ... FSC

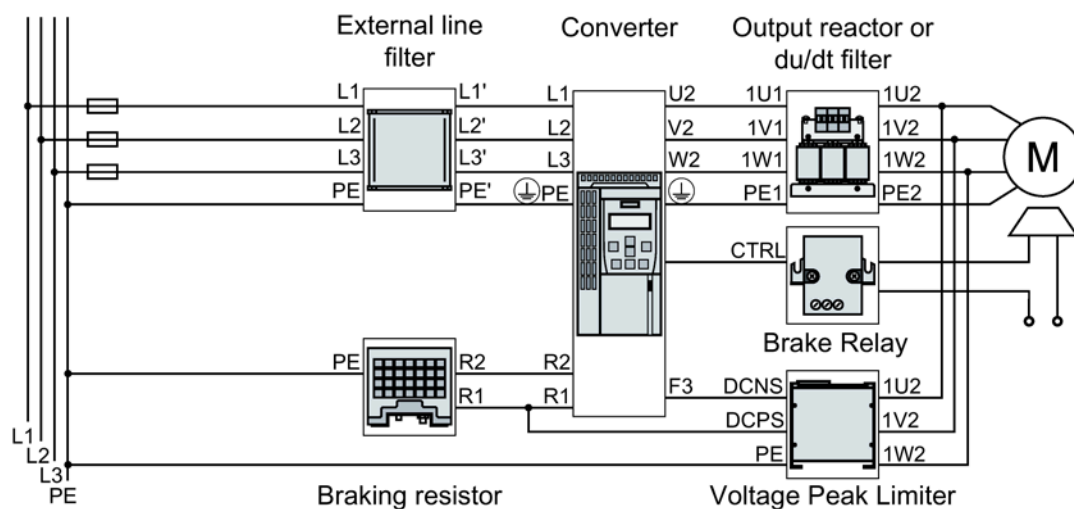


Figure 4-6 Connecting the PM240-2 Power Module, 200 V / 400 V / 690 V 3 AC, FSD ... FSG

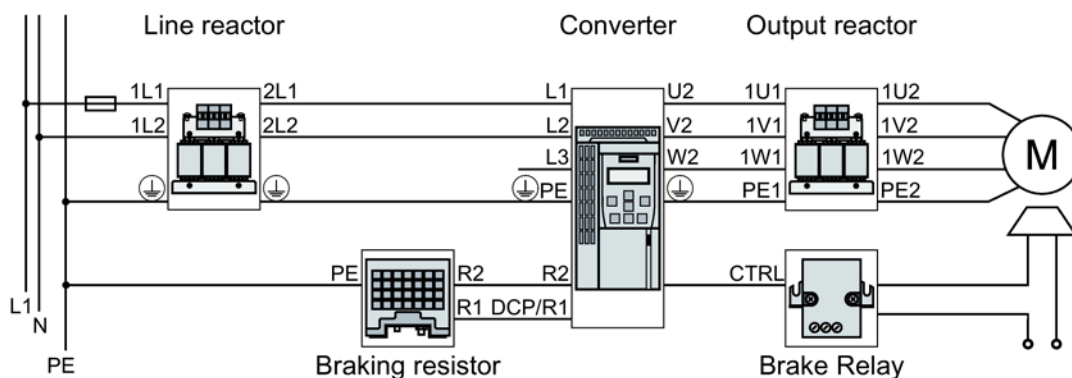


Figure 4-7 Connecting the PM240-2 Power Module, 200 V 1 AC, FSA ... FSC

### Note

#### Connecting PM240-2 Power Modules, 200 V to 1 AC - only FSA ... FSC

For the 200 V versions and single-phase line systems, connect the phase conductor and neutral conductor to any two of the terminals L1, L2, L3.


### Connect cables at the converter so that they are EMC compliant

Attach the cable tie holders to the Power Module as shown to the left in the diagram before you establish the connections.

Fix the line connecting cable using a cable tie as shown in ①.

Fix the shield of the motor connecting cable using a hose clamp (②).

Connect the shield of the control cable with the shield plate of the Control Unit (③) using a steel band. Also attach the control cable to the Power Module using a cable tie (④).

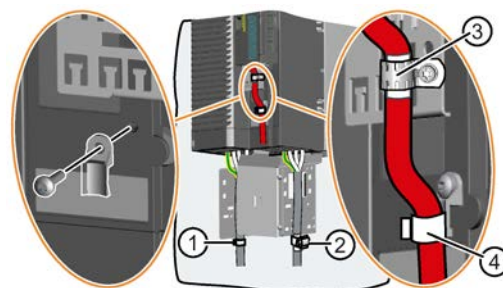

### 4.2.2 Length of the motor cable

Always dimension the motor cable so that the ohmic losses are less than 5 % of the converter power rating.

The permissible length of the motor cable also depends on the quality of the motor cable and the converter pulse frequency. The values specified below are applicable for high quality cables, such as CY100 or similar, and for the pulse frequencies set in the factory.



Technical data (Page 73)

If you set other pulse frequencies, then you must ensure that the EMC category is complied with on the plant or system side.

EMC-compliant wiring is required in order that the converter complies with the EMC category listed in the following table.



EMC-compliant installation of a machine or system (Page 22)

Carefully observe the following section for operation in the first environment:



Electromagnetic compatibility of variable-speed drives (Page 107)

Table 4- 1 Permissible lengths of motor connecting cables, converter FSA ... FSC

EMC category	Second Environment, C2		No EMC category		
Converter	with internal C2 filter	with external C1 filter, without output reactor	without filter, without output reactor	without filter, with output reactor	
Cable	Shielded	Shielded	Shielded/unshielded	Shielded	Unshielded
200 V	50 m	---	150 m	150 m	225 m
400 V	50 m <sup>1)</sup>	150 m <sup>3)</sup>	150 m	150 m	225 m

<sup>1)</sup> For a low-capacitance motor cable: FSB 100 m, FSC 150 m

<sup>2)</sup> For a low-capacitance motor cable: FSA 150 m, FSB 100 m, FSC 100 m

<sup>3)</sup> 150 m for voltages in the range 380 V ... 415 V,  
100 m for voltages in the range 440 V ... 480 V

Table 4- 2 Permissible cable lengths for the motor connection, FSD ... FSE

EMC category	Second Environment, C2	No EMC category			
Converter	with internal C2 filter	with or without filter, with or without output reactor		without filter, with two output reactors in series	
Cable	Shielded	Shielded	Unshielded	Shielded	Unshielded
200 V	150 m	200 m	300 m	350 m	525 m
400 V	150 m	200 m	300 m	350 m	525 m
690 V	100 m	200 m	300 m	---	---

Table 4- 3 Permissible cable lengths for the motor connection, FSF

Converter	with internal C2 filter	with or without filter, with or without output reactor		without filter, with two output reactors in series	
EMC category	Second Environment, C2	No EMC category			
Cable	Shielded	Shielded	Unshielded	Shielded	Unshielded
200 V	150 m	300 m	450 m	525 m	800 m
400 V	150 m	300 m	450 m	525 m	800 m
690 V	150 m <sup>1)</sup>	300 m	450 m	525 m	800 m

Restriction for PT devices with 400 V: Use a double-shielded cable for the motor connection.

<sup>1)</sup> only C3


Table 4- 4 Permissible cable lengths for the motor connection, FSG



Converter	with internal C2 filter	with or without filter, with or without output reactor		without filter, with two output reactors in series	
EMC category	Second Environment, C2	No EMC category			
Cable	Shielded	Shielded	Unshielded	Shielded	Unshielded
400 V	150 m 300 m <sup>1)</sup>	300 m	450 m	525 m	800 m
690 V	300 m <sup>1)</sup>	300 m	450 m	525 m	800 m

<sup>1)</sup> only C3

### 4.2.3 Connection terminals at the converter

Table 4- 5 Connection, cross-section and tightening torque for PM240-2 Power Modules

Converter	Connection		Cross-section and tightening torque		Stripped insulation length
			Metric	Imperial	
FSA	Line system, motor and braking resistor	 Plug connector with screw terminals	1.5 ... 2.5 mm <sup>2</sup> , 0.5 Nm	16 ... 14 AWG, 4.5 lbf in	8 mm
FSB			1.5 ... 6 mm <sup>2</sup> , 0.6 Nm	16 ... 10 AWG, 5.5 lbf in	8 mm
FSC			6 ... 16 mm <sup>2</sup> , 1.3 Nm	10 ... 6 AWG, 12 lbf in	10 mm
FSD	Line and motor	Screw-type terminal	10 ... 35 mm <sup>2</sup> , 2.5 ... 4.5 Nm	8 ... 2 AWG, 22 ... 40 lbf in	18 mm
	Braking resistor		2.5 ... 16 mm <sup>2</sup> , 1.2 ... 1.5 Nm	20 ... 6 AWG, 10.5 ... 13 lbf in	10 mm
FSE	Line and motor	Screw-type terminal	25 ... 70 mm <sup>2</sup> , 8 ... 10 Nm	6 ... 3/0 AWG, 71 ... 88.5 lbf in	25 mm
	Braking resistor		10 ... 35 mm <sup>2</sup> , 2.5 ... 4.5 Nm	8 ... 2 AWG, 22 ... 40 lbf in	18 mm

Converter	Connection		Cross-section and tightening torque		Stripped insulation length
			Metric	Imperial	
FSF	Line and motor	 Cable lug according to SN71322 for M10 bolts	35 ... 2 × 120 mm <sup>2</sup> , 22 ... 25 Nm	1 AWG ... 2 × 4/0 AWG, 195 ... 221 lbf.in	/
	Braking resistor	Screw-type terminal	25 ... 70 mm <sup>2</sup> , 8 ... 10 Nm	6 ... 3/0 AWG, 71 ... 88.5 lbf.in	25 mm
FSG	Line and motor	 Cable lug according to SN71322 for M10 bolts	35 ... 2 × 185 mm <sup>2</sup> , 22 ... 25 Nm	1 AWG ... 2 × 350 MCM, 195 ... 221 lbf.in	/
	Braking resistor	Screw-type terminal	25 ... 70 mm <sup>2</sup> , 8 ... 10 Nm	6 ... 3/0 AWG, 71 ... 88.5 lbf.in	25 mm

#### 4.2.4 Establishing connections

##### Procedure




1. Proceed as follows to establish the connections:

1. Ensure that the device is in a no-voltage condition and the DC link is discharged.
2. Establish the connections as described in the following sections.



This means that you have established the connections.

#### Connections for frame sizes FSA ... FSC

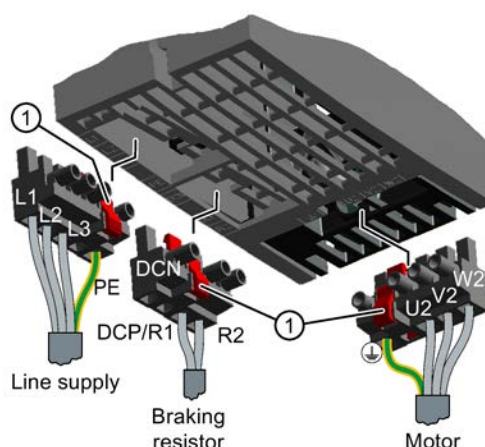

The Power Modules are equipped with withdrawable plug connectors that cannot be inadvertently interchanged.

To remove a plug connector, you must release it by pressing on the red lever.


① Release lever

## Connections for frame sizes FSD ... FSG


You must remove the covers from the connections in order to connect the line supply, braking resistor and motor to the converter.

In addition, for frame sizes FSD and FSE, release the two terminal screws on the connections for the motor and braking resistor, and remove the dummy plug.


For frame sizes FSF and FSG, you must breakout the openings from the connection cover for the power connections. Use side cutters or a fine saw blade.

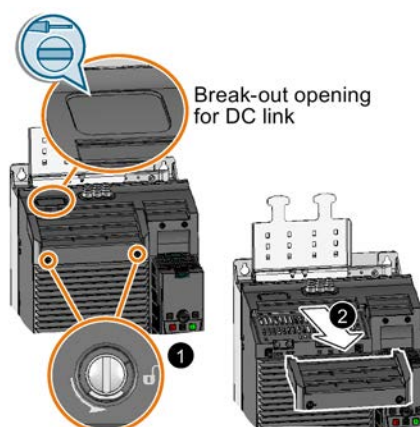

FSD ... FSG: Remove the top covers

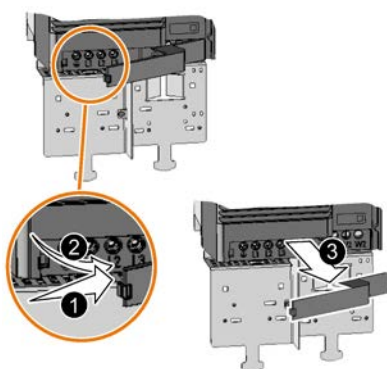

FSD, FSE: Remove the lower cover

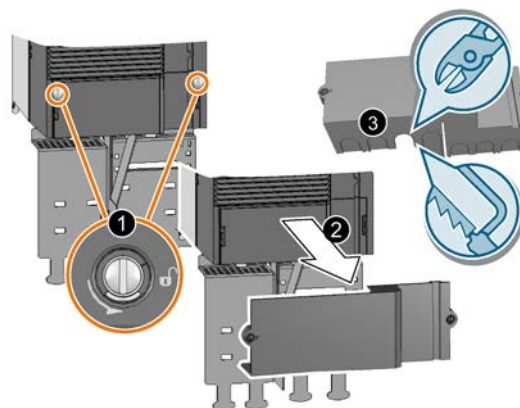

FSF, FSG: Remove the lower cover

## 4.2 Connecting the line and motor cable at the converter

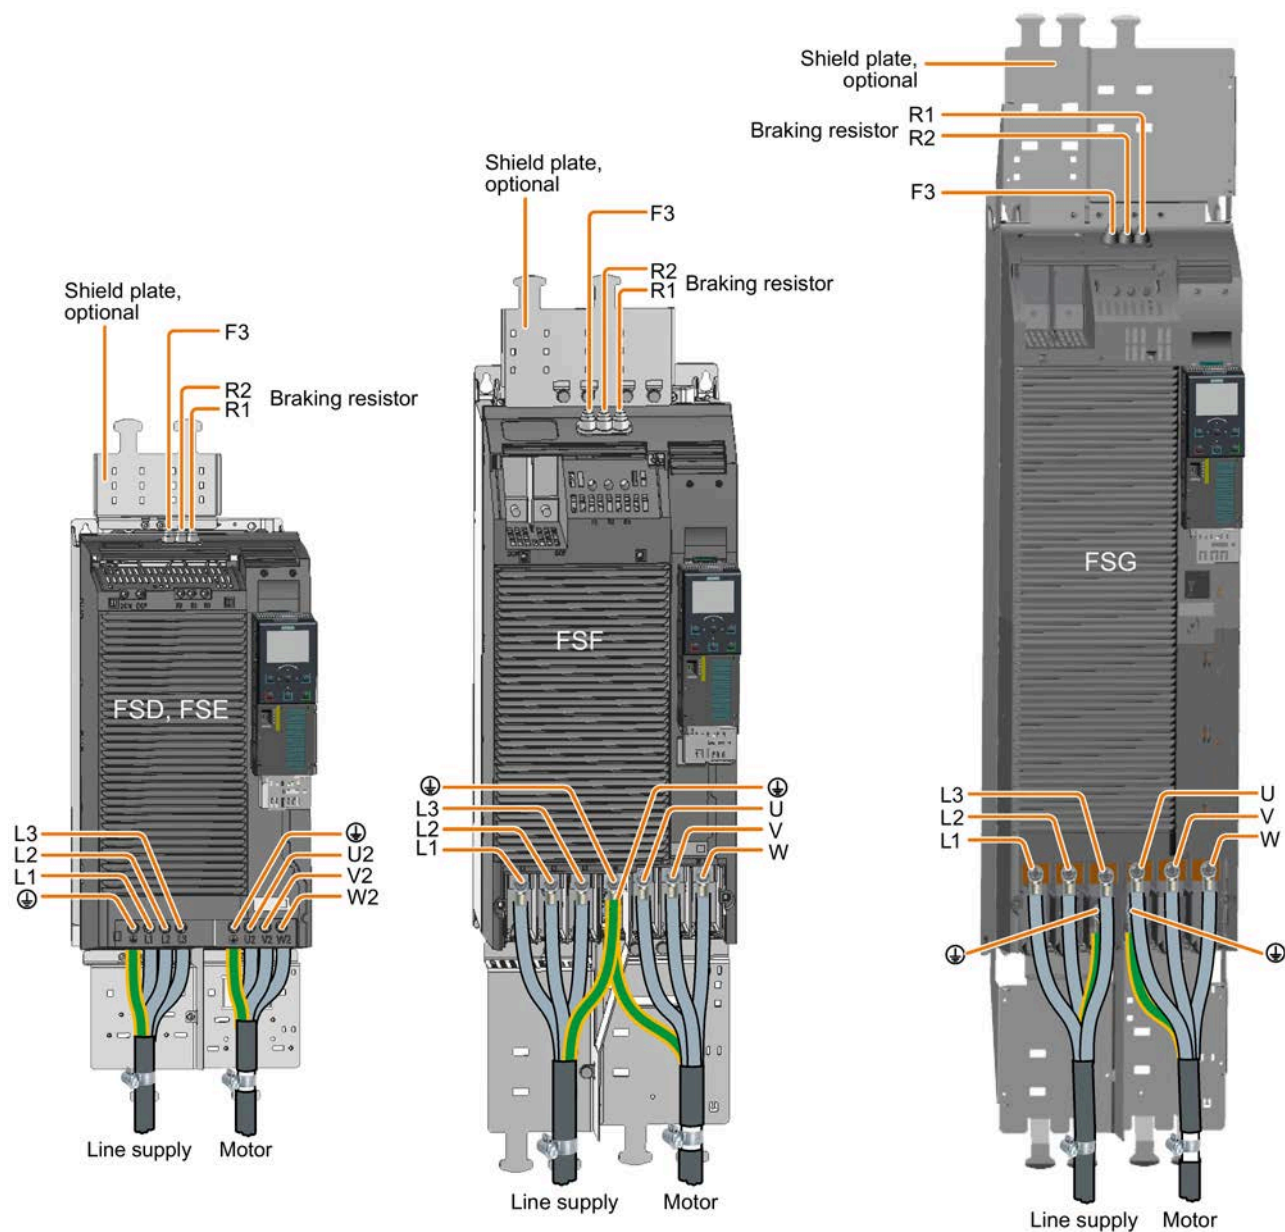


Figure 4-8 Connections for the line supply, motor and braking resistor

You must re-attach the connection covers in order to re-establish the touch protection of the converter after it has been connected up.

## Additional information when connecting FSG converters

### Note

#### Conductor cross-section 240 mm<sup>2</sup>

Cable lugs for M10 bolts according to SN71322 are suitable for cables with cross-sections of 35 mm<sup>2</sup> ... 185 mm<sup>2</sup> (1 AWG ... 2 × 350 MCM).

If you wish to establish connections with cables of 240 mm<sup>2</sup> (500 MCM), you must use narrow cable lugs, e.g. Klauke 12SG10. Other cable lugs are not suitable due to the narrow design of the converter.

The maximum permissible width of the cable lugs is 37 mm (1.45 inches).


Remove the plastic insulating plate as shown below to gain better access to the terminals for the power connections.

### WARNING

#### Damage to converter as a result of operation without insulating plates

Without the insulating plates, voltage flashovers may occur between the phases.

- Replace the insulating plates after connecting the cables.

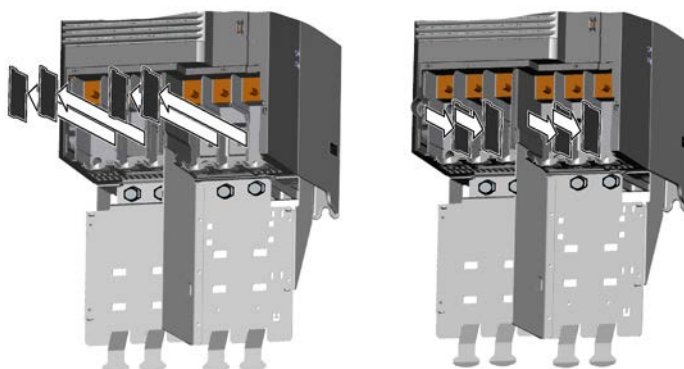

## Braking resistor connection

Use the rubber cable gland as shown in the right-hand figure for connecting the braking resistor.


Using a sharp knife, cut the cap of the cable gland corresponding to the diameter of the connection cable of the braking resistor and establish the connections.

Connect the braking resistor at the R1 and R2 terminals.

An optional shield plate is available as strain relief for the connection cable of the braking resistor.



Top shield plate - FSD ... FSG (Page 117)

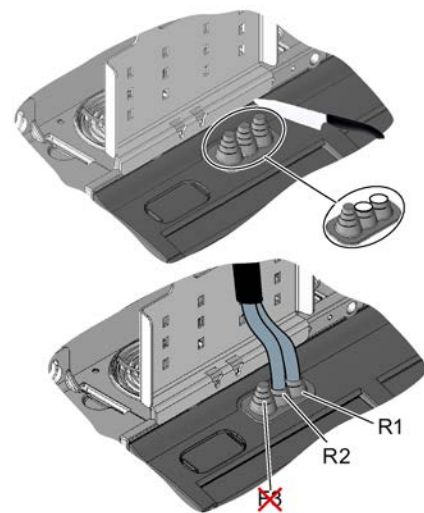

## 4.3 STO via Power Module terminals

### Description

The "Safe Torque Off" (STO) safety function can be implemented via terminals on the power modules of frame sizes FSD ... FSG.

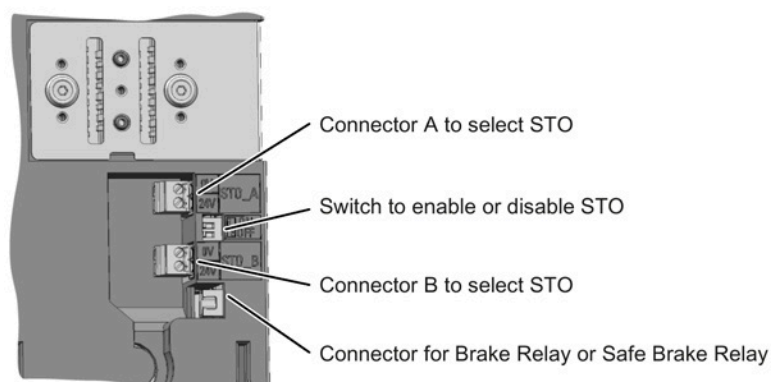


Figure 4-9 Terminals and switches for the "STO via power module terminals" function

The two switches have the following function:

- Both switches = ON: STO is enabled
- Both switches = OFF: STO is locked
- Two switches different: not permissible

Terminals STO\_A and STO\_B are low active.

### Connect line to select STO

Use a SELV or PELV power supply with 24 V DC (20.4 V ... 28.8 V, maximum 60 V briefly) for the STO\_A and STO\_B connections.

Use a shielded cable with the following properties:

- Length  $\leq 30$  m
- Cross section  $0.5 \text{ mm}^2 \dots + 1.5 \text{ mm}^2$  (20 ... 16 AWG)
- Insulated for 600 V

Use conductor end sleeves, stripped length 7 mm.

### Procedure

1. Connect the cable to select STO at terminals STO\_A and STO\_B on the front of the power module.
2. Tighten the screws of the terminals with a torque of 0.2 Nm (2 lbf in).
3. Attach the shield to the shield plate of the Control Unit through the largest possible surface area.

You have connected the STO terminals.



**Note****Configuring a safety function**

In order to use the "STO via power module terminals" safety function, the function has to be configured with a commissioning tool.

Further information and wiring examples are to be found in the "Safety Integrated" Function Manual.





Manuals for your converter (Page 163)

## 4.4 Connecting the motor to the converter in a star or delta connection

**Overview**

Standard induction motors up to a rated power of approximately 3 kW are usually connected in star/delta connection (Y/ $\Delta$ ) at 400 V/230 V. For a 400-V line supply, you can connect the motor to the converter either in a star or in a delta connection.

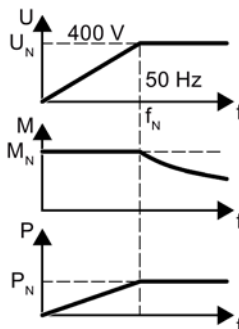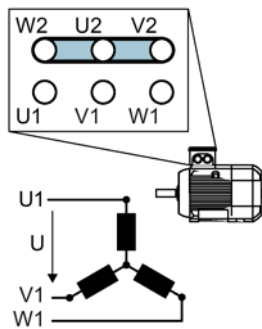
**Function description****Operating the motor in a star connection**

In a star connection, the motor can provide its rated torque  $M_N$  in the range 0 ... rated frequency  $f_N$ .

Rated voltage  $U_N = 400$  V is available at a rated frequency  $f_N = 50$  Hz.

The motor goes into field weakening above the rated frequency. In field weakening, the available motor torque decreases proportionally with  $1/f$ . In field weakening, the available power remains constant.

### Operating the motor in a delta connection with 87 Hz characteristic

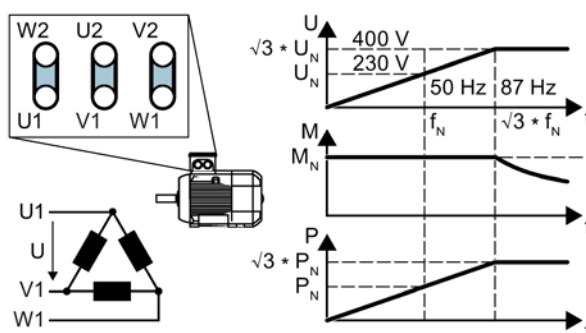

In a delta connection, the motor is operated with a voltage and frequency above its rated values. As a consequence, the motor power is increased by a factor  $\sqrt{3} \approx 1.73$ .

In the range  $f = 0 \dots 87 \text{ Hz}$ , the motor can output its rated torque  $M_N$ .

The maximum voltage  $U = 400 \text{ V}$  is available at a frequency of  $f = \sqrt{3} \times 50 \text{ Hz} \approx 87 \text{ Hz}$ .

The motor only goes into field weakening above 87 Hz.

The higher motor power when operated with an 87 Hz characteristic has the following disadvantages:

- The converter must supply approximately 1.73x current. Select a converter based on its rated current - and not its rated power.
- The motor temperature increases more significantly than when operated with  $f \leq 50 \text{ Hz}$ .
- The motor must have windings that are approved for a voltage  $>$  rated voltage  $U_N$ .
- As the fan impeller rotates faster, the motor has a higher noise level than operation with  $f \leq 50 \text{ Hz}$ .



## Service and maintenance

### WARNING

#### **Fire or electric shock due to defective components**

If an overcurrent protection device is triggered, the converter may be defective. A defective converter can cause a fire or electric shock.

- Have the converter and the overcurrent protection device checked by a specialist.

## Repair

### WARNING

#### **Fire or electric shock due to improper repair**

Improper repair of the converter may cause malfunctions or result in consequential damage such as fire or electric shock.

- Only commission the following persons to repair the converter:
  - Siemens customer service
  - A repair center that has been authorized by Siemens
  - Specialist personnel who are thoroughly acquainted with all the warnings and operating procedures contained in this manual.
- Only use original spare parts when carrying out repairs.


## Recycling and disposal



For environmentally-friendly recycling and disposal of your old device, please contact a company certified for the disposal of waste electrical and electronic equipment, and dispose of the old device as prescribed in the respective country of use.

## 5.1 Maintenance

The purpose of maintenance is to maintain the specified condition of the Power Module.

Regularly remove dirt and pollution, and replace the fan in plenty of time.  Replacing a fan (Page 70)

### Cleaning

#### Converters with IP20 degree of protection - built-in units

Clean the converter with an anti-static brush, a vacuum cleaner and areas that are difficult to access, using dry compressed air (max. 1 bar).

#### Converters with push-through technology – PT devices

Clean the heatsink at regular intervals. If necessary, remove the air deflection plate at the rear. Use a torque of 2 Nm when reconnecting. The fans must be installed if you clean the heatsink using water.

### Ventilation

The devices must be installed in a cabinet. Ensure that the cabinet's ventilation slots are not blocked. Check that the fan is functioning correctly.

### Cables and screw terminals

Regularly check the cables for damage, and immediately replace any defective parts.

Regularly check that the screw terminals have been correctly tightened. Retighten the screws if necessary.

---

#### Note

The actual maintenance intervals depend on the installation and operating conditions.

Siemens offers its customers support in the form of service contracts. For further information, contact your Siemens regional office or sales office.

---

## 5.2 Commissioning after a long storage time

If the converter was not operational for a longer period of time, it is possible that you must form the DC-link capacitors before switching on.

Form the DC-link capacitors in the following cases:

- If the converter was not operational for longer than one year.
- If the date of manufacture of the converter was more than one year ago when commissioning the drive system for the first time. The date of manufacture is coded in the serial number (see the next paragraph).

You form the DC-link capacitors by connecting power to the converters as shown below.

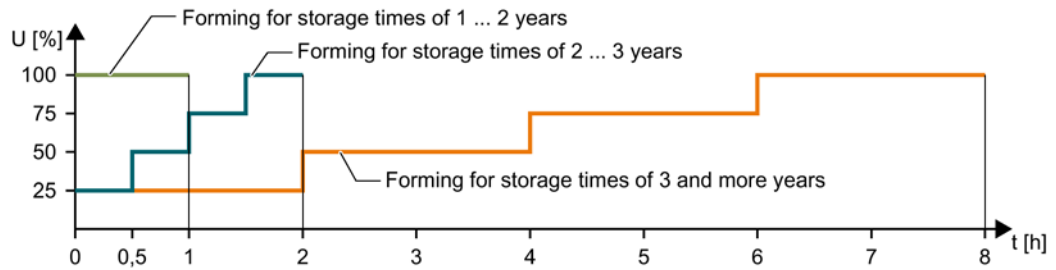


Figure 5-1 Forming the DC-link capacitors

### Data of manufacture of the converter

The date of manufacture of the converter is coded in positions 3 - 6 of the serial number.

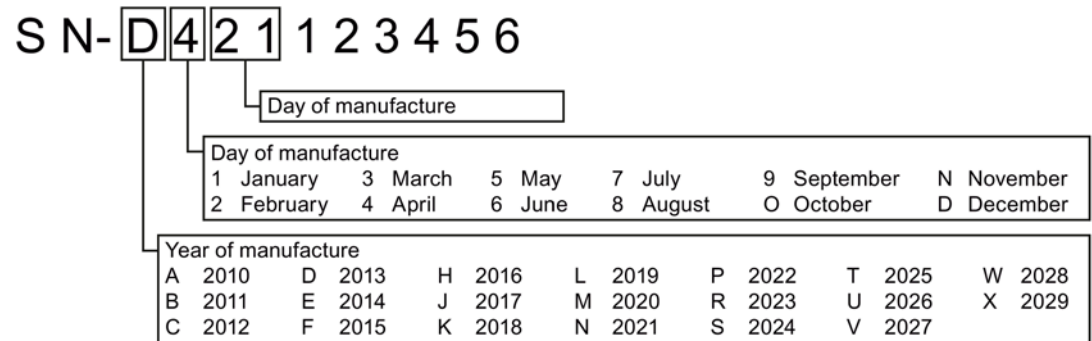


Figure 5-2 Data of manufacture in the serial number (example, April 21, 2013)

## 5.3 Replacing a fan

### Service life of the fan

The average service life of the fan is 40,000 hours. In practice, however, the service life may deviate from this value. Especially a dusty environment can block up the fan.

The fan must be replaced in good time to ensure that the converter is ready for operation.

### Applies to all frame sizes

Proceed as follows to remove the fan unit:

Switch off the converter power supply before replacing the fan.



#### WARNING

#### Electric shock as a result of a residual charge in power components

After the power supply has been switched off, it takes up to 5 minutes until the capacitors in the converter have discharged so that the residual charge is at a non-hazardous level.

- Check the voltage at the converter connections before you carry out any installation work.


### 5.3.1 Fan replacement FSA ... FSC

The fan module is installed at the bottom. It has one fan each for frame sizes FSA and FSB, and two for frame size C.

#### Procedure



1. Withdraw the line and motor cable plug connectors and, if available, remove the braking resistor from the Power Module.
2. Remove the shield plate from the Power Module.
3. Remove the fan module from the Power Module in steps ① and ② as shown in the diagram. Use a screwdriver if necessary.

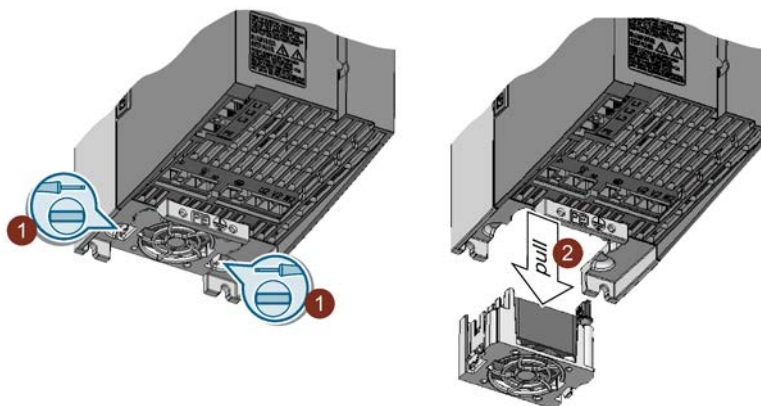

4. Install the new fan module in the inverse sequence.



You have replaced the fan module.


### 5.3.2 Fan replacement FSD ... FSF

The fan module is installed at the top.

#### Procedure




1. Remove the fan module from the Power Module in steps ① and ② as shown in the diagram. Use a screwdriver if necessary.

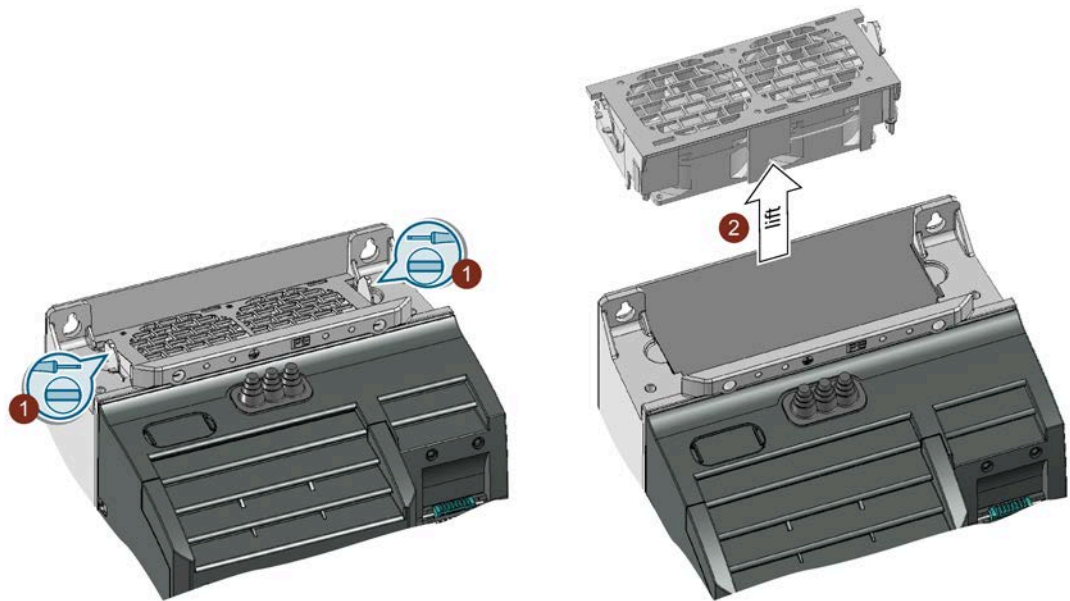

2. Additionally for PT devices:

Remove the interior fan as shown below.

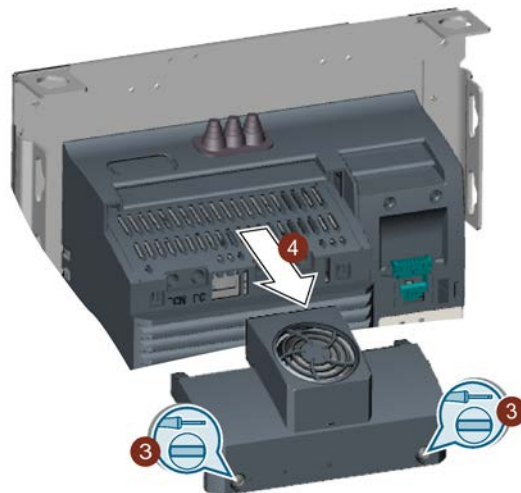

3. Install the new fan module in inverse sequence.  
By inserting the fan module, you establish the electrical connection between the converter and fan module.



You have replaced the fan module.


### 5.3.3 FSG fan replacement

The fan module is installed at the top.

#### Procedure



1. Remove the fan module from the Power Module in steps ① and ② as shown in the diagram. Use a screwdriver.

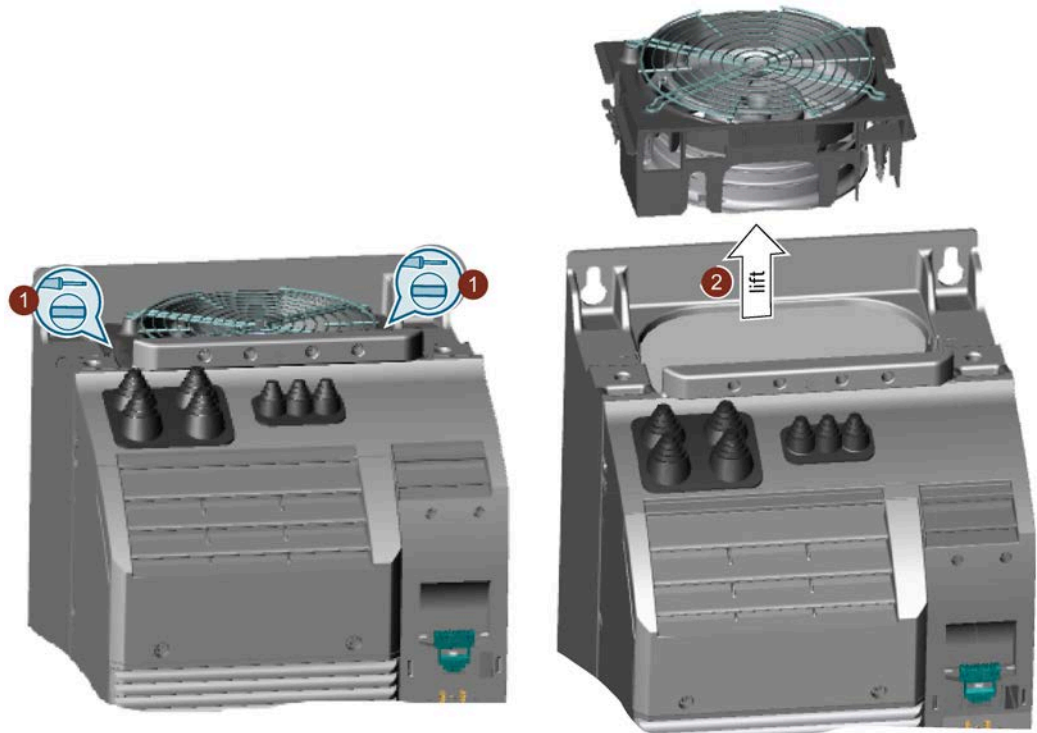

2. Install the new fan module in inverse sequence.  
By inserting the fan module, you establish the electrical connection between the converter and fan module.

■ You have replaced the fan module.

## Technical data

### Power loss of the Power Modules

---

#### Note

##### Power loss for the FSA ... FSC Power Modules

The values specified for the power loss are typical values at 100% of the rated speed and 100% of the load corresponding to Low Overload.

##### Power loss for the FSD ... FSG Power Modules

The values specified for the power loss are typical values at 90% of the rated speed and 100% of the load corresponding to Low Overload.

---

### Protective devices for the Power Module

The fuses listed in the following tables are examples of suitable fuses.


Additional components for branch protection are available in the Internet:

 Branch protection and short-circuit strength according to UL and IEC  
<https://support.industry.siemens.com/cs/ww/en/view/109486009>

### Number of starting operations for converter

The frequency of operation for the converter is every 120 s.

The number of starting operations states how often line voltage may be switched to the de-energized converter.

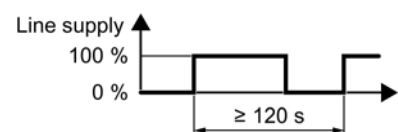

## 6.1 Electromagnetic compatibility - Overview

### Electromagnetic compatibility according to EN61800-3




Property	Version
Interference immunity	The converters are suitable for use in the first and second industrial environments
Interference emission - second environment	Category C2 for converters with integrated radio interference suppression filter
	Category C2 for converters without filter with optional external radio interference suppression filter for grounded line supplies (recommended for operation in conjunction with a residual current protective device RCD)
	Category C3 for 690-V converters with integrated radio interference suppression filter, frame size FSF, FSG
	Category C4 for converters without integrated radio interference suppression filter for operation on IT line supplies

Additional information as well as conditions for using the converter in the first environment are provided in the following Section:



Electromagnetic compatibility of variable-speed drives (Page 107).

## 6.2 Ambient conditions

Property	Version
<b>Ambient conditions for transport in the transport packaging</b>	
Air-conditioning	- 40° C ... + 70° C, according to Class 2K4 to EN 60721-3-2:1997 maximum humidity 95% at 40 °C
Mechanical system	Shock and vibration permissible according to 1M2 to IEC 60721-3-2:1997
Chemical substances	Protected according to Class 2C2 to IEC 60721-3-2:1997
Biological ambient conditions	Suitable according to Class 2B1 to IEC 60721-3-2:1997
<b>Ambient conditions for long-term storage in the product packaging or in transport packaging</b>	
Air-conditioning	- 25 °C ... + 55° C, according to Class 1K3 to IEC 60721-3-1:1997
Chemical substances	Protected according to Class 1C2 to IEC 60721-3-1:1997
Biological ambient conditions	Suitable according to Class 1B1 to IEC 60721-3-1:1997
<b>Ambient conditions in operation</b>	
Installation altitude	Up to 1000 m above sea level without limitations  Restrictions for special ambient conditions (Page 105)
Air-conditioning <sup>1)</sup>	<ul style="list-style-type: none"> <li>FSA ... FSC ambient operating temperature <sup>2)</sup> <ul style="list-style-type: none"> <li>For operation according to Low Overload: -10 °C ... +40 °C</li> <li>For operation according to High Overload: -10 °C ... +50 °C</li> <li> Restrictions for special ambient conditions (Page 105)</li> </ul> </li> <li>FSD ... FSG ambient operating temperature <sup>2)</sup> <ul style="list-style-type: none"> <li>For operation according to Low Overload: -20 °C ... +40 °C</li> <li>For operation according to High Overload: -20 °C ... +50 °C</li> <li> Restrictions for special ambient conditions (Page 105)</li> </ul> </li> <li>Relative humidity: 5 ... 95%, condensation not permitted</li> <li>Oil mist, ice formation, condensation, dripping water, spraying water, splashing water and water jets are not permitted</li> </ul>
Mechanical system	Vibration test during operation according to IEC 60068-2-6 Test Fc (sinusoidal) <ul style="list-style-type: none"> <li>0 ... 57 Hz: 0.075 mm deflection amplitude</li> <li>57 ... 150 Hz: 1 g acceleration amplitude</li> <li>10 frequency cycles per axis</li> </ul> Shock test according to IEC 60068-2-27 Test Ea (half-sine) <ul style="list-style-type: none"> <li>5 g peak acceleration</li> <li>30 ms duration</li> <li>3 shocks in all three axes in both directions</li> </ul>
Chemical substances	<ul style="list-style-type: none"> <li>FSA ... FSC: Protected according to 3C2 to IEC 60721-3-3:2002</li> <li>FSD ... FSG: Protected according to 3C3 to IEC 60721-3-3:2002</li> </ul>
Biological ambient conditions	Suitable according to 3B1 to IEC 60721-3-3: 2002
Pollution	Suitable for environments with degree of pollution 2 according to EN 61800-5-1

### 6.3 Overload capability of the converter

Property	Version
Cooling	Forced air cooling AF, according to EN 60146
Cooling air	Clean and dry air
Noise emission	Maximum 75 db(A)

- 1) Increased ruggedness regarding temperature range and relative humidity; therefore better than 3K3 according to IEC 60721-3-3: 2002
- 2) Observe the permissible ambient operating temperatures for the Control Unit and the Operator Panel (IOP-2 or BOP-2).

## 6.3 Overload capability of the converter

Overload capability is the property of the converter to temporarily supply a current that is higher than the rated current to accelerate a load. Two typical load cycles are defined to clearly demonstrate the overload capability: "Low Overload" and "High Overload"

### Definitions

#### Base load

Constant load between the accelerating phases of the drive

#### Low Overload

- **LO base load input current**  
Permissible input current for a "Low Overload" load cycle
- **LO base load output current**  
Permissible output current for a "Low Overload" load cycle
- **LO base load power**  
Rated power based on the LO base load output current

#### High Overload

- **HO base load input current**  
Permissible input current for a "High Overload" load cycle
- **HO base load output current**  
Permissible output current for a "High Overload" load cycle
- **HO base load power**  
Rated power based on the HO base load output current

If not specified otherwise, the power and current data in the technical data always refer to a load cycle according to Low Overload.

We recommend using the "SIZER" engineering software to select the converter.

You can find additional information about SIZER on the Internet:



Download Sizer

(<http://support.automation.siemens.com/WW/view/en/10804987/130000>)

## Load cycles and typical applications:

### "Low Overload" load cycle

The "Low Overload" load cycle assumes a uniform base load with low requirements placed on brief accelerating phases. Typical applications when designing according to "Low Overload" include:

- Pumps, fans and compressors
- Wet or dry blasting technology
- Mills, mixers, kneaders, crushers, agitators
- Basic spindles
- Rotary kilns
- Extruders

### "High Overload" load cycle

The "High Overload" load cycle permits dynamic accelerating phases at a reduced base load. Typical applications when designing according to "High Overload" include:

- Horizontal and vertical conveyor technology (conveyor belts, roller conveyors, chain conveyors)
- Centrifuges
- Escalators/moving stairways
- Lifters/Lowerers
- Elevators
- Gantry cranes
- Cable railways
- Storage and retrieval machines

## Typical converter load cycles

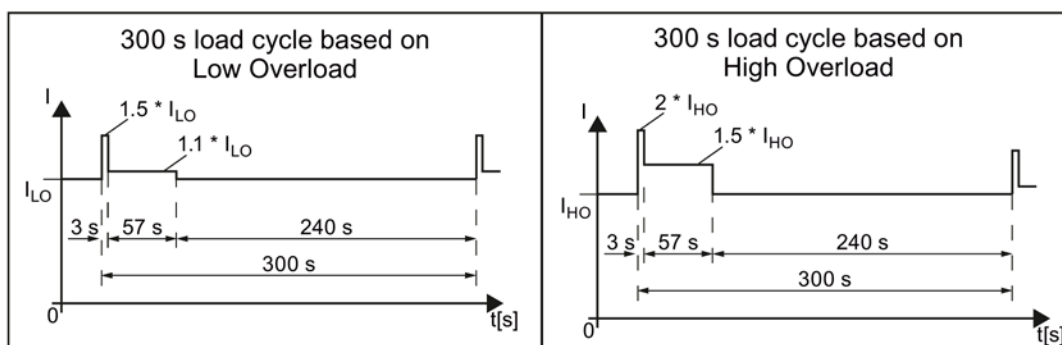


Figure 6-1 "Low Overload" and "High Overload" load cycles

## 6.4 200 V converters

### Motors for 200 V Power Modules

For the 200 V Power Modules, induction motors are permissible in the range from 25% ... 150% of the converter power without any restrictions.





### Permissible motors

#### Note


#### Motors for converter operation

Only use motors that are suitable for operation with converters with a DC link.

### 6.4.1 General data, 200 V converters

Property	Version		
Line voltage	FSA ... FSC	200 V ... 240 V 1 AC ± 10%	0.55 kW ... 4 kW - LO 0.37 kW ... 3 kW - HO
		200 V ... 240 V 3 AC ± 10%	0.55 kW ... 7.5 kW - LO 0.37 kW ... 5.5 kW - HO
	FSD ... FSF	200 V ... 240 V 3 AC ± 10% (in operation -20% < 1 min)	11 kW ... 55 kW - LO 7,5 kW ... 45 kW - HO
Line supply configurations	Grounded TN/TT line supplies or non-grounded IT line supplies  Permissible line supplies (Page 46)		
Line impedance	FSA ... FSC	2% ≤ Uk < 4%. For Uk < 2%, we recommend a line reactor, or a Power Module with the next higher power rating.	
	FSD ... FSF	No restrictions	
Power factor λ	FSA ... FSC	0.7 without line reactor for Uk ≥ 2% 0.85 with line reactor for Uk < 2%	
	FSD ... FSF	> 0.9	
Output voltage	0 V 3 AC ... 0.95 × input voltage		
Input frequency	50 Hz ... 60 Hz, ± 3 Hz		
Output frequency	0 ... 550 Hz, depending on the control mode		
Inrush current	< LO base load input current		
Overvoltage category according to EN 61800-5-1	III for line supplies		
Pulse frequency	4 kHz (factory setting), Adjustable in steps of 2 kHz.  Current reduction as a function of the pulse frequency (Page 86) If you increase the pulse frequency, the converter reduces the maximum output current.		
Short-circuit current (SCCR) and branch protection	Maximum permissible line short-circuit current ≤ 100 kA rms  Branch protection and short-circuit strength according to UL and IEC ( <a href="https://support.industry.siemens.com/cs/ww/en/view/109479152">https://support.industry.siemens.com/cs/ww/en/view/109479152</a> )		
Degree of protection according to EN 60529	IP20		
	IP55	PT devices outside the control cabinet	
Protection class according to EN 61800-5-1	The converters are devices with protection class I		
Touch protection according to EN 50274	DGUV regulation 3 when used for the intended purpose		
Cooling in compliance with EN 60146	Forced air cooling AF		
Safety Integrated	See function manual "Safety Integrated"  "Safety Integrated" function manual ( <a href="https://support.industry.siemens.com/cs/ww/en/view/109751320">https://support.industry.siemens.com/cs/ww/en/view/109751320</a> )		

## Dependency of input voltage and output power

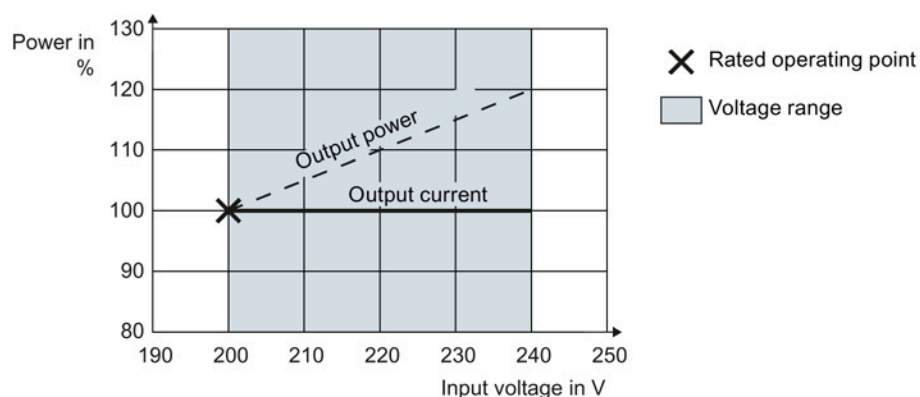

### 6.4.2 Specific technical data, 200 V converters

Table 6- 1 PM240-2, IP20, frame size A, 200 V ... 240 V 1 AC / 3 AC

Article No. without filter	6SL3210-1PB13-0UL0	6SL3210-1PB13-8UL0
Article No. with filter	6SL3210-1PB13-0AL0	6SL3210-1PB13-8AL0
LO base load power	0.55 kW	0.75 kW
1 AC LO base load input current	7.5 A	9.6 A
3 AC LO base load input current	4.2 A	5.5 A
LO base load output current	3.2 A	4.2 A
HO base load power	0.37 kW	0.55 kW
1 AC HO base load input current	6.6 A	8.4 A
3 AC HO base load input current	3.0 A	4.2 A
HO base load output current	2.3 A	3.2 A
Fuse according to IEC	3NA3805 (16 A)	3NA3805 (16 A)
Fuse according to UL, class J	15 A	15 A
Power loss	0.04 kW	0.04 kW
Required cooling air flow	5 l/s	5 l/s
Weight without filter	1.4 kg	1.4 kg
Weight with filter	1.6 kg	1.6 kg

## 6.4 200 V converters

Table 6- 2 PM240-2, PT, frame size A, 200 V ... 240 V 1 AC / 3 AC

<b>Article No. without filter</b>	<b>6SL3211-1PB13-8UL0</b>
<b>Article No. with filter</b>	<b>6SL3211-1PB13-8AL0</b>
LO base load power	0.75 kW
1 AC LO base load input current	9.6 A
3 AC LO base load input current	5.5 A
LO base load output current	4.2 A
HO base load power	0.55 kW
1 AC HO base load input current	8.4 A
3 AC HO base load input current	4.2 A
HO base load output current	3.2 A
Fuse according to IEC	3NA3 805 (16 A)
Fuse according to UL, class J	15 A
Power loss	0.04 kW
Required cooling air flow	5 l/s
Weight without filter	1.8 kg
Weight with filter	2.0 kg

Table 6- 3 PM240-2, IP20, frame size B, 200 V ... 240 V 1 AC / 3 AC

<b>Article No. without filter</b>	<b>6SL3210-1PB15-5UL0</b>	<b>6SL3210-1PB17-4UL0</b>	<b>6SL3210-1PB21-0UL0</b>
<b>Article No. with filter</b>	<b>6SL3210-1PB15-5AL0</b>	<b>6SL3210-1PB17-4AL0</b>	<b>6SL3210-1PB21-0AL0</b>
LO base load power	1.1 kW	1.5 kW	2.2 kW
1 AC LO base load input current	13.5 A	18.1 A	24.0 A
3 AC LO base load input current	7.8 A	9.7 A	13.6 A
LO base load output current	6 A	7.4 A	10.4 A
HO base load power	0.75 kW	1.1 kW	1.5 kW
1 AC HO base load input current	11.8 A	15.8 A	20.9 A
3 AC HO base load input current	5.5 A	7.8 A	9.7 A
HO base load output current	4.2 A	6 A	7.4 A
Fuse according to IEC	3NA3812 (32 A)	3NA3812 (32 A)	3NA3812 (32 A)
Fuse according to UL, class J	35 A	35 A	35 A
Power loss	0.05 kW	0.07 kW	0.12 kW
Required cooling air flow	9.2 l/s	9.2 l/s	9.2 l/s
Weight without filter	2.8 kg	2.8 kg	2.8 kg
Weight with filter	3.1 kg	3.1 kg	3.1 kg

Table 6- 4 PM240-2, PT, frame size B, 200 V ... 240 V 1 AC / 3 AC

Article No. without filter	6SL3211-1PB21-0UL0
Article No. with filter	6SL3211-1PB21-0AL0
LO base load power	2.2 kW
1 AC LO base load input current	24.0 A
3 AC LO base load input current	13.6 A
LO base load output current	10.4 A
HO base load power	1.5 kW
1 AC HO base load input current	20.9 A
3 AC HO base load input current	9.7 A
HO base load output current	7.4 A
Fuse according to IEC	3NA3812 (32 A)
Fuse according to UL, class J	35 A
Power loss	0.12 kW <sup>1)</sup>
Required cooling air flow	9.2 l/s
Weight without filter	3.4 kg
Weight with filter	3.7 kg

<sup>1)</sup> approx. 0.08 kW through the heat sink

Table 6- 5 PM240-2, IP 20, frame size C, 200 V ... 240 V 1 AC / 3 AC

Article No. without filter	6SL3210-1PB21-4UL0	6SL3210-1PB21-8UL0
Article No. with filter	6SL3210-1PB21-4AL0	6SL3210-1PB21-8AL0
LO base load power	3 kW	4 kW
1 AC LO base load input current	35.9 A	43.0 A
3 AC LO base load input current	17.7 A	22.8 A
LO base load output current	13.6 A	17.5 A
HO base load power	2.2 kW	3 kW
1 AC HO base load input current	31.3 A	37.5 A
3 AC HO base load input current	13.6 A	17.7 A
HO base load output current	10.4 A	13.6 A
Fuse according to IEC	3NA3820 (50 A)	3NA3820 (50 A)
Fuse according to UL, class J	50 A	50 A
Power loss	0.14 kW	0.18 kW
Required cooling air flow	18.5 l/s	18.5 l/s
Weight without filter	5.0 kg	5.0 kg
Weight with filter	5.2 kg	5.2 kg

6.4 200 V converters

Table 6- 6 PM240-2, PT, frame size C, 200 V ... 240 V 1 AC / 3 AC

<b>Article No. without filter</b>	<b>6SL3211-1PB21-8UL0</b>
<b>Article No. with filter</b>	<b>6SL3211-1PB21-8AL0</b>
LO base load power	4 kW
1 AC LO base load input current	43.0 A
3 AC LO base load input current	22.8 A
LO base load output current	17.5 A
HO base load power	3 kW
1 AC HO base load input current	37.5 A
3 AC HO base load input current	17.7 A
HO base load output current	13.6 A
Fuse according to IEC	3NA3820 (50 A)
Fuse according to UL, class J	50 A
Power loss	0.18 kW <sup>1)</sup>
Required cooling air flow	18.5 l/s
Weight without filter	5.9 kg
Weight with filter	6.2 kg

<sup>1)</sup> approx. 0.09 kW through the heat sink

Table 6- 7 PM240-2, IP 20, frame size C, 200 V ... 240 V 3 AC

<b>Article No. without filter</b>	<b>6SL3210-1PC22-2UL0</b>	<b>6SL3210-1PC22-8UL0</b>
<b>Article No. with filter</b>	<b>6SL3210-1PC22-2AL0</b>	<b>6SL3210-1PC22-8AL0</b>
LO base load power	5.5 kW	7.5 kW
LO base load input current	28.6 A	36.4 A
LO base load output current	22.0 A	28.0 A
HO base load power	4 kW	5.5 kW
HO base load input current	22.8 A	28.6 A
HO base load output current	17.5 A	22.0 A
Fuse according to IEC	3NA3820 (50 A)	3NA3820 (50 A)
Fuse according to UL, class J	50 A	50 A
Power loss	0.2 kW	0.26 kW
Required cooling air flow	18.5 l/s	18.5 l/s
Weight without filter	5.0 kg	5.0 kg
Weight with filter	5.2 kg	5.2 kg

Table 6- 8 PM240-2, PT, frame size C, 200 V ... 240 V 3 AC

Article No. without filter Article No. with filter	6SL3211-1PC22-2UL0 6SL3211-1PC22-2AL0	6SL3211-1PC22-8UL0 6SL3211-1PC22-8AL0
LO base load power	5.5 kW	7.5 kW
LO base load input current	28.6 A	36.4 A
LO base load output current	22.0 A	28.0 A
HO base load power	4 kW	5.5 kW
HO base load input current	22.8 A	28.6 A
HO base load output current	17.5 A	22.0 A
Fuse according to IEC	3NA3820 (50 A)	3NA3820 (50 A)
Fuse according to UL, class J	50 A	50 A
Power loss	0.2 kW <sup>1)</sup>	0.26 kW <sup>2)</sup>
Required cooling air flow	18.5 l/s	18.5 l/s
Weight without filter	5.9 kg	5.9 kg
Weight with filter	6.2 kg	6.2 kg

<sup>1)</sup> approx. 0.2 kW through the heatsink

<sup>2)</sup> approx. 0.25 kW through the heatsink

Table 6- 9 PM240-2, IP20, frame size D, 200 V ... 240 V 3 AC

Article No. without filter	6SL3210-1PC24-2UL0	6SL3210-1PC25-4UL0	6SL3210-1PC26-8UL0
LO base load power	11 kW	15 kW	18.5 kW
LO base load input current	40 A	51 A	64 A
LO base load output current	42 A	54 A	68 A
HO base load power	7.5 kW	11 kW	15 kW
HO base load input current	36 A	43 A	56 A
HO base load output current	35 A	42 A	54 A
Fuse according to IEC	3NA3822 (63 A)	3NA3824 (80 A)	3NA3830 (100 A)
Fuse according to UL, class J	60 A	70 A	90 A
Power loss	0.45 kW	0.61 kW	0.82 kW
Required cooling air flow	55 l/s	55 l/s	55 l/s
Weight	18.3 kg	18.3 kg	18.3 kg

6.4 200 V converters

Table 6- 10 PM240-2, PT, frame size D, 200 V ... 240 V 3 AC

Article No. without filter	6SL3211-1PC26-8UL0
LO base load power	18.5 kW
LO base load input current	64 A
LO base load output current	68 A
HO base load power	15 kW
HO base load input current	56 A
HO base load output current	54 A
Fuse according to IEC	3NA3830 (100 A)
Fuse according to UL, class J	90 A
Power loss	0.82 kW <sup>1)</sup>
Required cooling air flow	55 l/s
Weight	19.5 kg

<sup>1)</sup> approx. 0.72 kW through the heatsink

Table 6- 11 PM240-2, IP20, frame size E, 200 V ... 240 V 3 AC

Article No. without filter	6SL3210-1PC28-0UL0	6SL3210-1PC31-1UL0
LO base load power	22 kW	30 kW
LO base load input current	76 A	98 A
LO base load output current	80 A	104 A
HO base load power	18.5 kW	22 kW
HO base load input current	71 A	83 A
HO base load output current	68 A	80 A
Fuse according to IEC	3NA3830 (100 A)	3NA3836 (160 A)
Fuse according to UL, class J	100 A	150 A
Power loss	0.92 kW	1.28 kW
Required cooling air flow	83 l/s	83 l/s
Weight	26.8 kg	26.8 kg

Table 6- 12 PM240-2, PT, frame size E, 200 V to 240 V 3 AC

Article No. without filter	6SL3211-1PC31-1UL0
LO base load power	30 kW
LO base load input current	98 A
LO base load output current	104 A
HO base load power	22 kW
HO base load input current	83 A
HO base load output current	80 A
Fuse according to IEC	3NA3836 (160 A)
Fuse according to UL, class J	150 A
Power loss	1.28 kW <sup>1)</sup>
Required cooling air flow	83 l/s
Weight	29.5 kg

<sup>1)</sup> approx. 1.1 kW through the heatsink

Table 6- 13 PM240-2, IP20, frame size F, 200 V ... 240 V 3 AC

Article No. without filter	6SL3210-1PC31-3UL0	6SL3210-1PC31-6UL0	6SL3210-1PC31-8UL0
LO base load power	37 kW	45 kW	55 kW
LO base load input current	126 A	149 A	172 A
LO base load output current	130 A	154 A	178 A
HO base load power	30 kW	37 kW	45 kW
HO base load input current	110 A	138 A	164 A
HO base load output current	104 A	130 A	154 A
Fuse according to IEC	3NA3140 (200 A)	3NA3140 (200 A)	3NA3142 (224 A)
Fuse according to UL, class J	175 A	200 A	250 A
Power loss	1.38 kW	1.72 kW	2.09 kW
Required cooling air flow	153 l/s	153 l/s	153 l/s
Weight	58 kg	58 kg	58 kg

## 6.4 200 V converters

Table 6- 14 PM240-2, PT, frame size F, 200 V to 240 V 3 AC

Article No. without filter	6SL3211-1PC31-8UL0
LO base load power	55 kW
LO base load input current	172 A
LO base load output current	178 A
HO base load power	45 kW
HO base load input current	164 A
HO base load output current	154 A
Fuse according to IEC	3NA3142 (224 A)
Fuse according to UL, class J	250 A
Power loss	2.09 kW <sup>1)</sup>
Required cooling air flow	153 l/s
Weight	60.5 kg

<sup>1)</sup> approx. 1.9 kW through the heatsink

### 6.4.3 Current derating depending on the pulse frequency, 200 V converters

Article number	LO power [kW]	Pulse frequency [kHz]							
		2	4 *)	6	8	10	12	14	16
		LO base load output current [A]							
6SL3210-1PB13-0 . LO	0.55	3.2	<b>3.2</b>	2.7	2.2	1.9	1.6	1.4	1.3
6SL321 . -1PB13-8 . LO	0.75	4.2	<b>4.2</b>	3.6	2.9	2.5	2.1	1.9	1.7
6SL3210-1PB15-5 . LO	1.1	6	<b>6</b>	5.1	4.2	3.6	3	2.7	2.4
6SL3210-1PB17-4 . LO	1.5	7.4	<b>7.4</b>	6.3	5.2	4.4	3.7	3.3	3
6SL321 . -1PB21-0 . LO	2.2	10.4	<b>10.4</b>	8.8	7.3	6.2	5.2	4.7	4.2
6SL3210-1PB21-4 . LO	3	13.6	<b>13.6</b>	11.6	9.5	8.2	6.8	6.1	5.4
6SL321 . -1PB21-8 . LO	4	17.5	<b>17.5</b>	14.9	12.3	10.5	8.8	7.9	7
6SL3210-1PC22-2 . LO	5.5	22	<b>22</b>	18.7	15.4	13.2	11	9.9	8.8
6SL3210-1PC22-8 . LO	7.5	28	<b>28</b>	23.8	19.6	16.8	14	12.6	11.2
6SL3210-1PC24-2UL0	11	42	<b>42</b>	35.7	29.4	25.2	21	18.9	16.8
6SL3210-1PC25-4UL0	15	54	<b>54</b>	45.9	37.8	32.4	27	24.3	21.6
6SL321 . -1PC26-8UL0	18.5	68	<b>68</b>	57.8	47.6	40.8	34	30.6	27.2
6SL3210-1PC28-0UL0	22	80	<b>80</b>	68	56	48	40	36	32
6SL321 . -1PC31-1UL0	30	104	<b>104</b>	88.4	72.8	62.4	52	46.8	41.6
6SL3210-1PC31-3UL0	37	130	<b>130</b>	110.5	91	---	---	---	---
6SL3210-1PC31-6UL0	45	154	<b>154</b>	130.9	107.8	---	---	---	---
6SL321 . -1PC31-8UL0	55	178	<b>178</b>	151.3	124.6	---	---	---	---

\*) Factory setting

The permissible motor cable length depends on the particular cable type and the pulse frequency that has been selected.

## **6.5 400 V converters**

### **Motors for 400 V Power Modules**

For the 400 V Power Modules, induction motors are permissible in the range from 25 % ... 150 % of the converter power without any restrictions.

### **Permissible motors**





---

**Note****Motors for converter operation**


Only use motors that are suitable for operation with converters with a DC link.

---

### 6.5.1 General data, 400 V converters

Property	Version
Line voltage	FSA ... FSC 380 V ... 480 V 3 AC $\pm 10\%$
	FSD ... FSG 380 V ... 480 V 3 AC $\pm 10\%$ (in operation $-20\% < 1$ min)
Line supply configurations	Grounded TN/TT line supplies or non-grounded IT line supplies  Permissible line supplies (Page 46)
Line impedance	FSA ... FSC $1\% \leq U_k < 4\%$ , for values smaller than 1%, we recommend a line reactor, or a Power Module with the next higher power rating.
	FSD ... FSG No restrictions
Power factor $\lambda$	FSA ... FSC 0.7 without line reactor for $U_k \geq 1\%$ 0.85 with line reactor for $U_k < 1\%$
	FSD ... FSG $> 0.9$
Output voltage	0 V 3 AC ... 0.95 x input voltage (max.)
Input frequency	50 Hz ... 60 Hz, $\pm 3$ Hz
Output frequency	0 ... 550 Hz, depending on the control mode
Inrush current	$< LO$ base load input current
Overvoltage category according to EN 61800-5-1	III for line supplies
Pulse frequency	Factory setting <ul style="list-style-type: none"> <li>4 kHz for devices with an LO base load power <math>&lt; 110</math> kW</li> <li>2 kHz for devices with an LO base load power <math>\geq 110</math> kW</li> </ul> Can be adjusted in 2 kHz steps as follows: <ul style="list-style-type: none"> <li>2 kHz ... 16 kHz for devices with an LO base load power <math>&lt; 55</math> kW</li> <li>2 kHz ... 8 kHz for devices with an LO base load output of 55 kW ... 250 kW</li> </ul> If you increase the pulse frequency, the converter reduces the maximum output current.  Current reduction as a function of the pulse frequency (Page 98)
Short-circuit current (SCCR) and branch protection	Maximum permissible line short-circuit current $\leq 100$ kA rms  Branch protection and short-circuit strength according to UL and IEC <a href="https://support.industry.siemens.com/cs/ww/en/view/109479152">https://support.industry.siemens.com/cs/ww/en/view/109479152</a>
Braking methods	DC braking, compound braking, dynamic braking with integrated braking chopper
Degree of protection according to EN 60529	IP20
	IP55 PT devices outside the control cabinet
Protection class according to EN 61800-5-1	The converters are devices with protection class I
Touch protection according to EN 50274	DGUV regulation 3 when used for the intended purpose
Cooling in compliance with EN 60146	Forced air cooling AF
Safety Integrated	See function manual "Safety Integrated"  "Safety Integrated" function manual <a href="https://support.industry.siemens.com/cs/ww/en/view/109751320">https://support.industry.siemens.com/cs/ww/en/view/109751320</a>

## Dependency of input voltage and output power

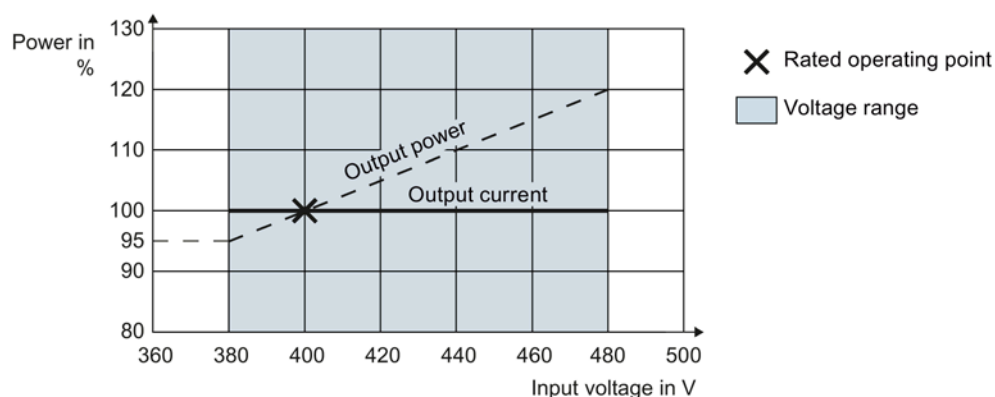

## 6.5.2 Specific technical data, 400 V converters

Table 6- 15 PM240-2, IP20, frame size A, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE11-8UL1	6SL3210-1PE12-3UL1	6SL3210-1PE13-2UL1
Article No. with filter	6SL3210-1PE11-8AL1	6SL3210-1PE12-3AL1	6SL3210-1PE13-2AL1
LO base load power	0.55 kW	0.75 kW	1.1 kW
LO base load input current	2.3 A	2.9 A	4.1 A
LO base load output current	1.7 A	2.2 A	3.1 A
HO base load power	0.37 kW	0.55 kW	0.75 kW
HO base load input current	2.0 A	2.6 A	3.3 A
HO base load output current	1.3 A	1.7 A	2.2 A
Fuse according to IEC	3NA3805 (16 A)	3NA3805 (16 A)	3NA3805 (16 A)
Fuse according to UL, class J	10 A	10 A	15 A
Power loss	0.04 kW	0.04 kW	0.04 kW
Required cooling air flow	5 l/s	5 l/s	5 l/s
Weight without filter	1.3 kg	1.3 kg	1.3 kg
Weight with filter	1.5 kg	1.5 kg	1.5 kg

Table 6- 16 PM240-2, IP20, frame size A, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE14-3UL1	6SL3210-1PE16-1UL1	6SL3210-1PE18-0UL1
Article No. with filter	6SL3210-1PE14-3AL1	6SL3210-1PE16-1AL1	6SL3210-1PE18-0AL1
LO base load power	1.5 kW	2.2 kW	3.0 kW
LO base load input current	5.5 A	7.7 A	10.1 A
LO base load output current	4.1 A	5.9 A	7.7 A
HO base load power	1.1 kW	1.5 kW	2.2 kW
HO base load input current	4.7 A	6.1 A	8.8 A
HO base load output current	3.1 A	4.1 A	5.9 A
Fuse according to IEC	3NA3805 (16 A)	3NA3805 (16 A)	3NA3805 (16 A)
Fuse according to UL, class J	15 A	15 A	15 A
Power loss	0.07 kW	0.1 kW	0.12 kW
Required cooling air flow	5 l/s	5 l/s	5 l/s
Weight without filter	1.4 kg	1.4 kg	1.4 kg
Weight with filter	1.6 kg	1.6 kg	1.6 kg

Table 6- 17 PM240-2, PT, frame size A, 380 V ... 480 V 3 AC

Article No. without filter	6SL3211-1PE18-0UL1
Article No. with filter	6SL3211-1PE18-0AL1
LO base load power	3.0 kW
LO base load input current	10.1 A
LO base load output current	7.7 A
HO base load power	2.2 kW
HO base load input current	8.8 A
HO base load output current	5.9 A
Fuse according to IEC	3NA3805 (16 A)
Fuse according to UL, class J	15 A
Power loss without filter	0.12 kW <sup>1)</sup>
Required cooling air flow	7 l/s
Weight without filter	1.8 kg
Weight with filter	2.0 kg

1) approx. 0.1 kW through the heatsink

Table 6- 18 PM240-2, IP20, frame size B, 380 V ... 480 V 3 AC

Article No. without filter Article No. with filter	6SL3210-1PE21-1UL0 6SL3210-1PE21-1AL0	6SL3210-1PE21-4UL0 6SL3210-1PE21-4AL0	6SL3210-1PE21-8UL0 6SL3210-1PE21-8AL0
LO base load power	4.0 kW	5.5 kW	7.5 kW
LO base load input current	13.3 A	17.2 A	22.2 A
LO base load output current	10.2 A	13.2 A	18.0 A
HO base load power	3.0 kW	4.0 kW	5.5 kW
HO base load input current	11.6 A	15.3 A	19.8 A
HO base load output current	7.7 A	10.2 A	13.2 A
Fuse according to IEC	3NA3812 (32 A)	3NA3812 (32 A)	3NA3812 (32 A)
Fuse according to UL, class J	35 A	35 A	35 A
Power loss	0.11 kW	0.15 kW	0.2 kW
Required cooling air flow	9.2 l/s	9.2 l/s	9.2 l/s
Weight without filter	2.9 kg	2.9 kg	3.0 kg
Weight with filter	3.1 kg	3.1 kg	3.2 kg

Table 6- 19 PM240-2, PT, frame size B, 380 V ... 480 V 3 AC

Article No. without filter Article No. with filter	6SL3211-1PE21-8UL0 6SL3211-1PE21-8AL0
LO base load power	7.5 kW
LO base load input current	22.2 A
LO base load output current	18.0 A
HO base load power	5.5 kW
HO base load input current	19.8 A
HO base load output current	13.7 A
Fuse according to IEC	3NA3812 (32 A)
Fuse according to UL, class J	35 A
Power loss	0.2 kW <sup>1)</sup>
Required cooling air flow	9.2 l/s
Weight without filter	3.6 kg
Weight with filter	3.9 kg

1) approx. 0.16 kW through the heatsink

Table 6- 20 PM240-2, IP20, frame size C, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE22-7UL0	6SL3210-1PE23-3UL0
Article No. with filter	6SL3210-1PE22-7AL0	6SL3210-1PE23-3AL0
LO base load power	11.0 kW	15.0 kW
LO base load input current	32.6 A	39.9 A
LO base load output current	26.0 A	32.0 A
HO base load power	7.5 kW	11.0 kW
HO base load input current	27.0 A	36.0 A
HO base load output current	18.0 A	26.0 A
Fuse according to IEC	3NA3820 (50 A)	3NA3820 (50 A)
Fuse according to UL, class J	50 A	50 A
Power loss	0.3 kW	0.37 kW
Required cooling air flow	18.5 l/s	18.5 l/s
Weight without filter	4.7 kg	4.8 kg
Weight with filter	5.3 kg	5.4 kg

Table 6- 21 PM240-2, PT, frame size C, 380 V ... 480 V 3 AC

Article No. without filter	6SL3211-1PE23-3UL0
Article No. with filter	6SL3211-1PE23-3AL0
LO base load power	15.0 kW
LO base load input current	39.9 A
LO base load output current	32.0 A
HO base load power	11.0 kW
HO base load input current	36.0 A
HO base load output current	26.0 A
Fuse according to IEC	3NA3820 (50 A)
Fuse according to UL, class J	50 A
Power loss	0.37 kW <sup>1)</sup>
Required cooling air flow	18.5 l/s
Weight without filter	5.8 kg
Weight with filter	6.3 kg

1) approx. 0.3 kW through the heatsink

Table 6- 22 PM240-2, IP20, frame size D, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE23-8UL0	6SL3210-1PE24-5UL0	6SL3210-1PE26-0UL0
Article No. with filter	6SL3210-1PE23-8AL0	6SL3210-1PE24-5AL0	6SL3210-1PE26-0AL0
LO base load power	18.5 kW	22 kW	30 kW
LO base load input current	36 A	42 A	57 A
LO base load output current	38 A	45 A	60 A
HO base load power	15 kW	18.5 kW	22 kW
HO base load input current	33 A	38 A	47 A
HO base load output current	32 A	38 A	45 A
Fuse according to IEC	3NA3822 (63 A)	3NA3824 (80 A)	3NA3830 (100 A)
Fuse according to UL, class J	60 A	70 A	90 A
Power loss without filter	0.57 kW	0.70 kW	0.82 kW
Power loss with filter	0.58 kW	0.71 kW	0.83 kW
Required cooling air flow	55 l/s	55 l/s	55 l/s
Weight without filter	16.6 kg	16.6 kg	18.3 kg
Weight with filter	18.3 kg	18.3 kg	19 kg

Table 6- 23 PM240-2, IP20, frame size D, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE27-5UL0
Article No. with filter	6SL3210-1PE27-5AL0
LO base load power	37 kW
LO base load input current	70 A
LO base load output current	75 A
HO base load power	30 kW
HO base load input current	62 A
HO base load output current	60 A
Fuse according to IEC	3NA3830 (100 A)
Fuse according to UL, class J	100 A
Power loss without filter	1.09 kW
Power loss with filter	1.10 kW
Required cooling air flow	55 l/s
Weight without filter	18.3 kg
Weight with filter	19 kg

6.5 400 V converters

Table 6- 24 PM240-2, PT, frame size D, 380 V ... 480 V 3 AC

<b>Article No. without filter</b>	<b>6SL3211-1PE27-5UL0</b>
<b>Article No. with filter</b>	<b>6SL3211-1PE27-5AL0</b>
LO base load power	37 kW
LO base load input current	70 A
LO base load output current	75 A
HO base load power	30 kW
HO base load input current	62 A
HO base load output current	60 A
Fuse according to IEC	3NA3830 (100 A)
Fuse according to UL, class J	100 A
Power loss without filter	1.09 kW <sup>1)</sup>
Power loss with filter	1.10 kW <sup>1)</sup>
Required cooling air flow	55 l/s
Weight without filter	20 kg
Weight with filter	22 kg

<sup>1)</sup> Approx. 1 kW through the heatsink

Table 6- 25 PM240-2, IP20, frame size E, 380 V ... 480 V 3 AC

<b>Article No. without filter</b>	<b>6SL3210-1PE28-8UL0</b>	<b>6SL3210-1PE31-1UL0</b>
<b>Article No. with filter</b>	<b>6SL3210-1PE28-8AL0</b>	<b>6SL3210-1PE31-1AL0</b>
LO base load power	45 kW	55 kW
LO base load input current	86 A	104 A
LO base load output current	90 A	110 A
HO base load power	37 kW	45 kW
HO base load input current	78 A	94 A
HO base load output current	75 A	90 A
Fuse according to IEC	3NA3832 (125 A)	3NA3836 (160 A)
Fuse according to UL, class J	125 A	150 A
Power loss without filter	1.29 kW	1.65 kW
Power loss with filter	1.30 kW	1.67 kW
Required cooling air flow	83 l/s	83 l/s
Weight without filter	26.4 kg	26.4 kg
Weight with filter	28.4 kg	28.4 kg

Table 6- 26 PM240-2, PT, frame size E, 380 V ... 480 V 3 AC

Article No. without filter	6SL3211-1PE31-1UL0
Article No. with filter	6SL3211-1PE31-1AL0
LO base load power	55 kW
LO base load input current	104 A
LO base load output current	110 A
HO base load power	45 kW
HO base load input current	94 A
HO base load output current	90 A
Fuse according to IEC	3NA3836 (160 A)
Fuse according to UL, class J	150 A
Power loss without filter	1.65 kW <sup>1)</sup>
Power loss with filter	1.67 kW <sup>1)</sup>
Required cooling air flow	83 l/s
Weight without filter	30.5 kg
Weight with filter	32 kg

<sup>1)</sup> Approx. 1.4 kW through the heatsink

Table 6- 27 PM240-2, IP20, frame size F, 380 V ... 480 V 3 AC

Article No. without filter	6SL3210-1PE31-5UL0	6SL3210-1PE31-8UL0	6SL3210-1PE32-1UL0
Article No. with filter	6SL3210-1PE31-5AL0	6SL3210-1PE31-8AL0	6SL3210-1PE32-1AL0
LO base load power	75 kW	90 kW	110 kW
LO base load input current	140 A	172 A	198 A
LO base load output current	145 A	178 A	205 A
HO base load power	55 kW	75 kW	90 kW
HO base load input current	117 A	154 A	189 A
HO base load output current	110 A	145 A	178 A
Fuse according to IEC	3NA3140 (200 A)	3NA3142 (224 A)	3NA3250 (300 A)
Fuse according to UL, class J	200 A	250 A	300 A
Power loss without filter	1.91 kW	2.46 kW	2.28 kW
Power loss with filter	1.93 kW	2.48 kW	2.30 kW
Required cooling air flow	153 l/s	153 l/s	153 l/s
Weight without filter	58 kg	58 kg	62 kg
Weight with filter	64 kg	64 kg	66 kg

6.5 400 V converters

Table 6- 28 PM240-2, IP20, frame size F, 380 V ... 480 V 3 AC

<b>Article No. without filter</b>	<b>6SL3210-1PE32-5UL0</b>
<b>Article No. with filter</b>	<b>6SL3210-1PE32-5AL0</b>
LO base load power	132 kW
LO base load input current	242 A
LO base load output current	250 A
HO base load power	110 kW
HO base load input current	218 A
HO base load output current	205 A
Fuse according to IEC	3NA3252 (315 A)
Fuse according to UL, class J	350 A
Power loss without filter	2.98 kW
Power loss with filter	3.02 kW
Required cooling air flow	153 l/s
Weight without filter	62 kg
Weight with filter	66 kg

Table 6- 29 PM240-2, PT, frame size F, 380 V ... 480 V 3 AC

<b>Article No. without filter</b>	<b>6SL3211-1PE32-5UL0</b>
<b>Article No. with filter</b>	<b>6SL3211-1PE32-5AL0</b>
LO base load power	132 kW
LO base load input current	242 A
LO base load output current	250 A
HO base load power	110 kW
HO base load input current	218 A
HO base load output current	205 A
Fuse according to IEC	3NA3252 (315 A)
Fuse according to UL, class J	350 A
Power loss without filter	2.98 kW <sup>1)</sup>
Power loss with filter	3.02 kW <sup>1)</sup>
Required cooling air flow	153 l/s
Weight without filter	63.5 kg
Weight with filter	68.5 kg

<sup>1)</sup> Approx. 2.6 kW through the heatsink

Table 6- 30 PM240-2, frame size G, 380 V ... 480 V 3 AC

Article No. with filter class C3	6SL3210-1PE33-0CL0	6SL3210-1PE33-7CL0	6SL3210-1PE34-8CL0
Article No. with filter class C2	6SL3210-1PE33-0AL0	6SL3210-1PE33-7AL0	6SL3210-1PE34-8AL0
LO base load power	160 kW	200 kW	250 kW
LO base load input current	300 A	365 A	470 A
LO base load output current	302 A	370 A	477 A
HO base load power	132 kW	160 kW	200 kW
HO base load input current	275 A	330 A	400 A
HO base load output current	250 A	302 A	370 A
Fuse according to IEC	3NA3254 (355 A)	3NA3260 (400 A)	3NA3372 (630 A)
Fuse according to UL, class J	400 A	500 A	600 A
Fuse according to IEC/UL	3NE1334-2 (500A)	3NE1334-2 (500A)	3NE1436-2 (630A)
Power loss with filter class C3	3.67 kW	4.62 kW	6.18 kW
Power loss with filter class C2	3.67 kW	4.62 kW	6.18 kW
Required cooling air flow	210 l/s	210 l/s	210 l/s
Weight with filter class C3	105 kg	113 kg	120 kg
Weight with filter class C2	107 kg	114 kg	122 kg

### 6.5.3 Current derating depending on the pulse frequency, 400 V converters

Article number	LO power [kW]	Pulse frequency [kHz]							
		2	4 *)	6	8	10	12	14	16
		LO base load output current [A]							
6SL3210-1PE11-8 . L1	0.55	1.7	<b>1.7</b>	1.4	1.2	1	0.9	0.8	0.7
6SL3210-1PE12-3 . L1	0.75	2.2	<b>2.2</b>	1.9	1.5	1.3	1.1	1	0.9
6SL3210-1PE13-2 . L1	1.1	3.1	<b>3.1</b>	2.6	2.2	1.9	1.6	1.4	1.2
6SL3210-1PE14-3 . L1	1.5	4.1	<b>4.1</b>	3.5	2.9	2.5	2.1	1.8	1.6
6SL3210-1PE16-1 . L1	2.2	5.9	<b>5.9</b>	5	4.1	3.5	3	2.7	2.4
6SL321 . -1PE18-0 . L1	3	7.7	<b>7.7</b>	6.5	5.4	4.6	3.9	3.5	3.1
6SL3210-1PE21-1 . L0	4	10.2	<b>10.2</b>	8.7	7.1	6.1	5.1	4.6	4.1
6SL3210-1PE21-4 . L0	5.5	13.2	<b>13.2</b>	11.2	9.2	7.9	6.6	5.9	5.3
6SL321 . -1PE21-8 . L0	7.5	18	<b>18</b>	15.3	12.6	10.8	9	8.1	7.2
6SL3210-1PE22-7 . L0	11	26	<b>26</b>	22.1	18.2	15.6	13	11.7	10.4
6SL321 . -1PE23-3 . L0	15	32	<b>32</b>	27.2	22.4	19.2	16	14.4	12.8
6SL3210-1PE23-8 . L0	18.5	38	<b>38</b>	32.3	26.6	22.8	19	17.1	15.2
6SL3210-1PE24-5 . L0	22	45	<b>45</b>	38.3	31.5	27	22.5	20.3	18
6SL3210-1PE26-0 . L0	30	60	<b>60</b>	51	42	36	30	27	24
6SL321 . -1PE27-5 . L0	37	75	<b>75</b>	63.8	52.5	45	37.5	33.8	30
6SL3210-1PE28-8 . L0	45	90	<b>90</b>	76.5	63	54	45	40.5	36
6SL321 . -1PE31-1 . L0	55	110	<b>110</b>	93.5	77	---	---	---	---
6SL3210-1PE31-5 . L0	75	145	<b>145</b>	123.3	101.5	---	---	---	---
6SL3210-1PE31-8 . L0	90	178	<b>178</b>	151.3	124.6	---	---	---	---
Article number		Pulse frequency [kHz]							
		2 *)	4	6	8	10	12	14	16
		LO base load output current [A]							
6SL3210-1PE32-1 . L0	110	<b>205</b>	143.5	102.5	82	---	---	---	---
6SL321 . -1PE32-5 . L0	132	<b>250</b>	175	125	100	---	---	---	---
6SL3210-1PE33-0 . L0	160	<b>302</b>	211.4	151	120.8	---	---	---	---
6SL3210-1PE33-7 . L0	200	<b>370</b>	259	185	148	---	---	---	---
6SL3210-1PE34-8 . L0	250	<b>477</b>	333.9	238.5	190.8	---	---	---	---

\*) Factory setting

The permissible motor cable length depends on the particular cable type and the pulse frequency that has been selected

## 6.6 690 V converters

### **Motors for 690 V Power Modules**

For the 690 V Power Modules, induction motors are permissible in the range from 50 % ... 150 % of the converter power without any restrictions.

---

### **Note**





#### **Motors for converter operation**

Only use motors that are suitable for operation with converters with a DC link.


For 690 V Power Modules, motors with a suitable insulation system for 690 V converter operation are required (e.g. PREMIUM).

---

### 6.6.1 General data, 690 V converters

Property	Version
Line voltage	<ul style="list-style-type: none"> <li>for systems according to IEC: 500 V ... 690 V 3 AC <math>\pm 10\%</math> (in operation <math>-20\% &lt; 1 \text{ min}</math>)</li> <li>for systems according to UL 500 V ... 600 V 3 AC <math>\pm 10\%</math> (in operation <math>-20\% &lt; 1 \text{ min}</math>) filtered devices only with Slash Rating (600Y/347V AC)</li> </ul>
Line supply configurations	<p>Grounded TN/TT line supplies or non-grounded IT line supplies</p>  Permissible line supplies (Page 46)
Line impedance	No restrictions
Power factor $\lambda$	$> 0.9$
Output voltage	0 V 3 AC ... 0.95 x input voltage (max.)
Input frequency	50 Hz ... 60 Hz, $\pm 3 \text{ Hz}$
Output frequency	0 ... 550 Hz, depending on the control mode
Inrush current	$< \text{LO base load input current}$
Overvoltage category according to EN 61800-5-1	III for line supplies
Pulse frequency	<p>2 kHz (factory setting), can be adjusted to 4 kHz</p> <p>Adjustable in steps of 2 kHz.</p>  Current reduction as a function of the pulse frequency (Page 104) If you increase the pulse frequency, the converter reduces the maximum output current.
Short-circuit current (SCCR) and branch protection	<p>Maximum permissible line short-circuit current <math>\leq 100 \text{ kA rms}</math></p>  Branch protection and short-circuit strength according to UL and IEC ( <a href="https://support.industry.siemens.com/cs/ww/en/view/109479152">https://support.industry.siemens.com/cs/ww/en/view/109479152</a> )
Braking methods	DC braking, compound braking, dynamic braking with integrated braking chopper
Degree of protection according to EN 60529	IP20; must be installed in a control cabinet
Protection class according to EN 61800-5-1	The converters are devices with protection class I
Touch protection according to EN 50274	DGUV regulation 3 when used for the intended purpose
Cooling in compliance with EN 60146	Forced air cooling AF
Safety Integrated	<p>See function manual "Safety Integrated"</p>  "Safety Integrated" function manual ( <a href="https://support.industry.siemens.com/cs/ww/en/view/109751320">https://support.industry.siemens.com/cs/ww/en/view/109751320</a> )

## Dependency of input voltage and output power

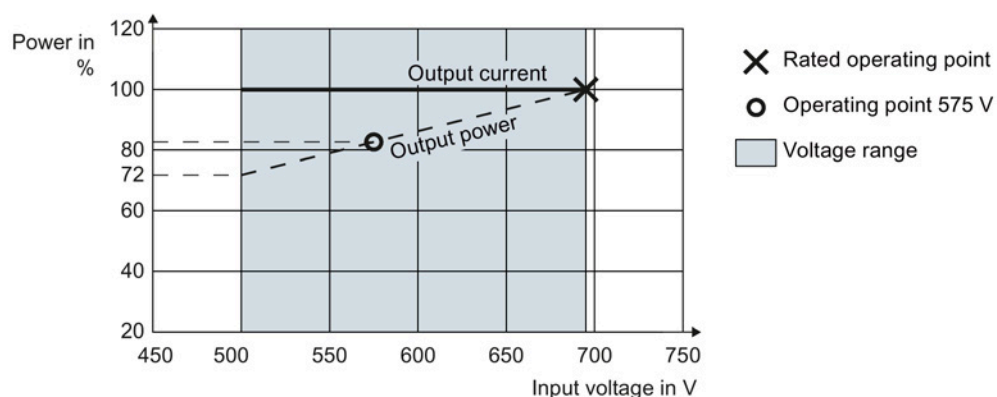

## 6.6.2 Specific technical data, 690 V converters

Table 6- 31 PM240-2, IP20, frame size D, 500 V ... 690 V 3 AC

Article No. - without filter	6SL3210-1PH21-4UL0	6SL3210-1PH22-0UL0	6SL3210-1PH22-3UL0
Article No. - with filter	6SL3210-1PH21-4AL0	6SL3210-1PH22-0AL0	6SL3210-1PH22-3AL0
LO base load power	11 kW	15 kW	18.5 kW
LO base load input current	14 A	18 A	22 A
LO base load output current	14 A	19 A	23 A
HO base load power	7.5 kW	11 kW	15 kW
HO base load input current	11 A	14 A	20 A
HO base load output current	11 A	14 A	19 A
Fuse according to IEC	3NA3807-6 (20 A)	3NA3810-6 (25 A)	3NA3812-6 (32 A)
Fuse according to UL, class J	20 A	25 A	30 A
Power loss without filter	0.35 kW	0.44 kW	0.52 kW
Power loss with filter	0.35 kW	0.45 kW	0.52 kW
Required cooling air flow	55 l/s	55 l/s	55 l/s
Weight without filter	17.4 kg	17.4 kg	17.4 kg
Weight with filter	18.9 kg	18.9 kg	18.9 kg

## 6.6 690 V converters

Table 6- 32 PM240-2, IP20, frame size D, 500 V ... 690 V 3 AC

Article No. - without filter	6SL3210-1PH22-7UL0	6SL3210-1PH23-5UL0	6SL3210-1PH24-2UL0
Article No. - with filter	6SL3210-1PH22-7AL0	6SL3210-1PH23 -5AL0	6SL3210-1PH24-2AL0
LO base load power	22 kW	30 kW	37 kW
LO base load input current	25 A	33 A	40 A
LO base load output current	27 A	35 A	42 A
HO base load power	18.5 kW	22 kW	30 kW
HO base load input current	24 A	28 A	36 A
HO base load output current	23 A	27 A	35 A
Siemens fuse according to IEC	3NA3817-6KJ (40 A)	3NA3820-6KJ (50 A)	33NA3822-6 (63 A)
Fuse according to UL, class J	35 A	45 A	60 A
Power loss without filter	0.60 kW	0.77 kW	0.93 kW
Power loss with filter	0.60 kW	0.78 kW	0.94 kW
Required cooling air flow	55 l/s	55 l/s	55 l/s
Weight without filter	17.4 kg	17.4 kg	17.4 kg
Weight with filter	18.9 kg	18.9 kg	18.9 kg

Table 6- 33 PM240-2, IP20, frame size E, 500 V ... 690 V 3 AC

Article No. - without filter	6SL3210-1PH25-2UL0	6SL3210-1PH26-2UL0
Article No. - with filter	6SL3210-1PH25-2AL0	6SL3210-1PH26-2AL0
LO base load power	45 kW	55 kW
LO base load input current	50 A	59 A
LO base load output current	52 A	62 A
HO base load power	37 kW	45 kW
HO base load input current	44 A	54 A
HO base load output current	42 A	52 A
Siemens fuse according to IEC	3NA3824-6 (80A)	3NA3824-6 (80A)
Fuse according to UL, class J	80 A	80 A
Power loss without filter	1.07 kW	1.30 kW
Power loss with filter	1.08 kW	1.31 kW
Required cooling air flow	83 l/s	83 l/s
Weight without filter	27.1 kg	27.1 kg
Weight with filter	28.5 kg	28.5 kg

Table 6- 34 PM240-2, IP20, frame size F, 500 V ... 690 V 3 AC

Article No. - without filter	6SL3210-1PH28-0UL0	6SL3210-1PH31-0UL0	6SL3210-1PH31-2UL0
Article No. - with filter	6SL3210-1PH28-0AL0	6SL3210-1PH31-0AL0	6SL3210-1PH31-2AL0
LO base load power	75 kW	90 kW	110 kW
LO base load input current	78 A	97 A	111 A
LO base load output current	80 A	100 A	115 A
HO base load power	55 kW	75 kW	90 kW
HO base load input current	66 A	85 A	106 A
HO base load output current	62 A	80 A	100 A
Siemens fuse according to IEC	3NA3830-6 (100 A)	3NA3132-6 (125 A)	3NA3136-6 (160 A)
Fuse according to UL, class J	100 A	125 A	150 A
Power loss without filter	1.37 kW	1.74 kW	1.95 kW
Power loss with filter	1.38 kW	1.76 kW	1.97 kW
Required cooling air flow	153 l/s	153 l/s	153 l/s
Weight without filter	61 kg	61 kg	61 kg
Weight with filter	65 kg	65 kg	65 kg

Table 6- 35 PM240-2, IP20, frame size F, 500 V ... 690 V 3 AC

Article No. - without filter	6SL3210-1PH31-4UL0
Article No. - with filter	6SL3210-1PH31-4AL0
LO base load power	132 kW
LO base load input current	137 A
LO base load output current	142 A
HO base load power	110 kW
HO base load input current	122 A
HO base load output current	115 A
Siemens fuse according to IEC	3NA3140-6 (200 A)
Fuse according to UL, class J	200 A
Power loss without filter	2.48 kW
Power loss with filter	2.51 kW
Required cooling air flow	153 l/s
Weight without filter	61 kg
Weight with filter	65 kg

## 6.6 690 V converters

Table 6- 36 PM240-2, frame size G, 500 V ... 690 V 3 AC

Article No. with filter	6SL3210-1PH31-7CLO	6SL3210-1PH32-1CLO	6SL3210-1PH32-5CLO
LO base load power	160 kW	200 kW	250 kW
LO base load input current	170 A	205 A	250 A
LO base load output current	171 A	208 A	250 A
HO base load power	132 kW	160 kW	200 kW
HO base load input current	160 A	185 A	225 A
HO base load output current	144 A	171 A	208 A
Fuse according to the IEC/UL	3NE1227-0 (250A)	3NE1230-0 (315A)	3NE1331-0 (350A)
Power loss	2.94 kW	3.70 kW	4.64 kW
Required cooling air flow	210 l/s	210 l/s	210 l/s
Weight	114 kg	114 kg	114 kg

### 6.6.3 Current derating depending on the pulse frequency, 690 V converters

Article number	LO power [kW]	Pulse frequency [kHz]	
		2 *)	4
		LO base load output current [A]	
6SL3210-1PH21-4 . LO	11	14	8.4
6SL3210-1PH22-0 . LO	15	19	11.4
6SL3210-1PH22-3 . LO	18.5	23	13.8
6SL3210-1PH22-7 . LO	22	27	16.2
6SL3210-1PH23-5 . LO	30	35	21
6SL321 . -1PH24-2 . LO	37	42	25.2
6SL3210-1PH25-2 . LO	45	52	31.2
6SL321 . -1PH26-2 . LO	55	62	37.2
6SL3210-1PH28-0 . LO	75	80	48
6SL3210-1PH31-0 . LO	90	100	60
6SL3210-1PH31-2 . LO	110	115	69
6SL3210-1PH31-4 . LO	132	142	85.2
6SL3210-1PH31-7CLO	160	171	102.6
6SL3210-1PH32-1CLO	200	208	124.8
6SL3210-1PH32-5CLO	250	250	150

\*) Factory setting

The permissible motor cable length depends on the particular cable type and the pulse frequency that has been selected

## 6.7 Restrictions for special ambient conditions

### Maximum current at low speeds

#### NOTICE

##### Overheating the converter due to unsuitable load

Loading the converter with a high output current and at the same time with a low output frequency can cause the current-conducting components in the converter to overheat. Excessively high temperatures can damage the converter or have a negative impact on the converter service life.

- Never operate the converter continuously with an output frequency = 0 Hz.
- Only operate the converter in the permissible operating range.

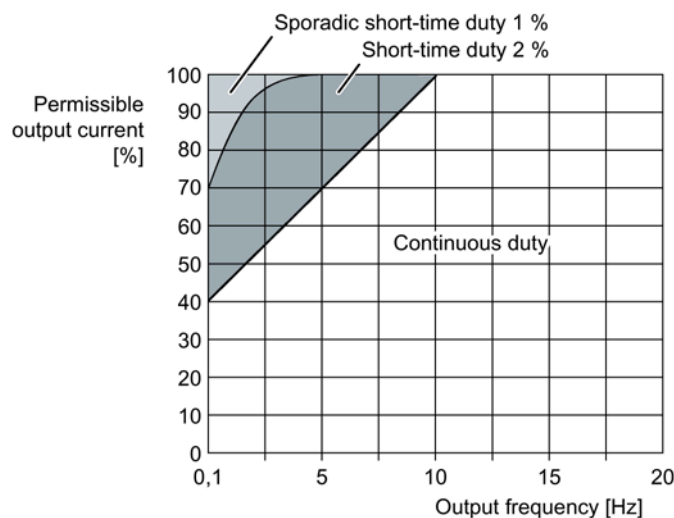


Figure 6-2 Permissible operating range of the converter

- **Continuous operation:**  
Operating state that is permissible for the complete operating time.
- **Short-time duty:**  
Operating state that is permissible for less than 2 % of the operating time.
- **Sporadic short-time duty:**  
Operating state that is permissible for less than 1 % of the operating time.

## 6.7 Restrictions for special ambient conditions

### Current reduction as a function of the installation altitude and ambient temperature

At installation altitudes above 1000 m the permissible converter output current is reduced.

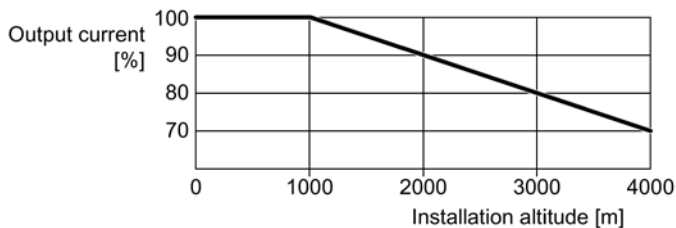


Figure 6-3 Current reduction as a function of the installation altitude

At installation altitudes above 1000 m, you can compensate the permissible converter output current to a certain extent using the ambient temperature. The following tables contain the details.

Table 6- 37 Maximum permitted output current for loading according to LO

Installation altitude [m] up to	Ambient temperature [°C]								
	20	25	30	35	40	45	50	55	60
	Output current in [%] when loading to LO								
1000	100					93	85	76	66
1500	100				95	88	81	72	63
2000	100			97	90	83	77	68	59
2500	100		98	91	85	79	72	64	56
3000	100	98	92	86	80	74	68	60	53
3500	98	92	86	81	75	69	64	57	50
4000	91	86	81	75	70	65	60	53	46

Table 6- 38 Maximum permitted output current when loading according to HO

Installation altitude [m] up to	Ambient temperature [°C]								
	20	25	30	35	40	45	50	55	60
	Output current in [%] when loading to HO								
1000	100							87	74
1500	100						95	83	70
2000	100				99	95	90	78	67
2500	100			98	94	89	85	74	63
3000	100		96	92	88	84	80	70	59
3500	98	94	90	86	83	79	75	65	56
4000	91	88	84	81	77	74	70	61	52

Also observe the maximum permissible ambient operating temperatures for the Control Unit and possibly the Operator Panel.

**Permissible line supplies dependent on the installation altitude**

- For installation altitudes  $\leq 2000$  m above sea level, it is permissible to connect the converter to any of the line supplies that are specified for it.
- For installation altitudes 2000 m ... 4000 m above sea level, the following applies:
  - Connection to a TN line system with grounded neutral point is permissible.
  - TN systems with grounded line conductor are not permitted.
  - The TN line system with grounded neutral point can also be supplied using an isolation transformer.
  - The phase-to-phase voltage does not have to be reduced.

---

**Note**

**Using Power Modules connected to TN line supplies with voltages  $\geq 600$  V for installation altitudes 2000 m ... 4000 m**

For voltages  $\geq 600$  V, the TN line supply must have a grounded neutral point established using an isolating transformer.

---

## 6.8 Electromagnetic compatibility of variable-speed drives

EMC (electromagnetic compatibility) means that the devices function satisfactorily without interfering with other devices and without being disrupted by other devices. EMC applies when the emitted interference (emission level) and the interference immunity are matched with each other.

The product standard IEC/EN 61800-3 describes the EMC requirements placed on "Variable-speed drive systems".

A variable-speed drive system (or Power Drive System PDS) consists of the converter as well as the associated electric motors and encoders including the connecting cables.

The driven machine is not part of the drive system.

---

**Note****PDS as component of machines or systems**

When you install PDS into machines or systems, additional measures may be required so that the product standards of these machines or systems is complied with. The machine or system builder is responsible for taking these measures.

---

## Environments and categories

### Environments

IEC/EN 61800-3 makes a distinction between the "first environment" and "second environment" - and defines different requirements for these environments.

- **First environment:**  
Residential buildings or locations at which the PDS is directly connected to a public low-voltage supply without intermediate transformer.
- **Second environment:**  
All industrial plant/systems or locations that are connected to the public grid through their own, dedicated transformer.

### Categories

IEC/EN 61800-3 makes a distinction between four drive system categories:

- **Category C1:**  
Drive systems for rated voltages < 1000 V for unrestricted use in the "first environment"
- **Category C2:**  
Stationary PDS for rated voltages < 1000 V for operation in the "second environment".  
  
Appropriately qualified personnel are required to install the PDS. An appropriately trained and qualified person has the necessary experience for installing and commissioning a PDS, including the associated EMC aspects.  
  
Additional measures are required for operation in the "first environment".
- **Category C3:**  
PDS for rated voltages < 1000 V - only for operation in the "second environment".
- **Category C4:**  
PDS for IT line supplies for operation in complex systems in the "second environment".  
  
An EMC plan is required.

## 6.8.1

### Converter applications

Converters involve equipment used on a professional basis, deployed in certain areas of business and industry - and are not operated in the general public domain.



For an EMC-compliant installation, observe the information provided in the Configuration manual:EMC installation guideline (<http://support.automation.siemens.com/WW/view/en/60612658>).

The devices described there are intended for operation in the first and second environments. Conditions for operation in the respective environment are subsequently listed.


### 6.8.1.1 Operation in the Second Environment

#### Interference immunity

You do not have to take any additional measures regarding interference immunity.

#### Interference emission - operation in the second environment, Category C2

The drive system must comply with the following conditions in order to comply with the limit values of the second environment, Category C2:

- The drive system is installed by appropriately qualified personnel in compliance with EMC regulations - and the installation notes provided in the manual.
- You use a shielded motor cable with low capacitance.
- The pulse frequency is not higher than the value set in the factory.
- The drive system is connected to a TN or TT line supply.
- You comply with the permissible motor cable length.  
 Length of the motor cable (Page 56).
- The converters are equipped with a Category C2 line filter (internal or external).

- **200 V converter frame size FSA ... FSC**

Converters with integrated filter are suitable for operation in the second environment, Category C2.

- **200 V converter frame size FSD ... FSF**

The converters require an external filter, Category C2


- **400 V converter**

Converters with integrated filter are suitable for operation in the second environment, Category C2.

- **690 V converter**

Converters of frame sizes FSD and FSE with integrated filter are suitable for operation in the Second Environment, Category C2.

Converters of frame sizes FSF and FSG with integrated filter are suitable for operation in the Second Environment, Category C3.

With the external filters, from Section  Line filter (Page 125), the converters without integrated filter comply with the requirements of the Second Environment, Category C2 with reference to interference emission.

If you use converters without integrated filter or a filter other than those mentioned above, then you are responsible for verifying that the interference emission is limited.

You can use a dedicated radio interference suppression filter for each converter - or a common filter for several converters.



Further information on unfiltered devices can be found on the Internet:

Compliance with EMC limits with unfiltered devices

(<https://support.industry.siemens.com/cs/ww/en/view/109750634>)

## Interference emission - operation in the second environment, Category C4

When connected to IT line supplies, only filtered converters are permissible. Use external filters without capacitors with respect to ground to limit symmetrical interference emission. When necessary, contact one of our Solution Partners

(<https://www.automation.siemens.com/solutionpartner/partnerfinder/Home/Index?country=DE&program=1&technology=19&lang=en>).

### 6.8.1.2 Operation in the First Environment

#### Interference immunity

You do not have to take any additional measures regarding interference immunity.

## Interference emission - operation in the first environment, Category C2

In order that you may operate the drive system in the first environment, Category C2, then in addition to the requirements for use in the second environment, you must also observe the limit values related to harmonic currents.

---

#### Note

##### Maintaining the limit values for harmonic currents

With respect to the compliance with limits for harmonic currents, the EMC product standard EN61800-3 for PDS refers to compliance with standards EN 61000-3-2 and EN 61000-3-12.

---

#### Converter with an LO base load power $\leq 1$ kW:

It cannot be guaranteed that the limit values are complied with corresponding to IEC 61000-3-2. The installation person/company or company operating the professionally used device must obtain authorization from the grid operator to connect the device regarding the harmonic currents.



Typical harmonic currents (Page 111)

#### Converters with an LO base load input current $\leq 16$ A:

These devices are not subject to any limit values, and as a consequence can be connected to the public low-voltage grid without any prior consultation.

#### Converters with an LO base load input current $> 16$ A and $\leq 75$ A

The drive system is in compliance with IEC/EN 61000-3-12 under the following preconditions:

- FSC Power Module, input voltage 3 AC 200 ... 240 V: You use a 3% or 4% line reactor.
- FSD Power Module, input voltage 3 AC 200 ... 240 V: A line reactor is not required
- FSB/FSC Power Module, input voltage 3 AC 380 ... 480 V: You use a 3% or 4% line reactor.

- Power Module FSD, input voltage 380 ... 480 V 3 AC: A line reactor is not required

#### Note

##### Line reactor

Contact our Solution Partners

(<https://www.automation.siemens.com/solutionpartner/partnerfinder/Home/Index?country=DE&program=1&technology=19&lang=en>) for a line reactor.

- Short-circuit power  $S_{SC}$  at the connection point of the customer's system to the public grid, is greater than or equal to the value according to the following formula:

$$S_{SC} \geq 120 \times \sqrt{3} \times V_{in} \times I_{LO} \text{ base load input current}$$

**Example:** FSD converter, 400 V, input current, 70 A:

$$S_{SC} \geq 120 \times \sqrt{3} \times 400 \text{ V} \times 70 \text{ A}$$

This corresponds to a low-voltage transformer with an apparent power rating of 300 kVA ... 400 kVA with  $V_K = 4\% \dots 6\%$

The installation company or company operating the equipment is responsible for ensuring that this equipment is only connected at a connection point with an appropriate short-circuit power (fault level).

If these preconditions do not apply, then the installation company or company operating the device must obtain authorization from the grid operator to connect the device regarding the harmonic currents.



Typical harmonic currents (Page 111)

#### Converters with an LO base load current > 75A

There are no standard-related requirements for installing devices such as these. However, we recommend that the grid operator is informed when such a device is connected. 400 V converters conform to EN 61000-3-12.

## 6.8.2 Typical harmonic currents

Table 6- 39 Typical harmonic currents (%) of the converter

Converter	Harmonic number							
	5th	7th	11th	13th	17th	19th	23rd	25th
FSA ... FSC, 200 V, 400 V <sup>1)</sup>	54	39	11	5.5	5	3	2	2
FSD ... FSF, 200 V <sup>2)</sup>	28	14	8	6	5	4	3	3
FSD ... FSG, 400 V <sup>2)</sup>	37	21	7	5	4	3	3	2
FSD ... FSG, 690 V <sup>2)</sup>	34	18	8	5	4	3	3	2

<sup>1)</sup> Values relative to the LO input current for  $V_K 1\%$

<sup>2)</sup> Values relative to the LO input current

### 6.8.3 Harmonics at the power supply connection point according to IEC 61000-2-2

#### Description

IEC 61000-2-2 defines the compatibility level for voltage harmonics for the point of common coupling (PCC) with the public supply system.

For systems in which converters or other non-linear loads are widely used, a circuit feedback calculation that takes the individual system configuration into consideration should always be performed.

The converter with upstream Line Harmonics Filters (LHF) allows adherence to the compatibility level for voltage harmonics, regardless of what percentage of the overall load is made up of the converter load.

#### Note

The voltage distortions behavior in the frequency range of 2 kHz to 9 kHz (IEC 61000-2-2 AMD 1) and from 9 kHz to 150 kHz (IEC 61000-2-2 AMD 2) must be evaluated specifically for each system as a function of the impedance at the power supply connection point.

### 6.8.4 EMC limit values in South Korea

The following statements apply for filtered 400 V converters, frame sizes FSD ... FSF.

All other converters do not comply with the limit values.

이 기기는 업무용(A 급) 전자파적합기기로서 판매자 또는 사용자는 이 점을 주의하시기 바라며, 가정외의 지역에서 사용하는 것을 목적으로 합니다.  
For sellers or users, please keep in mind that this device is an A-grade electromagnetic wave device. This device is intended to be used in areas other than home.

The EMC limit values to be observed for Korea correspond to the limit values of the EMC product standard for variable-speed electric drives EN 61800-3 of category C2 or the limit value class A, Group 1 to KN11.

By implementing appropriate additional measures, the limit values according to category C2 or limit value class A, Group 1, are observed.

Additional measures, such as the use of an additional RFI suppression filter (EMC filter), may be necessary.

In addition, measures for EMC-compliant configuration of the plant or system are described in detail in this manual.

You can find additional information about EMC-compliant configuration of the plant or system on the Internet:



EMC installation guideline

(<http://support.automation.siemens.com/WW/view/en/60612658>)

The final statement on compliance with the applicable standard is given by the respective label attached to the individual device.

## 6.9 Service life

The PM240-2 is designed to have a service life of 10 years under the following conditions:

- Nominal load at 40 °C: 4000 h/y
- Idle time or standby at 20 °C: 4000 h/y
- Power off: 760 h/y



## Spare parts

### Spare parts for frame sizes FSA ... FSC

	Article number		
	FSA	FSB	FSC
PM240-2 PT shield connection kit	6SL3266-1EA00-0DA0	6SL3266-1EB00-0DA0	6SL3266-1EC00-0DA0
Fan kit	6SL3200-0SF12-0AA0	6SL3200-0SF13-0AA0	6SL3200-0SF14-0AA0

### Spare parts for frame sizes FSD ... FSG

	Article number			
	FSD	FSE	FSF	FSG
Set of small components	6SL3200-0SK08-0AA0	6SL3200-0SK08-0AA0	6SL3200-0SK08-0AA0	6SL3200-0SK08-0AA0
Mechanical kit	6SL3200-0SM13-0AA0	6SL3200-0SM14-0AA0	6SL3200-0SM15-0AA0	6SL3200-0SM16-0AA0
Fan kit, IP20 devices	6SL3200-0SF15-0AA0	6SL3200-0SF16-0AA0	6SL3200-0SF17-0AA0	6SL3200-0SF18-0AA0
Fan kit, PT devices	6SL3200-0SF25-0AA0	6SL3200-0SF27-0AA0	6SL3200-0SF28-0AA0	---
Accessory kit / shield connection kit	6SL3262-1AD01-0DA0	6SL3262-1AE01-0DA0	6SL3262-1AF01-0DA0	6SL3262-1AG01-0DA0




## Accessories

### Available components

- Accessory kit / shield connection kit (includes the upper shield plate)
- Mounting frames for PT Power Modules
- Mounting grips for PT Power Modules - frame sizes FSD ... FSF
- Control Unit Adapter Kit CUA20, FSA ... FSG
- Line harmonics filters for frame sizes FSB ... FSG
- Line reactors for frame sizes FSA ... FSC  
Line reactors are not required for frame sizes FSD ... FSG.
- External line filters, Class B (regarding conducted emissions) for frame sizes FSA ... FSC  
No Class B filters are available for frame sizes FSD ... FSG.
- Braking resistors
- Brake Relay or Safe Brake Relay for controlling a motor holding brake
- Output reactors
- Sine-wave filters
- dv/dt filter plus Voltage Peak Limiter

### Connection components

Connection overview for the electrical components

 Connection overview (Page 53).

## 8.1 Top shield plate - FSD ... FSG

The shield plate is included in the accessory kit / shield connection kit. Article numbers:

 Spare parts (Page 115)

Fasten the shield plate as shown in the graphic:

- FSD and FSE: 2 x M5 / 3 Nm
- FSF and FSG: 4 x M8 / 23 Nm



## 8.2 Mounting frames for PT power modules

### Article numbers for mounting frames

- FSA: 6SL3260-6AA00-0DA0
- FSB: 6SL3260-6AB00-0DA0
- FSC: 6SL3260-6AC00-0DA0
- FSD: 6SL3200-0SM17-0AA0
- FSE: 6SL3200-0SM18-0AA0
- FSF: 6SL3200-0SM20-0AA0

All of the necessary nuts and seals are included in the scope of delivery.

#### NOTICE

##### Damage to devices due to defective mounting frame seals

If seals are defective, liquid or dirt can enter the control cabinet. This can damage or even destroy devices.

- Check the seals for damage.
- Replace any damaged seals.




#### WARNING

##### Spread of fire from the rear side of the converter


In the event of fire outbreak, the rear side of the converter installed with the push-through mounting frame cannot prevent the escape of fire and smoke. This can result in serious personal injury or property damage.

- Install a metal rear air channel that prevents the spread of fire and smoke, or take other appropriate measures to protect personnel.
- Ensure that smoke can only escape via controlled and monitored paths.

## Dimension drawings for mounting frames, FSA ... FSC

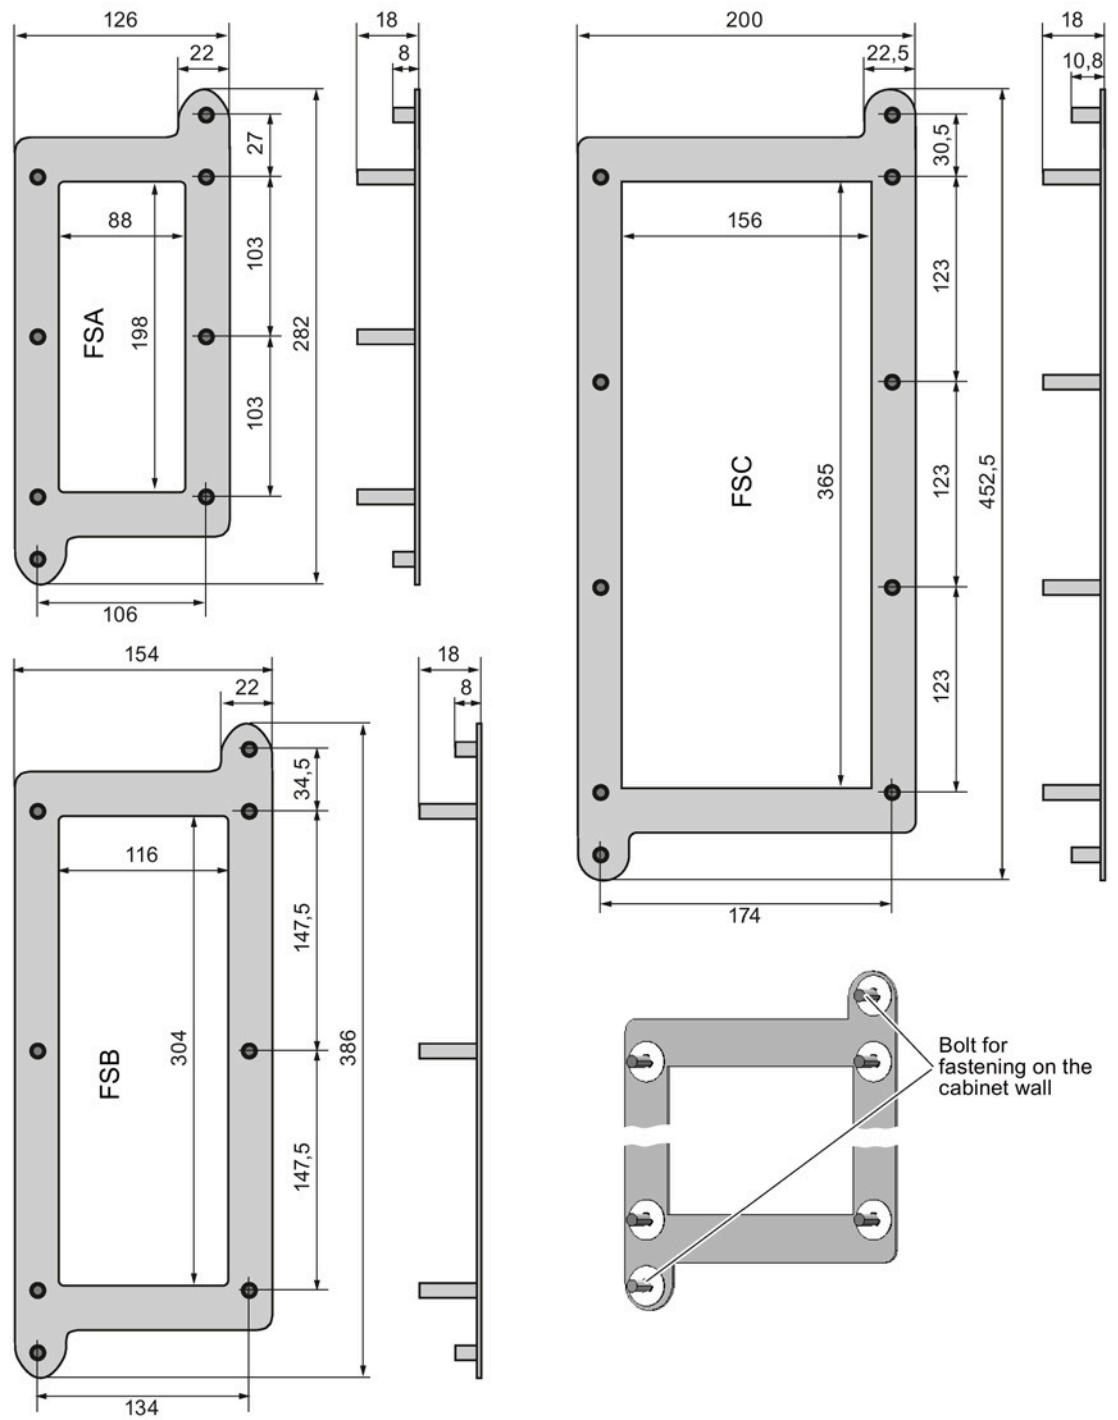

## Dimension drawings for mounting frames, FSD ... FSF

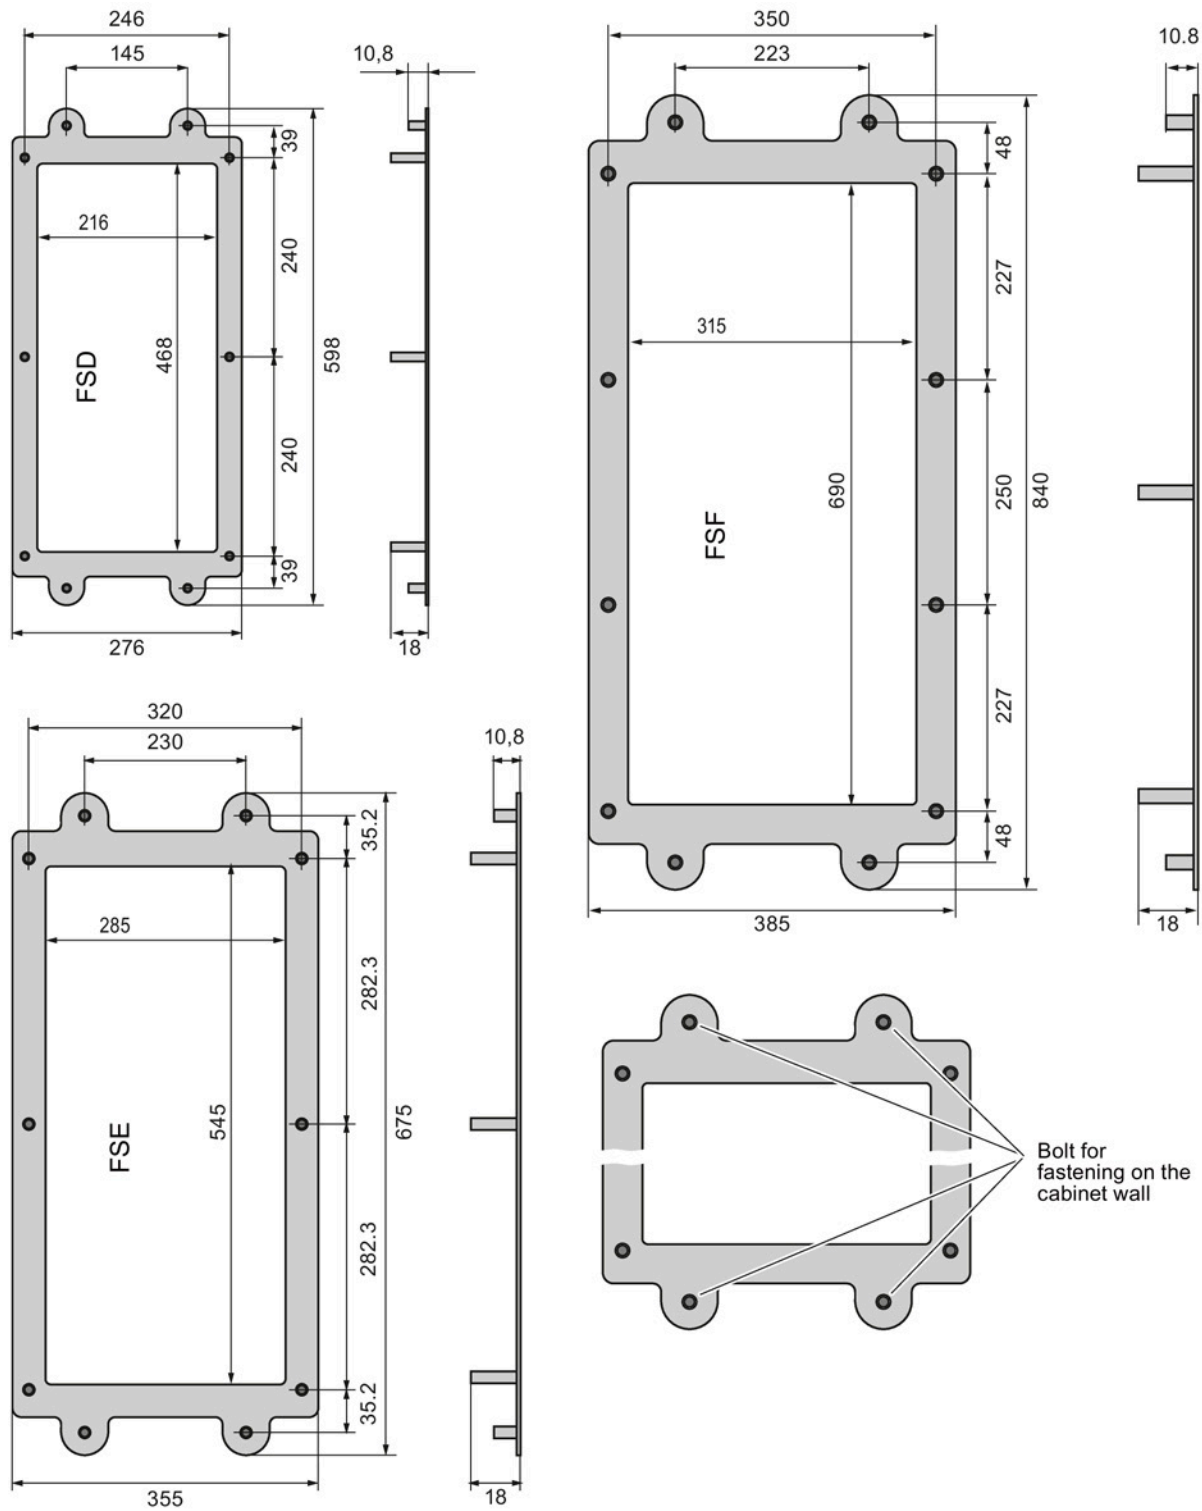

**Procedure**

Proceed as follows to correctly mount the Power Module with the mounting frame:

1. Prepare a cutout and holes in the control cabinet panel for the mounting frame corresponding to the dimension drawing.
2. Insert the mounting frame from the rear of the control cabinet through the corresponding holes and fix it in place at the fixing screws for the control cabinet panel; tighten the two / four nuts by hand.
3. Attach the seal to the inner side of the control cabinet (frame sizes FSA ... FSC only).
4. Insert the Power Module and tighten the screws by hand.
5. Mount the Power Module.
6. Finally, tighten the screws with the following torques.
  - M5 screws: 3.5 Nm
  - M6 screws: 5.9 Nm



You have correctly installed the Power Module.

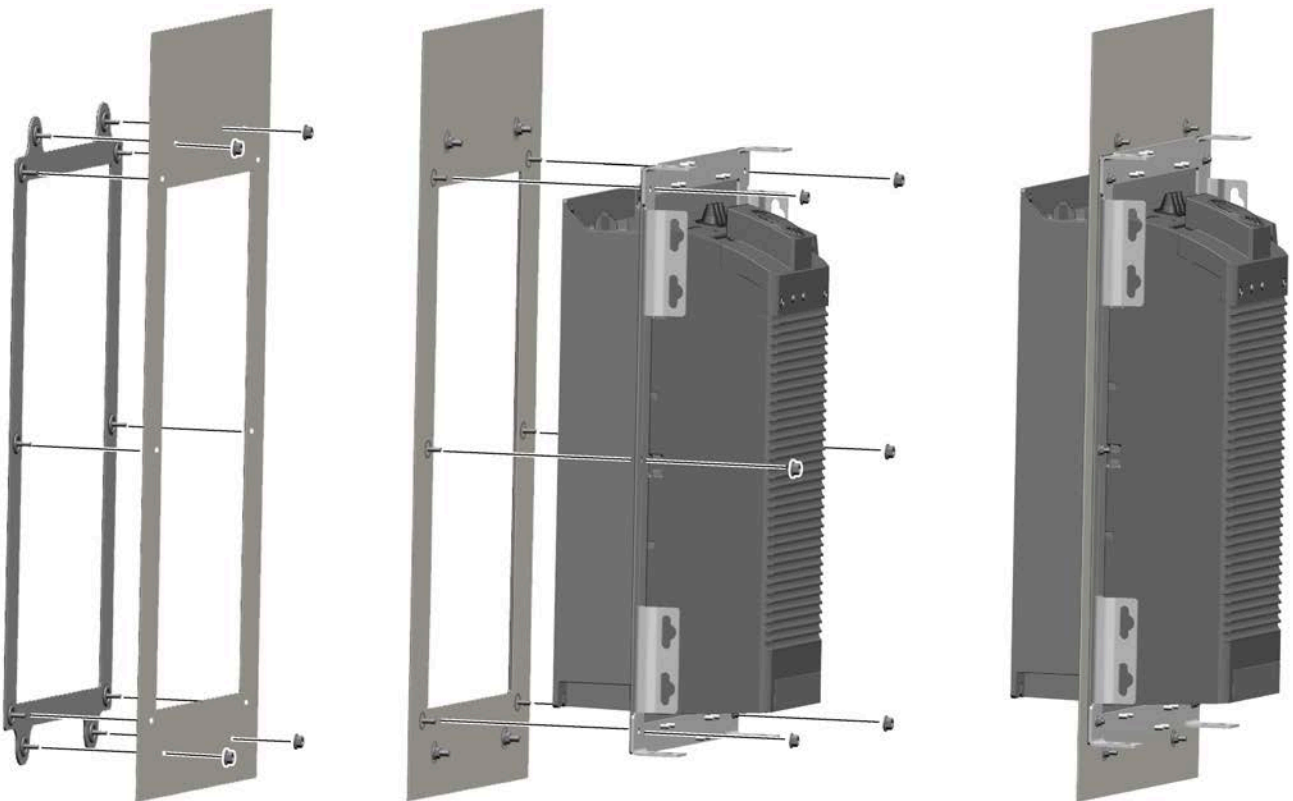



Figure 8-1 Installation instructions for the PT Power Modules with the optional mounting frame

## 8.3 Mounting grips for PT Power Modules

Mounting grips can be ordered for the PT Power Modules FSD ... FSF. The mounting grips enable the installation of the Power Module without hoisting gear.

Install the four hoisting grips as shown in the following image.

Article number: 6SL3200-0SM22-0AA0

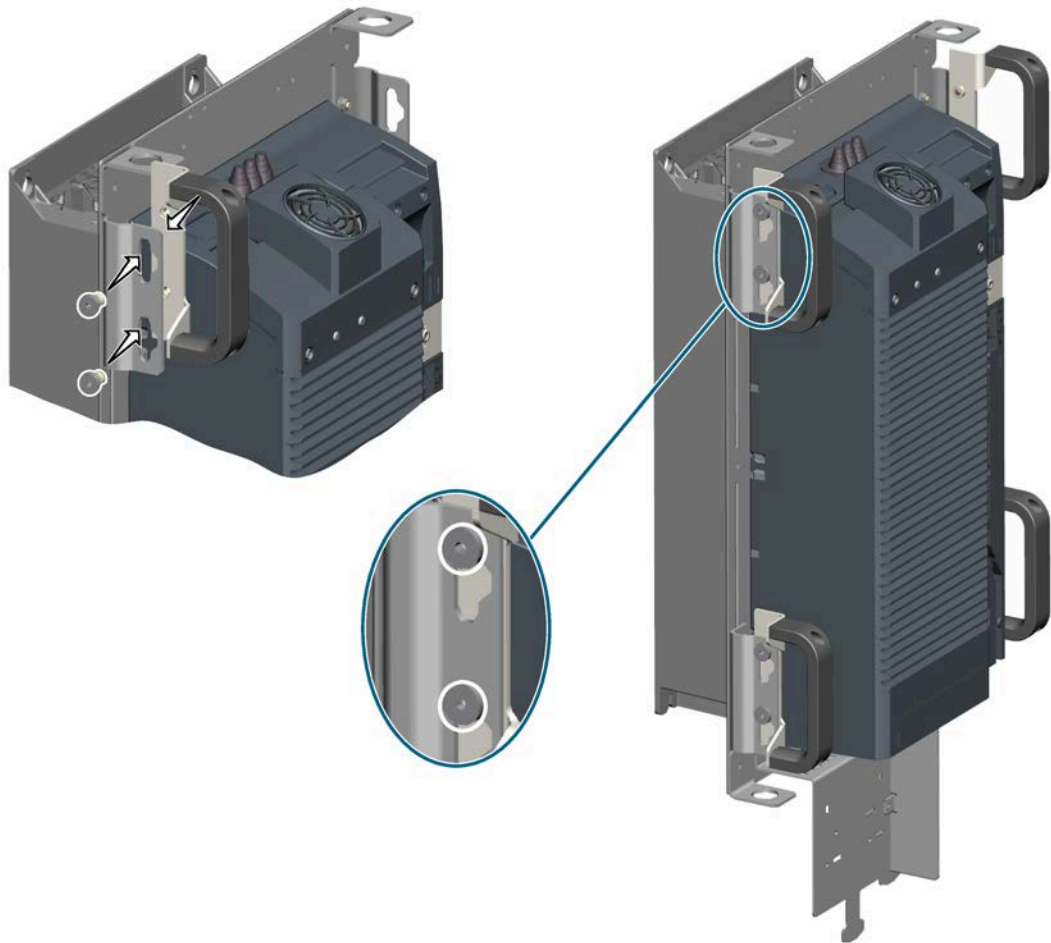


## 8.4 Control Unit Adapter Kit CUA20


The Control Unit Adapter Kit CUA20 is applicable to PM240-2 of all the frame sizes.

**Article number:** 6SL3255-0BW01-0NA0

### Scope of delivery

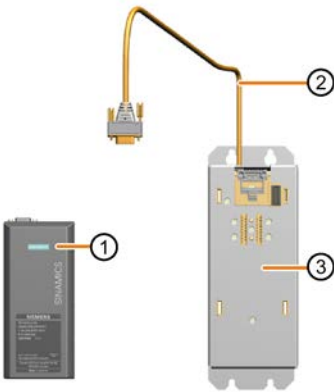	①	Adapter for the Power Module
	②	Connecting cable (1.5 m)
	③	Adapter for the Control Unit
	Mounting screws are not included in the scope of delivery.	

### Dimensions and drill patterns (mm)

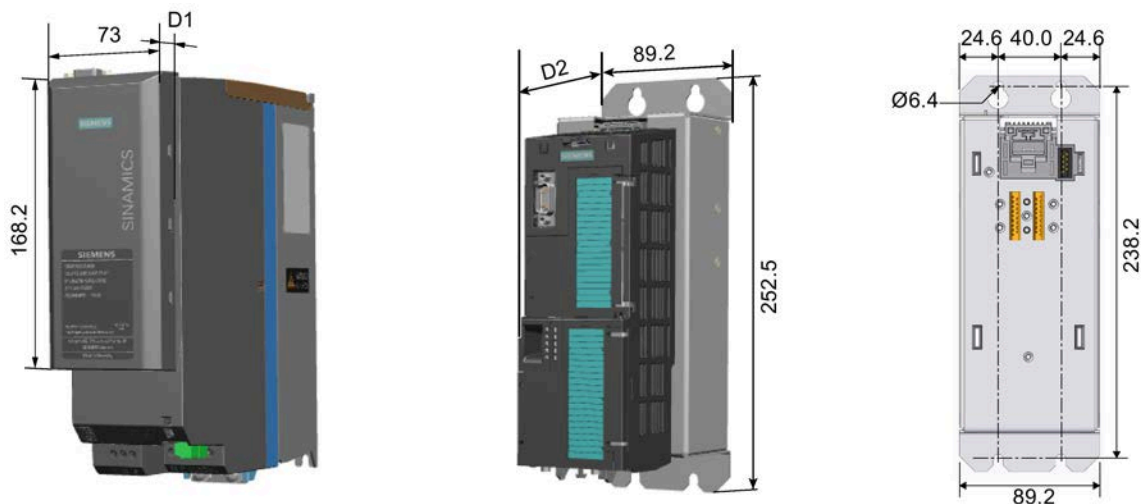


D1 <sup>1)</sup>		D2		
FSA...FSC	FSD...FSG	CU230P-2 <sup>2)</sup>	CU240E-2 <sup>2)</sup>	CU250S-2 <sup>2)</sup>
29	/	117.8	100.3	121.1

<sup>1)</sup> Additional depth after installation

<sup>2)</sup> Additional depth: with blanking cover or Operator Panel (11 mm); with SINAMICS G120 Smart Access (9 mm).

## Installing

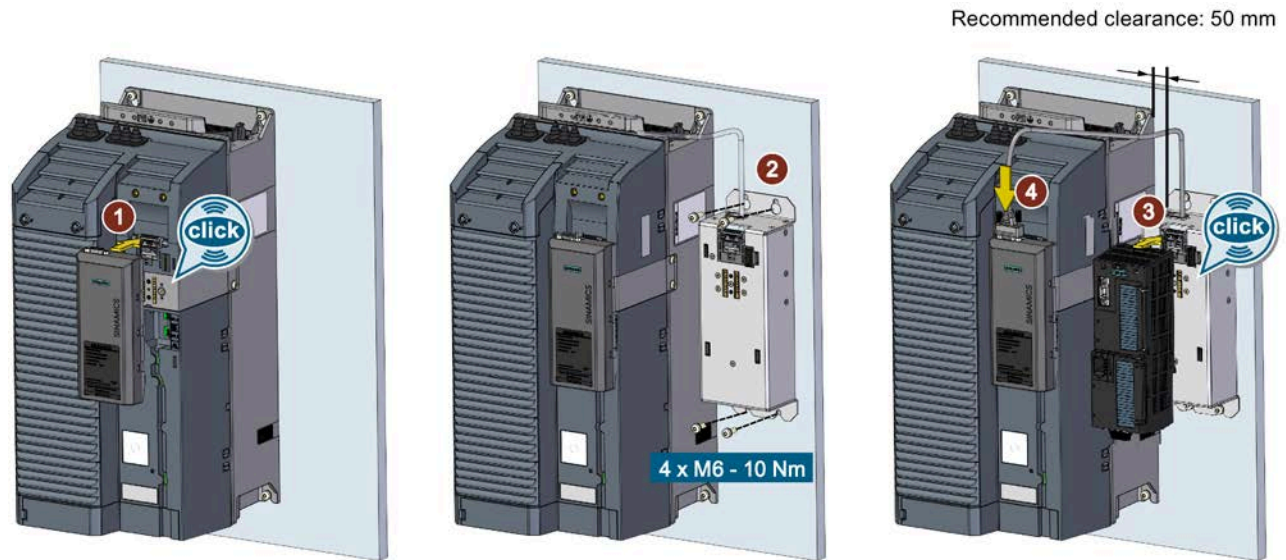**Note**

It is recommended to install the adapter for the Control Unit on the right or left of the Power Module.

**Note**

After you finish the installation, properly tie up the excessive part of the connecting cable.

**Note**

The shield of the STO/safety signal cables should still be connected to the shield plate of the Control Unit when using the Control Unit Adapter Kit CUA20.

## Technical specifications

Net weight	1032.8 g
Operating temperature	- 20 °C ... 60 °C
Shock and vibration	<ul style="list-style-type: none"> <li>• Transportation: 1M2 according to EN 60721-3-2</li> <li>• Operation: 3M1 according to EN 60721-3-3</li> </ul>
Protection against chemical substances	2C2 according to EN 60721-3-2
Standards and directives	CE, UL, TUV, EAC, RCM

## 8.5 Line filter

### Dimensions for mounting the line filter

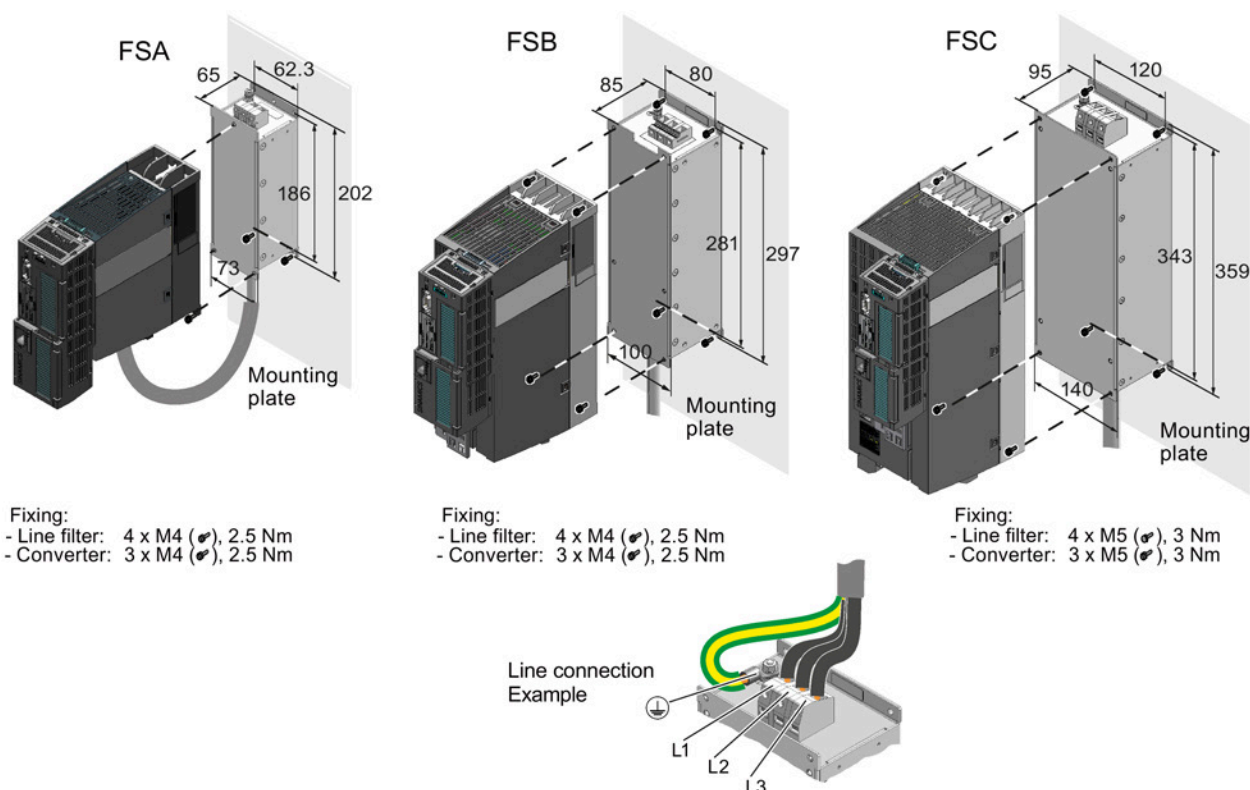


Table 8- 1 Technical data of the line filter (Class B regarding conducted emissions)

Article number	Power loss [W]	Connection		Weight [kg]
		Line supply and Power Module	PE	
6SL3203-0BE17-7BA0	13	2.5 mm <sup>2</sup> / 0.8 Nm 14 AWG / 7 lbf in	2.5 mm <sup>2</sup> / 2 Nm 14 AWG / 17.7 lbf in	1.75
6SL3203-0BE21-8BA0	22	6 mm <sup>2</sup> / 1.8 Nm 10 AWG / 15.9 lbf in	2.5 mm <sup>2</sup> / 2 Nm 14 AWG / 17.7 lbf in	4.0
6SL3203-0BE23-8BA0	50	16 mm <sup>2</sup> / 4 Nm 6 AWG / 35.4 lbf in	16 mm <sup>2</sup> / 32 Nm 6 AWG / 26.5 lbf in	7.3

Line filters are designed to IP20 degree of protection.

## 8.6 Line harmonics filter

Table 8- 2 Assignment table

Power Module, 400 V			Line filter (Class B regarding conducted emissions)
Frame size	Article number	Power	Article number
FSA	6SL3210-1PE11-8UL1	0.55	6SL3203-0BE17-7BA0
	6SL3210-1PE12-3UL1	0.75	
	6SL3210-1PE13-2UL1	1.1	
	6SL3210-1PE14-3UL1	1.5	
	6SL3210-1PE16-1UL1	2.2	
	6SL3210-1PE18-0UL1	3.0	
FSB	6SL3210-1PE21-1UL0	4.0	6SL3203-0BE21-8BA0
	6SL3210-1PE21-4UL0	5.5	
	6SL3210-1PE21-8UL0	7.5	
FSC	6SL3210-1PE22-7UL0	11	6SL3203-0BE23-8BA0
	6SL3210-1PE23-3UL0	15	

## 8.6 Line harmonics filter

The line harmonics filters reshape the distorted current back to the desired sinusoidal waveform.

With the line harmonics filters the converter fulfills the IEEE 519 standards.

For technical details refer to the following link:



Line harmonics filters

(<https://www.schaffner.com/products/download/product/datasheet/fn-3440-ecosine-50hz-passive-harmonic-filters/>)

### Note

If you use a line harmonics filter the permissible line voltage is 380 V ... 415 V 3 AC  $\pm 10\%$  instead of 380 V ... 480 V 3 AC  $\pm 10\%$  without a line harmonics filter.

## Assignment tables

Power Module, 400 V			Line harmonics filter
Frame size	Article number	Power [kW]	Article number
FSB	6SL3210-1PE21-4 . L0	5.5	UAC:FN34406112E2XXJRX
	6SL321 . -1PE21-8 . L0	7.5	UAC:FN34408112E2XXJRX
FSC	6SL3210-1PE22-7 . L0	11	UAC:FN344011113E2FAJRX
	6SL321 . -1PE23-3 . L0	15	UAC:FN344015113E2FAJRX
FSD	6SL3210-1PE23-8 . L0	18.5	UAC:FN344019113E2FAJRX
	6SL3210-1PE24-5 . L0	22	UAC:FN344022115E2FAJRX
	6SL3210-1PE26-0 . L0	30	UAC:FN344030115E2FAJRX
	6SL321 . -1PE27-5 . L0	37	UAC:FN344037115E2FAJRX
FSE	6SL3210-1PE28-8 . L0	45	UAC:FN344045115E2FAJRX
	6SL321 . -1PE31-1 . L0	55	UAC:FN344055115E2FAJRX
FSF	6SL3210-1PE31-5 . L0	75	UAC:FN344075116E2FAJRX
	6SL3210-1PE31-8 . L0	90	UAC:FN344090116E2FAJRX
	6SL3210-1PE32-1 . L0	110	UAC:FN3440110118E2FAJRX
	6SL321 . -1PE32-5 . L0	132	UAC:FN3440132118E2FAJXX
FSG	6SL3210-1PE33-0 . L0	160	UAC:FN3440160118E2FAJXX
	6SL3210-1PE33-7 . L0	200	UAC:FN3440200118E2FAJXX
	6SL3210-1PE34-8 . L0	250	UAC:FN3440132118E2FAJXX <sup>*)</sup>

<sup>\*)</sup> Two 132 kW filters in parallel are required.

If the expected input power exceeds the rating of the largest available filter, and a custom solution is not desired, then two or more filters can be wired in parallel. In this mode of operation, it is recommended to use filters with equal power ratings to ensure proper current sharing.

**NOTICE****Line harmonic filters for Power Modules with 160 kW, 200 kW and 250 kW**

The following combinations must not be used with u/f control.

- Power Module 160 kW with LHF: UAC:FN3440160118E2FAJXX
- Power Module 200 kW with LHF: UAC:FN3440200118E2FAJXX
- Power Module 250 kW with 2 LHF in parallel: UAC:FN3440132118E2FAJXX

When you use one of this combinations only the following settings of p1300 are allowed:


- P1300 = 20,
- P1300 = 21
- P1300 = 22
- P1300 = 23

### Clearances to other devices


Line harmonics filters are best installed as close as possible to the non-linear load. Ideally they are mounted next to the converter inside the electrical cabinet.

In order to ensure sufficient air flow, keep a clearance of minimum 150 mm above and below the filter to walls or other components.

It must be ensured that the environmental temperature is kept below 45 °C with appropriate thermal management (e.g. cabinet cooling). Filter operation in environments with higher temperatures require a temperature derating.

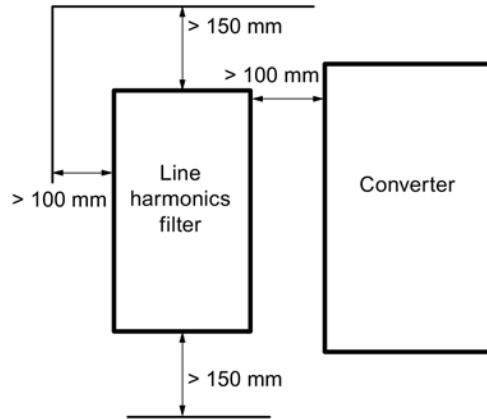

## Dimensions, drilling patterns, and technical data

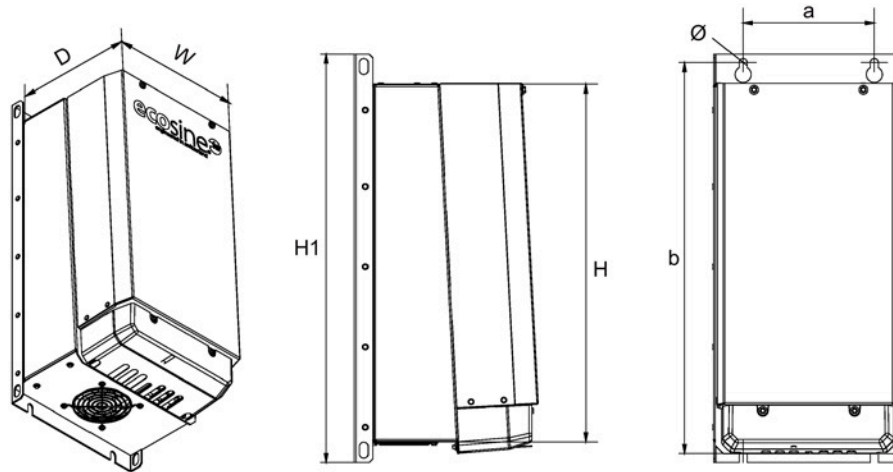


Article number	Weight [kg]	Dimensions [mm]				Drilling patterns [mm]			Power connections		
		D	W	H	H1	a	b	Ø	[mm² / Nm]	[AWG / lbf.in]	PE / torque [Nm]
UAC:FN34406112E2XXJRX UAC:FN34408112E2XXJRX	19 23	221	210	430	483	150	460	7	0.4 ... 6 / 1.2	10 ... 22 / 10.6	M6 / 8
UAC:FN344011113E2FAJRX UAC:FN344015113E2FAJRX UAC:FN344019113E2FAJRX	32 36 37	252	260	491	560	180	540	11	0.75 ... 16 / 3	6 ... 18 / 26.6	M8 / 14
UAC:FN344022115E2FAJRX UAC:FN344030115E2FAJRX UAC:FN344037115E2FAJRX UAC:FN344045115E2FAJRX UAC:FN344055115E2FAJRX	53 55 66 73 75	319	290	635	705	220	680	11	10 ... 50 / 8	1/0 ... 8 / 70.8	M8 / 14
UAC:FN344075116E2FAJRX UAC:FN344090116E2FAJRX	126 147	386	353	863	960	280	920	11	10 ... 95 / 8	3/0 ... 8 / 70.8	M10 / 25
UAC:FN3440110118E2FAJRX UAC:FN3440132118E2FAJXX UAC:FN3440160118E2FAJXX UAC:FN3440200118E2FAJXX	175 194 219 267	456	462	1053	1150	390	1115	11	95 ... 240 / 10	3/0 ... 500 kcmil / 88.5	M10 / 25

## 8.7 Line reactor

A line reactor protects the converter when connected to dirty line supplies (line supply environment). A line reactor supports the overvoltage protection, smooths the harmonics in the line supply and buffers commutation dips.

### Mounting position

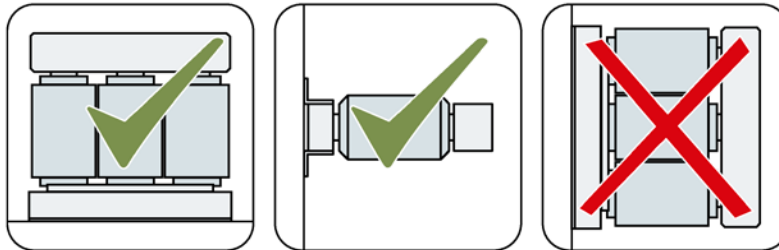

### Clearances to other devices

Keep shaded areas free of any devices and components.

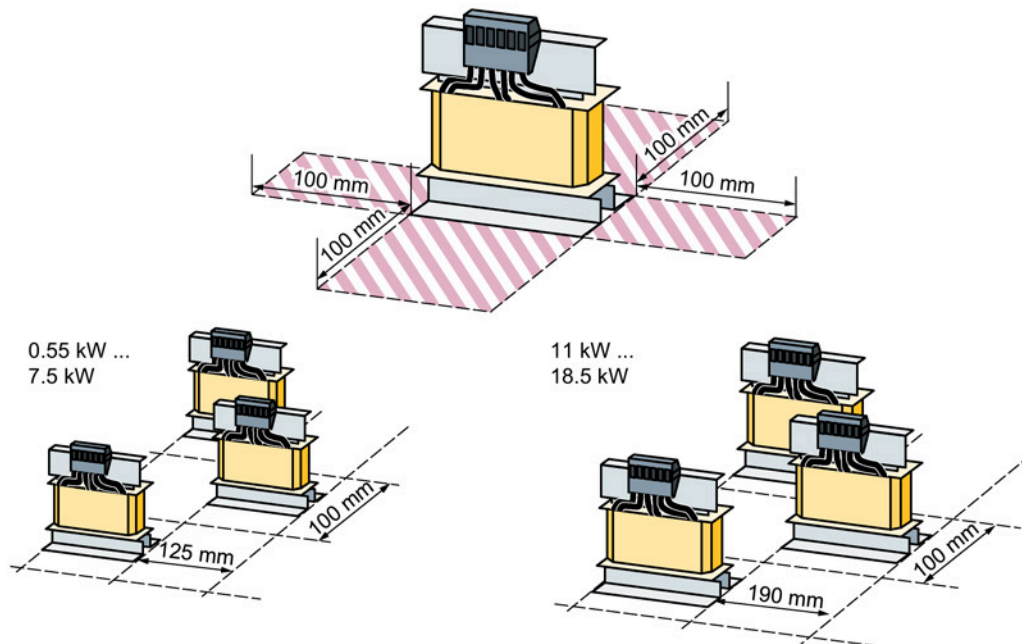



Figure 8-2 Clearances between the line reactors and other devices, examples for space-saving installation

## Dimensions [mm] and drilling patterns

<b>Article number</b> 6SL3203-0CE13-2AA0	
<b>Article number</b> 6SL3203-0CE21-0AA0	
<b>Article number</b> 6SL3203-0CE21-8AA0	
<b>Article number</b> 6SL3203-0CE23-8AA0	

Mount the line reactor using M5 screws, nuts and washers. Tightening torque: 6 Nm

Assignment of line reactor to converter:

 Table 8-4 Assignment table (Page 132)

## 8.7 Line reactor

Table 8- 3 Technical data of the line reactors

Article number	Inductance [mH]	Line/load connection		PE connection	Weight [kg]
		[mm <sup>2</sup> / nM]	[AWG / lbf in]	[mm <sup>2</sup> / lbf in]	
6SL3203-0CE13-2AA0	2.5	2.5 / 0.8	14 / 7	M4 [3 / 26.5]	1.1
6SL3203-0CE21-0AA0	1	6 / 1.8	10 / 15.9	M4 [3 / 26.5]	2.1
6SL3203-0CE21-8AA0	0.5	6 / 1.8	10 / 15.9	M5 [5 / 44.3]	2.95
6SL3203-0CE23-8AA0	0.3	16 / 4	6 / 34.5	M5 [5 / 44.3]	7.80

The line reactors are designed to IP20 degree of protection.

Table 8- 4 Assignment table

Line reactors	Power Module, 400 V		Power Module, 200 V	
6SL3203-0CE13-2AA0	6SL3210-1PE11-8 .L1 6SL3210-1PE12-3 .L1 6SL3210-1PE13-2 .L1	FSA	/	/
6SL3203-0CE21-0AA0	6SL3210-1PE14-3 .L1 6SL321 .-1PE16-1 .L1 6SL321 .-1PE18-0 .L1	FSA	6SL3210-1PB13-0 .L0 6SL321 .-1PB13-8 .L0	FSA
6SL3203-0CE21-8AA0	6SL3210-1PE21-1 .L0 6SL3210-1PE21-4 .L0 6SL321 .-1PE21-8 .L0	FSB	6SL3210-1PB15-5 .L0 6SL3210-1PB17-4 .L0 6SL321 .-1PB21-0 .L0	FSB
6SL3203-0CE23-8AA0	6SL3210-1PE22-7 .L0 6SL321 .-1PE23-3 .L0	FSC	6SL3210-1PB21-4 .L0 6SL321 .-1PB21-8 .L0 6SL321 .-1PC22-2 .L0 6SL321 .-1PC22-8 .L0	FSC

## Line reactors for 1 AC 200 V

For converters with 1 AC 200 V connection, rather than the line reactors listed above, you can also deploy the following or similar products:

- FSA:  
NKE 10 / 2.93 (Block company)
- FSB  
NKE 25 / 1.17 (Block company)
- FSC  
NKE 35 / 1.46 (Block company)

The technical properties and statements made by the manufacturer apply.

## 8.8 Braking resistor

The braking resistor enables loads with a large moment of inertia to be braked quickly. During braking of the motor and the load, excess energy is fed back to the converter. This causes the voltage to rise in the DC link. The converter transfers the excess energy to the externally mounted braking resistor.




### **! WARNING**

#### **Fire caused by an unsuitable or incorrectly installed braking resistor**

Using an unsuitable or improperly installed braking resistor can cause fires and smoke to develop. Fire and smoke development can cause severe personal injury or material damage.

- Only use braking resistors that are approved for the converter.
- Install the braking resistor in accordance with regulations.
- Monitor the temperature of the braking resistor.

### Mounting position

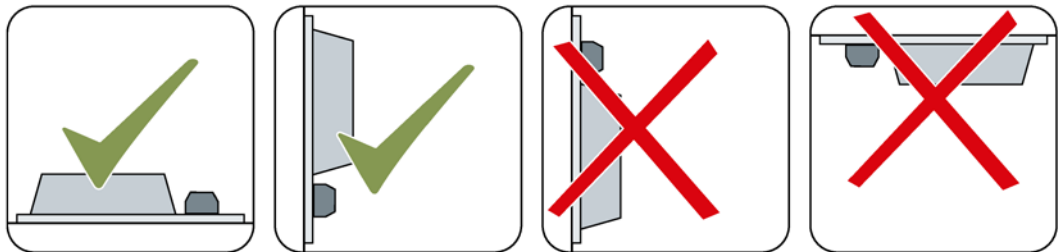

### Mounting instructions

Mount the resistor on a heat resistant surface with a high thermal conductivity.

Do not cover the ventilation openings of the braking resistor.

You can mount the braking resistor either outside or inside the switchgear room. When mounted outside, the cooling air requirement for the switchgear room is lower.

### Clearances to other devices

The following data are applicable for devices, frame sizes FSA ... FSC.

The clearances for braking resistors for devices, frame sizes FSD ... FSG are specified in the documentation, which is supplied with the braking resistor.


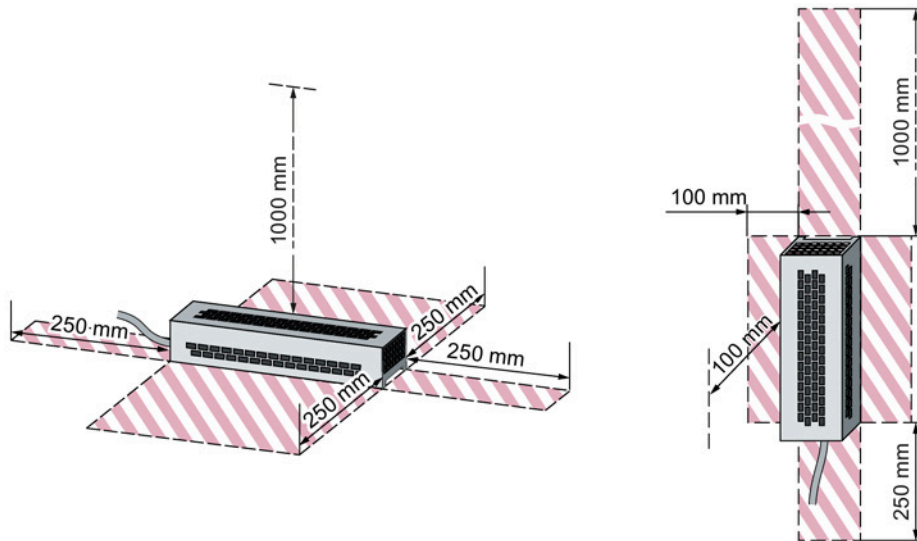


Figure 8-3 Minimum clearances for the braking resistor when mounting on a flat surface and for wall/panel mounting

Keep shaded areas free of any devices and components.

## Dimensions and drilling patterns

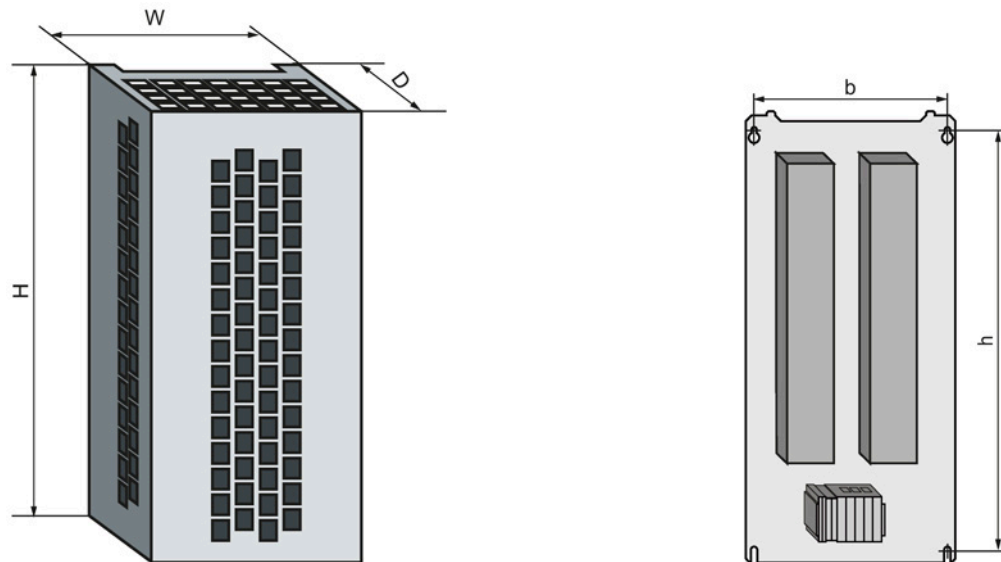

Article number	Overall dimensions [mm]			Drilling dimensions [mm]		Fixing/torque	Converter frame size
	W	H	D	b	h		
for 200 V converters							
JJY:023146720008	30	167	60	72	150	M4 / 3 Nm	FSA
JJY:023151720007	30	217	60	72	200	M4 / 3 Nm	FSB
JJY:023163720018	30	337	60	142	320	M4 / 3 Nm	FSC
JJY:023433720001	30	337	120	217	325	M5 / 6 Nm	FSC
JJY:023422620002	220	470	180	187	430	M5 / 6 Nm	FSD
JJY:023423320001	220	560	180	187	500	M5 / 6 Nm	FSE
JJY:023434020003	350	630	180	317	570	M5 / 6 Nm	FSF
for 400 V converters							
6SL3201-0BE14-3AA0	105	295	100	72	266	M4 / 3 Nm	FSA
6SL3201-0BE21-0AA0	105	345	100	72	316	M4 / 3 Nm	FSA
6SL3201-0BE21-8AA0	175	345	100	142	316	M4 / 3 Nm	FSB
6SL3201-0BE23-8AA0	250	490	140	217	460	M5 / 6 Nm	FSC
JJY:023422620001	220	470	180	187	430	M5 / 6 Nm	FSD
JJY:023424020001	220	610	180	187	570	M5 / 6 Nm	FSD
JJY:023434020001	350	630	180	317	570	M5 / 6 Nm	FSE
JJY:023454020001*)							FSF
• JJY:023422620001	220	470	180	187	430	M5 / 6 Nm	(FSD)
• JJY:023434020001	350	630	180	317	570	M5 / 6 Nm	(FSE)
JJY:023464020001*)							FSF
• JJY:023434020001	350	630	180	317	570	M5 / 6 Nm	(FSE)
• JJY:023434020001	350	630	180	317	570	M5 / 6 Nm	(FSE)
for 690 V converters							
JJY:023424020002	220	610	180	187	570	M5 / 6 Nm	FSD
JJY:023434020002	350	630	180	317	570	M5 / 6 Nm	FSE
JJY:023464020002*)							FSF
• JJY:023434020002	350	630	180	317	570	M5 / 6 Nm	(FSE)
• JJY:023434020002	350	630	180	317	570	M5 / 6 Nm	(FSE)

Use the screws, nuts and washers when fixing the braking resistors

\*) This braking resistor comprises two components, which must be connected in parallel on the plant/system side

### 8.8.1 Connecting a braking resistor

Some braking resistors have an integrated connection cable for the power connections (R1/R2) on the converter. Thus, the length and cross-section of the connection cable are given.

For braking resistors without integrated connection cable, the maximum cable length is 10 m. The required conductor cross-sections are contained in the following tables.

The conductor cross-sections for the temperature monitoring are contained in the Operating Instructions of the Control Unit of your converter.

#### Monitoring the temperature of the braking resistor without line contactor control

The braking contactors for FSA ... FSF converters are intrinsically safe braking resistors and shut down in the event of overheating.

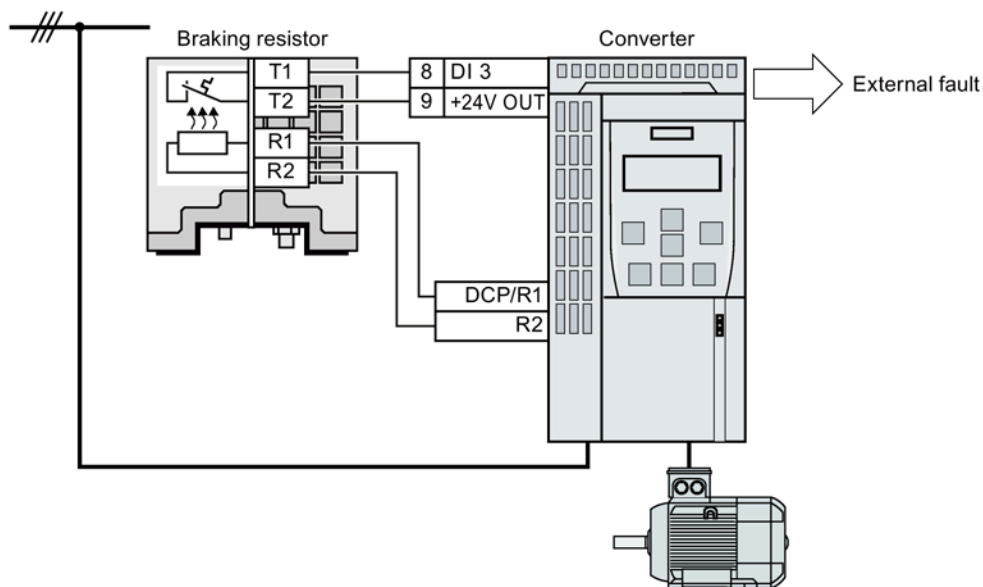


Figure 8-4 Connecting a braking resistor with temperature monitoring via digital input DI 3

#### Procedure



Proceed as follows to monitor the braking resistor temperature:

1. Connect the temperature monitoring system of the braking resistor (terminals T1 and T2 on the braking resistor) to a free digital input at the Control Unit of the converter.
2. When commissioning the drive, define the function of the digital input used as external fault, using p2106.

As an example with temperature monitoring via digital input DI 3: p2106 = 722.3.



You have ensured that the temperature is monitored.

## Monitoring the temperature of the braking resistor with line contactor control

With respect to FSG converters, you not only have to monitor the temperature of the braking resistor but also have to ensure that the converter is disconnected from the line in the event of a braking resistor overload. To do so, activate the line contactor control via a digital output of the converter.

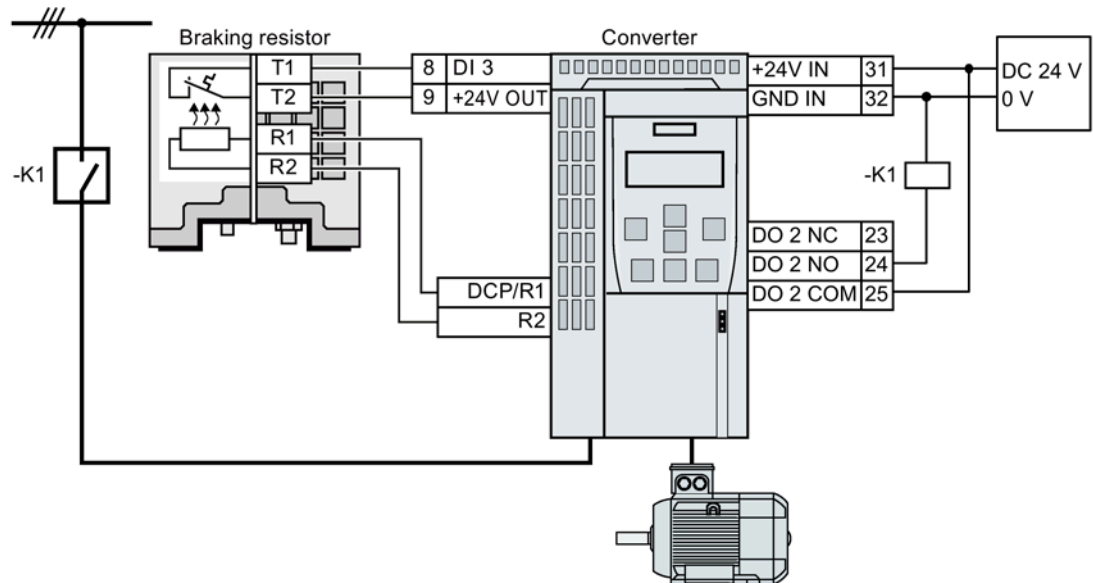


Figure 8-5 Connecting a braking resistor with temperature monitoring via digital input DI 3 and line contactor control (-K1) via digital output DO 2

### Procedure



1. Proceed as follows to monitor the braking resistor temperature and activate the line contactor control:

1. Connect the temperature monitoring system of the braking resistor (terminals T1 and T2 on the braking resistor) to a free digital input at the Control Unit of the converter.
2. When commissioning the drive, define the function of the digital input used as external fault, using p2106.

As an example with temperature monitoring via digital input DI 3: p2106 = 722.3.

3. Connect the digital output with the signal r0863.1 (line contactor control). For example for DO2 P0732 = 863.1



You have set the temperature monitoring and line contactor control.

### 8.8.2 Technical data of the braking resistor

For the converters, use the following or comparable braking resistors. The technical properties and statements made by the manufacturer apply.


#### Note

#### Braking resistors FSD ... FSF

Only use braking resistors that are UL approved, and have successfully passed the "Abnormal Operation Test" according to UL 508.

#### FSG braking resistors

Make sure that the monitoring system for braking resistor temperature shuts down the converter in the event of any overload.

Example:  Figure 8-5 Connecting a braking resistor with temperature monitoring via digital input DI 3 and line contactor control (-K1) via digital output DO 2 (Page 137)

### Braking resistors for PM240-2, 200 V

Table 8- 5 Technical data

Article number	Re- sistance	Maximum power, $P_{max}$	Connection R1 / R2	Degree of protection	Power Module	
		Rated power $P_{db}$		Weight	Article numbers	Frame size
JJY:023146720008	200 $\Omega$	0.75 kW 37.5 W	Connecting cable integrated in the braking resistor	IP20 0.5 kg	6SL3210-1PB13-0 . L0 6SL321 . -1PB13-8 . L0	FSA
JJY:023151720007	68 $\Omega$	2.2 kW 110 W		IP20 0.7 kg	6SL3210-1PB15-5 . L0 6SL3210-1PB17-4 . L0 6SL321 . -1PB21-0 . L0	FSB
JJY:02 3163720018	37 $\Omega$	4 kW 200 W		IP20 1.1 kg	6SL3210-1PB21-4 . L0 6SL321 . -1PB21-8 . L0	FSC
JJY:023433720001	20 $\Omega$	7.5 kW 375 W		IP20 2 kg	6SL3210-1PC22-2 . L0 6SL3210-1PC22-8 . L0	FSC
JJY:023422620002	7.5 $\Omega$	18.5 kW 930 W	10 mm <sup>2</sup> / 0.5 Nm 8 AWG / 4.5 lbf in	IP21 7.0 kg	6SL3210-1PC24-2UL0 6SL3210-1PC25-4UL0 6SL321 . -1PC26-8UL0	FSD
JJY:023423320001	4.5 $\Omega$	30 kW 1500 W	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 10.6 lbf in	IP21 8.5 kg	6SL3210-1PC28-0UL0 6SL321 . -1PC31-1UL0	FSE
JJY:023434020003	2.5 $\Omega$	55 kW 2750 W	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 10.6 lbf in	IP21 13.5 kg	6SL3210-1PC31-3UL0 6SL3210-1PC31-6UL0 6SL321 . -1PC31-8UL0	FSF

## Braking resistors for PM240-2, 400 V

Table 8- 6 Technical data

Article number	Re- sistance	Maximum power, $P_{max}$	Connection R1 / R2	Degree of protection	Power Module	
		Rated power $P_{db}$		Weight	Article numbers	Frame size
6SL3201-0BE14-3AA0	370 $\Omega$	1.5 kW	2.5 mm <sup>2</sup> / 0.5 Nm 14 AWG / 4.5 lbf in	IP20	6SL3210-1PE11-8 . L1 6SL3210-1PE12-3 . L1 6SL3210-1PE13-2 . L1 6SL3210-1PE14-3 . L1	FSA
		75 W		1.5 kg		
6SL3201-0BE21-0AA0	140 $\Omega$	4 kW	2.5 mm <sup>2</sup> / 0.5 Nm 14 AWG / 4.5 lbf in	IP20	6SL321 . -1PE16-1 . L1 6SL321 . -1PE18-0 . L1	FSA
		200 W		1.8 kg		
6SL3201-0BE21-8AA0	75 $\Omega$	7.5 kW	4 mm <sup>2</sup> / 0.5 Nm 12 AWG / 4.5 lbf in	IP20	6SL3210-1PE21-1 . L0 6SL3210-1PE21-4 . L0 6SL321 . -1PE21-8 . L0	FSB
		375 W		2.7 kg		
6SL3201-0BE23-8AA0	30 $\Omega$	18.5 kW	6 mm <sup>2</sup> / 0.8 Nm 10 AWG / 7.1 lbf in	IP20	6SL3210-1PE22-7 . L0 6SL321 . -1PE23-3 . L0	FSC
		925 W		6.2 kg		
JJY:023422620001	25 $\Omega$	22 kW	10 mm <sup>2</sup> / 0.8 Nm 8 AWG / 7.1 lbf in	IP21	6SL3210-1PE23-8 . L0 6SL3210-1PE24-5 . L0	FSD
		1100 W		7.0 kg		
JJY:023424020001	15 $\Omega$	37 kW	10 mm <sup>2</sup> / 0.8 Nm 8 AWG / 7.1 lbf in	IP21	6SL3210-1PE26-0 . L0 6SL321 . -1PE27-5 . L0	FSD
		1850 W		9.5 kg		
JJY:023434020001	10 $\Omega$	55 kW	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 4.5 lbf in	IP21	6SL3210-1PE28-8 . L0 6SL321 . -1PE31-1 . L0	FSE
		2750 W		13.5 kg		
JJY:023454020001 (JJY:023422620001    JJY:023434020001)	7.1 $\Omega$	77 kW	10 mm <sup>2</sup> / 0.8 Nm 8 AWG / 7.1 lbf in 16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 4.5 lbf in	IP21	6SL3210-1PE31-5 . L0 6SL3210-1PE31-8 . L0	FSF
		3850 W		20.5 kg		
JJY:023464020001 (JJY:023434020001    JJY:023434020001)	5 $\Omega$	110 kW	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 4.5 lbf in 16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 4.5 lbf in	IP21	6SL3210-1PE32-1 . L0 6SL321 . -1PE32-5 . L0	FSF
		5500 W		27 kg		
6SL3000-1BE32-5AA0	2.2 $\Omega$	250 kW	70 mm <sup>2</sup> / M10	IP00	6SL3210-1PE33-0 . L0 6SL3210-1PE33-7 . L0 6SL3210-1PE34-8 . L0	FSG
		12.5 kW		120 kg		

## Braking resistors for PM240-2, 690 V

Table 8- 7 Technical data

Article number	Re- sistance	Maximum power, $P_{max}$	Connection R1 / R2	Degree of protection	Power Module	
		Rated power $P_{db}$		Weight	Article Nos.	Frame size
JJY:023424020002	31 $\Omega$	37 kW	10 mm <sup>2</sup> / 0.8 Nm 8 AWG / 7.1 lbf in	IP21	6SL3210-1PH21-4 . L0 6SL3210-1PH22-0 . L0 6SL3210-1PH22-3 . L0 6SL3210-1PH22-7 . L0 6SL3210-1PH23-5 . L0 6SL321 . -1PH24-2 . L0	FSD
		1850 W		9.5 kg		
JJY:023434020002	21 $\Omega$	55 kW	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 4.5 lbf in	IP21	6SL3210-1PH25-2 . L0 6SL321 . -1PH26-2 . L0	FSE
		2750 W		13.5 kg		
JJY:023464020002 (JJY:023434020002    JJY:023434020002)	10.5 $\Omega$	110 kW	16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 10.6 lbf in 16 mm <sup>2</sup> / 1.2 Nm 6 AWG / 10.6 lbf in	IP21	6SL3210-1PH28-0 . L0 6SL3210-1PH31-0 . L0 6SL3210-1PH31-2 . L0 6SL3210-1PH31-4 . L0	FSF
		5500 W		27 kg		
6SL3000-1BH32-5AA0	4.9 $\Omega$	250 kW	70 mm <sup>2</sup> / M10	IP00	6SL3210-1PH31-7CL0 6SL3210-1PH32-1CL0 6SL3210-1PH32-5CL0	FSG
		12.5 kW		120 kg		

## Load cycles for the braking resistors

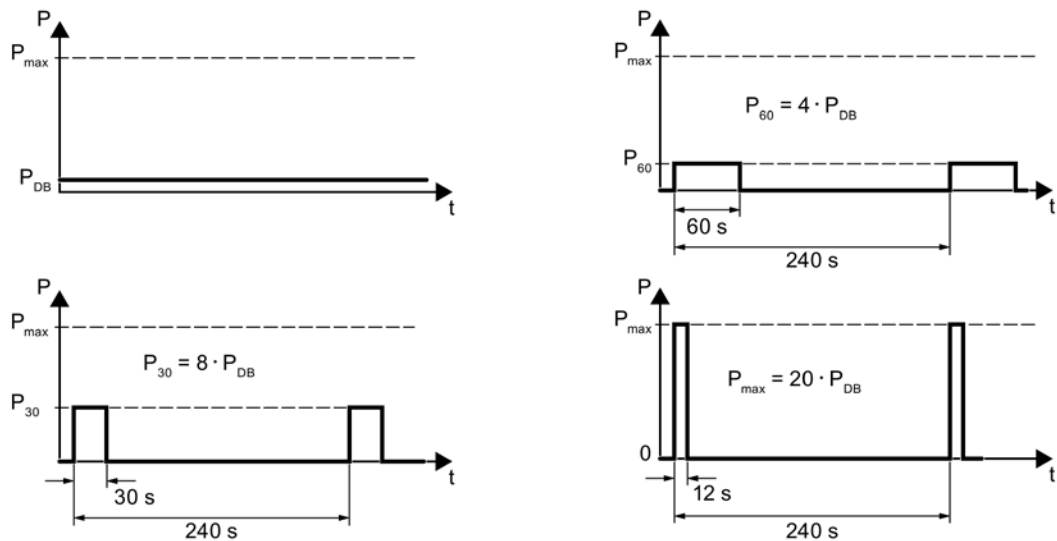


Figure 8-6 Pulse power, rated power and examples of the switch-on duration of the braking resistor

## 8.9 Braking relay

The converter uses the Brake Relay to control the motor holding brake. Two types of Brake Relay exist:

- The Brake Relay controls the motor holding brake
- The Safe Brake Relay controls a 24 V motor holding brake and monitors the brake control for short-circuit or cable breakage.

---

### Note

#### Brake Relay and Safe Brake Relay

There are no differences between the Brake Relay and the Safe Brake Relay in terms of installation and connection to the converter.

#### Connection to the converter

To ensure that you have the correct cable for connecting the Brake Relay irrespective of the converter size, you are supplied with two preassembled cables with different lengths. Connect the appropriate cable to the Brake Module and to the converter as shown below.

If you are using your own cable, ensure that the cable is insulated and rated for 600 V.

#### Connecting the motor holding brake via a PELV circuit

The Brake Relay must be connected to the protective conductor if the motor brake is supplied from a PELV circuit.

---



---

### Note

The Brake Relays are not limited regarding switching cycles.

---




### 8.9.1 Technical data of the brake relay

	Brake Relay 6SL3252-0BB00-0AA0	Safe Brake Relay 6SL3252-0BB01-0AA0
Input voltage	via the Power Module	20.4 ... 28.8 VDC <sup>1)</sup>
Input current	via the Power Module	Max. 2.5 A
Max. connection cross-section:	2.5 mm <sup>2</sup>	2.5 mm <sup>2</sup>
Degree of protection	IP20	IP20
Switching capability of the NO contact	1-phase 440 VAC, 3.5 A 1-phase 30 VDC, 12 A	-
Output voltage	-	24 V
Output current	-	max. 2 A



<sup>1)</sup> External, controlled power supply required. Recommended voltage: 26 VDC

## 8.9.2 Connections and circuit diagrams

## Brake Relay

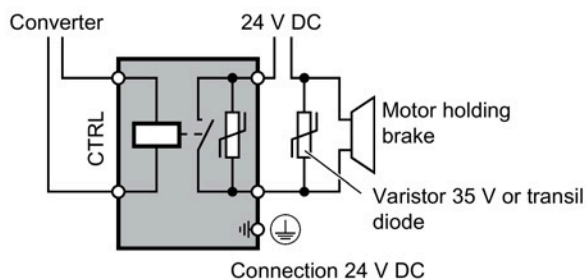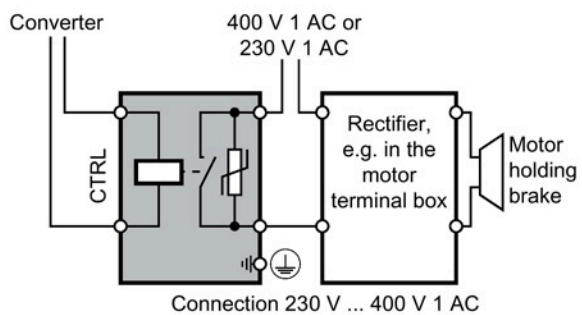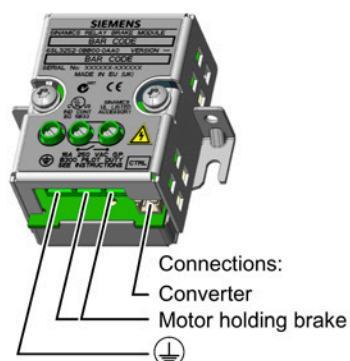

## Safe Brake Relay

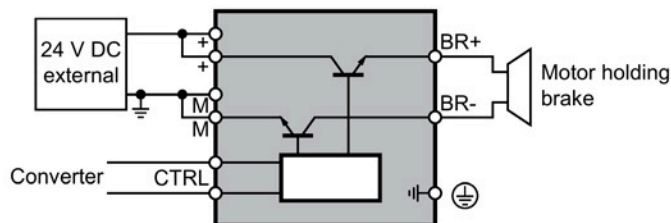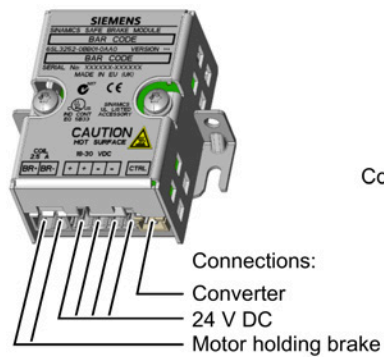

### 8.9.3 Mounting and connecting the brake relay

#### Installing the Brake Relay


- **FSA ... FSC:** Install the Brake Relay next to the Power Module.
- **FSD ... FSG:** Install the Brake Relay at the rear of the lower shield plate. Attach the Brake Relay before you install the shield plate.




Mounting the shield plates (Page 36)

#### Connecting the Brake Relay to the converter

The connector for the Brake Relay is located at the front of the Power Module. Lay the cable harness for the Brake Relay in the cable routing.

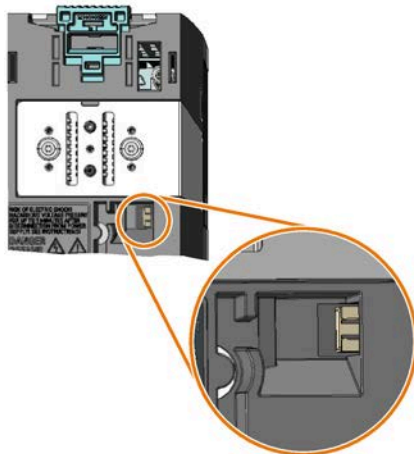

Brake relay connector for FSA ... FSC Power Modules without STO terminals

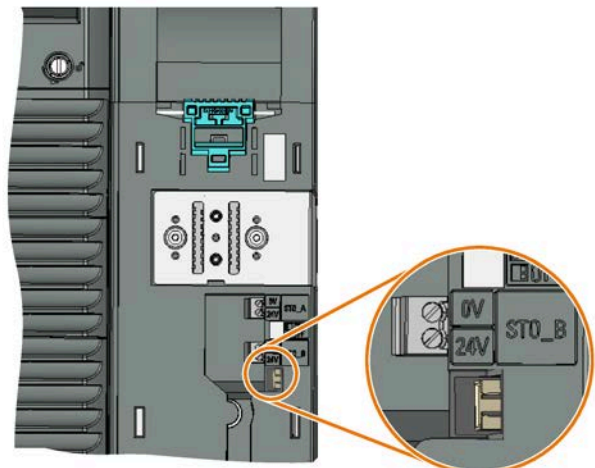

Brake relay connector for FSD ... FSG Power Modules with STO terminals

## 8.10 Output reactor

Output reactors reduce the voltage stress on the motor windings and the load placed on the converter as a result of capacitive recharging currents in the cables.

When using a output reactor, observe the following restrictions:

- The output frequency must not exceed 150 Hz.
- The pulse frequency must not exceed 4 kHz.

### NOTICE

#### Damage to the output reactor by exceeding the maximum pulse frequency

The maximum permissible pulse frequency when using the output reactor is 4 kHz. The output reactor can be damaged if the pulse frequency is exceeded.

- When using an output reactor, the pulse frequency of the Power Module must not be higher than 4 kHz.


### NOTICE

#### Damage to the output reactor if it is not activated during commissioning

The output reactor may be damaged if it is not activated during commissioning.


- Activate the output reactor during commissioning via the parameter specified by the converter manufacturer.
- Activate the output reactor during commissioning according to the electric specifications.

### Mounting position

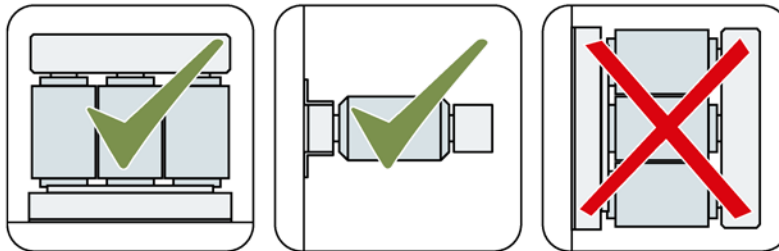

### Clearances to other devices

Keep shaded areas free of any devices and components.

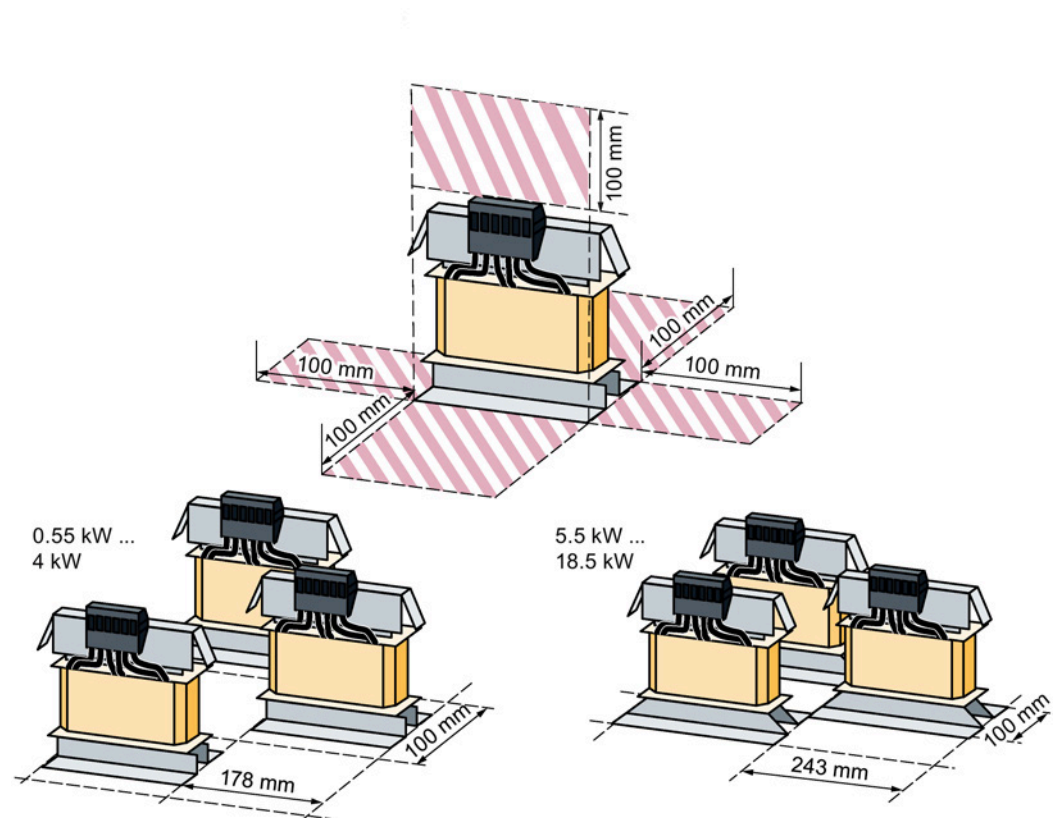

Minimum clearances of the output reactor to other devices, space-saving mounting examples

## Dimensions, drilling patterns and weights for FSA ... FSC converters

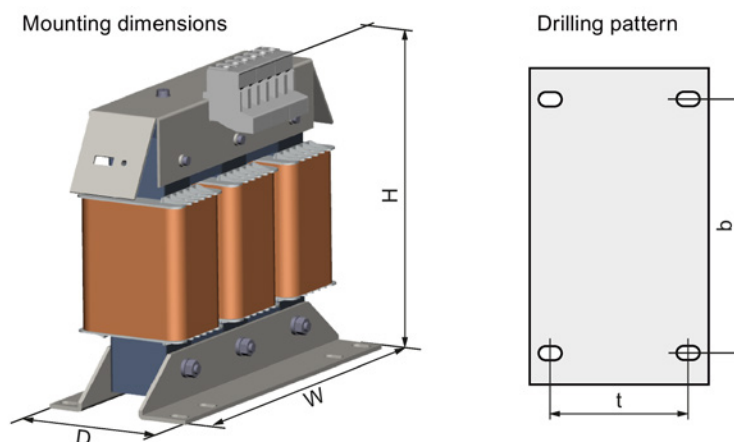


Table 8- 8 Dimensions and weights

Article number	Inductance [mH]	Overall dimensions [mm]			Drilling dimensions [mm]		Fixing/torque [Nm]	Weight [kg]
		W	H	D	b	t		
6SL3202-0AE16-1CA0	2.5	207	166	73	166	57	4 x M4 / 3	3.4
6SL3202-0AE18-8CA0	1.3	207	166	73	166	57	4 x M4 / 3	3.9
6SL3202-0AE21-8CA0	0.54	247	211	100	225	81	4 x M5 / 6	10.1
6SL3202-0AE23-8CA0	0.26	257	228	115	225	85	4 x M5 / 6	11.2

Output reactors are designed to IP20 degree of protection.

Table 8- 9 Connections to the Power Module and to the motor

Article number	Connection	
	Motor Module and motor	PE
6SL3202-0AE16-1CA0 6SL3202-0AE18-8CA0	Screw terminals 4 mm <sup>2</sup> ; 0.6 ... 0.8 Nm	Threaded bolt M4 / 3 Nm
6SL3202-0AE21-8CA0	Screw terminals 10 mm <sup>2</sup> ; 1.5 ... 1.8 Nm	Threaded bolt M5 / 5 Nm
6SL3202-0AE23-8CA0	Screw terminals 16 mm <sup>2</sup> ; 2 ... 4 Nm	Threaded bolt M5 / 5 Nm

## Assignment tables

Table 8- 10 Assignment table for 200 V Power Modules

Power Module			Output reactor
Frame size	Article number	Power [kW]	Article number
FSA	6SL3210-1PB13-0 . L0	0.55	6SL3202-0AE16-1CA0
FSA	6SL321 . -1PB13-8 . L0	0.75	
FSB	6SL3210-1PB15-5 . L0	1.1	
FSB	6SL3210-1PB17-4 . L0	1.5	6SL3202-0AE18-8CA0
FSB	6SL321 . -1PB21-0 . L0	2.2	6SL3202-0AE21-8CA0
FSC	6SL3210-1PB21-4 . L0	3	
FSC	6SL321 . -1PB21-8 . L0	4	
FSC	6SL321 . -1PC22-2 . L0	5.5	6SL3202-0AE23-8CA0
FSC	6SL3210-1PC22-8 . L0	7.5	

Table 8- 11 Assignment table for 400 V Power Modules

Power Module			Output reactor
Frame size	Article number	Power [kW]	Article number
FSA	6SL3210-1PE11-8 . L1	0.55	6SL3202-0AE16-1CA0
FSA	6SL3210-1PE12-3 . L1	0.75	
FSA	6SL3210-1PE13-2 . L1	1.1	
FSA	6SL3210-1PE14-3 . L1	1.5	
FSA	6SL3210-1PE16-1 . L1	2.2	
FSA	6SL321 . -1PE18-0 . L1	3	6SL3202-0AE18-8CA0
FSB	6SL3210-1PE21-1 . L0	4	6SL3202-0AE21-8CA0
FSB	6SL3210-1PE21-4 . L0	5.5	
FSB	6SL321 . -1PE21-8 . L0	7.5	
FSC	6SL3210-1PE22-7 . L0	11	6SL3202-0AE23-8CA0
FSC	6SL321 . -1PE23-3 . L0	15	

## Dimensions, drilling patterns and weights for FSD ... FSG converters

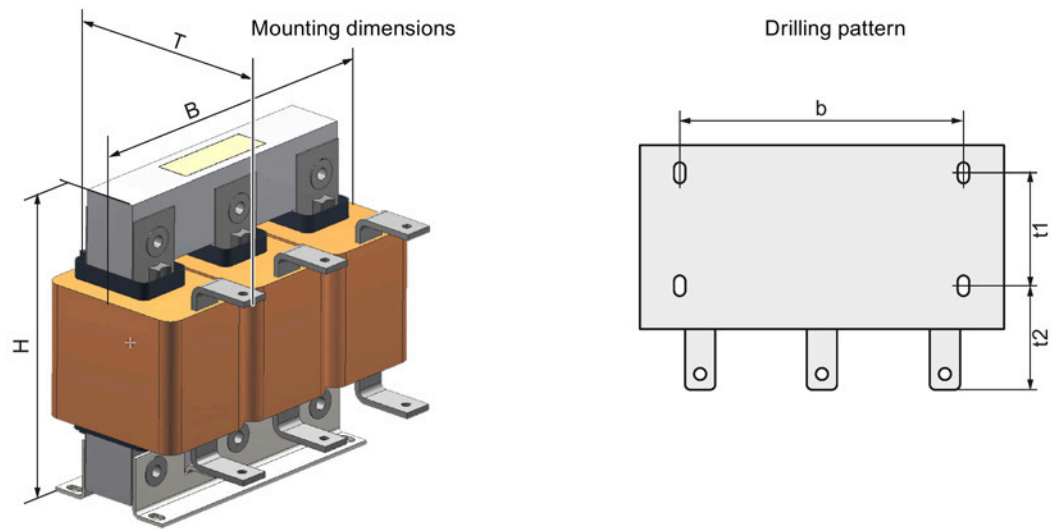


Figure 8-7 Dimensions and drilling patterns

Table 8- 12 Dimensions and weights

Article number	Inductance [mH]	Overall dimensions [mm]			Drilling dimensions [mm]			Fixing/torque [Nm]	Weight [kg]
		W	H	D	b	t1	t2		
6SE6400-3TC07-5ED0	/	270	248	209	200	102	91.5	4 x M8 / 25	26.5
6SE6400-3TC14-5FD0	/	350	321	288	264	140	134	4 x M8 / 25	57
6SL3000-2BE32-1AA0	/	300	285	257	224	165	78	4 x M8 / 25	60
6SL3000-2BE32-6AA0	/	300	315	277	224	185	78	4 x M8 / 25	66
6SL3000-2BE33-2AA0	/	300	285	277	224	183	79	4 x M8 / 25	66
6SL3000-2BE33-8AA0	/	300	285	277	224	183	79	4 x M8 / 25	73
6SL3000-2BE35-0AA0	/	300	365	277	224	183	79	4 x M8 / 25	100
JTA:TEU2532-0FP00-4EA0	1.5	264	255	131	249	101	/	4 x M6 / 10	18
JTA:TEU 9932-0FP00-4EA0	1.2	264	270	159	129	129	/	4 x M6 / 10	26
JTA:TEU 9932-0FS00-0EA0	0.9	310	370	182	289	142	/	4 x M8 / 25	42
JTA:TEU 9932-1FC00-1BA0	0.53	400	320	193	379	150	/	4 x M8 / 25	66
JTA:TEU 9932-0FV00-1BA0	0.37	400	355	193	379	150	/	4 x M8 / 25	90
JTA:TEU 4732-0FA00-0BA0	0.22	460	430	251	356	212	/	4 x M12 / 50	162

The output reactors have a protection rating of IP00.

Table 8- 13 Connections to the Power Module and to the motor

Article number	Connection	
	Motor Module and motor	PE
6SE6400-3TC07-5ED0	Cable lug M6 / 6 Nm	Screw M6 / 10 Nm
6SE6400-3TC14-5FD0	Cable lug M8 / 13 Nm	Screw M8 / 25 Nm
6SL3000-2BE32-1AA0	Cable lug M10 / 25 Nm	Screw M8 / 25 Nm
6SL3000-2BE32-6AA0		
6SL3000-2BE33-2AA0	Cable lug M10 / 25 Nm	Screw M8 / 25 Nm
6SL3000-2BE33-8AA0	Cable lug M10 / 50 Nm	Screw M8 / 25 Nm
6SL3000-2BE35-0AA0	Cable lug M12 / 50 Nm	Screw M8 / 25 Nm
JTA:TEU 2532-0FP00-4EA0	Screw terminals 16 mm <sup>2</sup>	Screw terminals 16 mm <sup>2</sup>
JTA:TEU 9932-0FP00-4EA0	Screw terminals 35 mm <sup>2</sup>	Screw terminals 35 mm <sup>2</sup>
JTA:TEU 9932-0FS00-0EA0	Screw terminals 50 mm <sup>2</sup>	Screw terminals 50 mm <sup>2</sup>
JTA:TEU 9932-1FC00-1BA0	Cable lug M8 / 13 Nm	Screw M6 / 10 Nm
JTA:TEU 9932-0FV00-1BA0	Cable lug M10 / 25 Nm	Screw M6 / 10 Nm
JTA:TEU 4732-0FA00-0BA0	Cable lug M10 / 25 Nm	Screw M6 / 10 Nm

## Assignment tables

Table 8- 14 Assignment table for 200 V Power Modules

Power Module			Output reactor
Frame size	Article number	Power [kW]	Article number
FSD	6SL3210-1PC24-2UL0	11	6SE6400-3TC07-5ED0
FSD	6SL3210-1PC25-4UL0	15	
FSD	6SL321 . -1PC26-8UL0	18.5	
FSE	6SL3210-1PC28-0UL0	22	6SE6400-3TC14-5FD0
FSE	6SL321 . -1PC31-1UL0	30	
FSF	6SL3210-1PC31-3UL0	37	
FSF	6SL3210-1PC31-6UL0	45	
FSF	6SL321 . -1PC31-8UL0	55	

Table 8- 15 Assignment table for 400 V Power Modules

Power Module			Output reactor
Frame size	Article number	Power [kW]	Article number
FSD	6SL3210-1PE23-8 . L0	18.5	6SE6400-3TC07-5ED0
FSD	6SL3210-1PE24-5 . L0	22	
FSD	6SL3210-1PE26-0 . L0	30	
FSD	6SL321 . -1PE27-5 . L0	37	
FSE	6SL3210-1PE28-8 . L0	45	6SE6400-3TC14-5FD0
FSE	6SL321 . -1PE31-1 . L0	55	
FSF	6SL3210-1PE31-5 . L0	75	
FSF	6SL3210-1PE31-8 . L0	90	
FSF	6SL3210-1PE32-1 . L0	110	6SL3000-2BE32-1AA0
FSF	6SL321 . -1PE32-5 . L0	132	6SL3000-2BE32-6AA0
FSG	6SL3210-1PE33-0 . L0	160	6SL3000-2BE33-2AA0
FSG	6SL3210-1PE33-7 . L0	200	6SL3000-2BE33-8AA0
FSG	6SL3210-1PE34-8 . L0	250	6SL3000-2BE35-0AA0

Table 8- 16 Assignment table for 690 V Power Modules

Power Module			Output reactor
Frame size	Article number	Power [kW]	Article number
FSD	6SL3210-1PH21-4 . L0	11	JTA:TEU 2532-0FP00-4EA0
	6SL3210-1PH22-0 . L0	15	
	6SL3210-1PH22-3 . L0	18.5	
	6SL3210-1PH22-7 . L0	22	JTA:TEU 9932-0FP00-4EA0
	6SL3210-1PH23-5 . L0	30	
	6SL3210-1PH24-2 . L0	37	
FSE	6SL3210-1PH25-2 . L0	45	JTA:TEU 9932-0FS00-0EA0
	6SL3210-1PH26-2 . L0	55	
FSF	6SL3210-1PH28-0 . L0	75	JTA:TEU 9932-1FC00-1BA0
	6SL3210-1PH31-0 . L0	90	
FSF	6SL3210-1PH31-2 . L0	110	JTA:TEU 9932-0FV00-1BA0
	6SL3210-1PH31-4 . L0	132	
FSG	6SL3210-1PH31-7CL0	160	JTA:TEU 4732-0FA00-0BA0
	6SL3210-1PH32-1CL0	200	
	6SL3210-1PH32-5CL0	250	

## 8.11 Sine-wave filter

The sine-wave filter limits the voltage gradient and the capacitive recharging currents which generally occur in converter operation. Therefore, when a sine-wave filter is used, longer screened motor cables are possible and the motor lifetime reaches the same values which are achieved when the motor is connected directly to the mains.

When using a sine-wave filter, observe the following restrictions:

- Operation is only permissible with pulse frequencies from 4 kHz ... 8 kHz (sine-wave filter from 160kW only 4 kHz).
- It must be ensured that the automatic pulse frequency reductions are deactivated.
- The converter power is reduced by 5%.
- The output frequency must not exceed 150 Hz.
- Operation and commissioning may only be performed with the motor connected because the sine-wave filter is not no-load proof.
- An output reactor is not required.

### NOTICE

#### Damage to the sine-wave filter if it is not activated during commissioning


The sine-wave filter may be damaged if it is not activated during commissioning.

- Activate the sine-wave filter during commissioning via parameter p0230.
- Activate the sine-wave filter during commissioning according to the electric specifications.


## Assignment table

Power Module			Sine-wave filter
Frame size	Article number	Power [kW]	Article number
<b>Power Module, 200 V</b>			
FSD	6SL3210-1PC24-2UL0	11	6SL3202-0AE24-6SA0
	6SL3210-1PC25-4UL0	15	6SL3202-0AE26-2SA0
	6SL321 .-1PC26-8UL0	18.5	6SL3202-0AE28-8SA0
FSE	6SL3210-1PC28-0UL0	22	6SL3202-0AE28-8SA0
	6SL321 .-1PC31-1UL0	30	6SL3202-0AE31-5SA0
FSF	6SL3210-1PC31-3UL0	37	6SL3202-0AE31-5SA0
	6SL3210-1PC31-6UL0	45	6SL3202-0AE31-8SA0
	6SL321 .-1PC31-8UL0	55	6SL3202-0AE31-8SA0
<b>Power Module, 400 V</b>			
FSD	6SL3210-1PE23-8 .L0	18.5	6SL3202-0AE24-6SA0
	6SL3210-1PE24-5 .L0	22	6SL3202-0AE24-6SA0
	6SL3210-1PE26-0 .L0	30	6SL3202-0AE26-2SA0
	6SL321 .-1PE27-5 .L0	37	6SL3202-0AE28-8SA0
FSE	6SL3210-1PE28-8 .L0	45	6SL3202-0AE28-8SA0
	6SL321 .-1PE31-1 .L0	55	6SL3202-0AE31-5SA0
FSF	6SL3210-1PE31-5 .L0	75	6SL3202-0AE31-5SA0
	6SL3210-1PE31-8 .L0	90	6SL3202-0AE31-8SA0
	6SL3210-1PE32-1 .L0	110	6SL3000-2CE32-3AA0
	6SL321 .-1PE32-5 .L0	132	6SL3000-2CE32-3AA0
FSG	6SL3210-1PE33-0 .L0	160	6SL3000-2CE32-8AA0
	6SL3210-1PE33-7 .L0	200	6SL3000-2CE33-3AA0
	6SL3210-1PE34-8 .L0	250	6SL3000-2CE34-1AA0

## Dimensions [mm] and drilling patterns

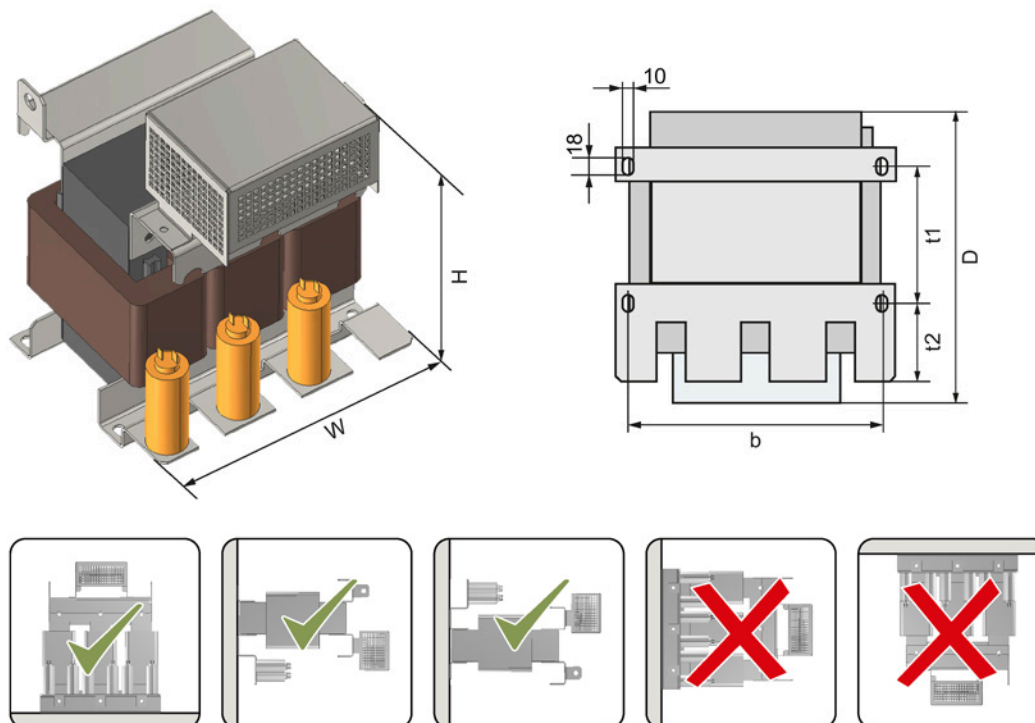

Sine-wave filter	Overall dimensions (mm)			Drilling dimensions (mm)			Fixing/torque (Nm)	Weight (kg)
	W	H	D	b	t1	t2		
6SL3202-0AE24-6SA0	250	305	262	230	127	90.5	4 x M6 / 7	24
6SL3202-0AE26-2SA0	250	315	262	230	127	90.5	4 x M6 / 7	34
6SL3202-0AE28-8SA0	275	368	275	250	132	100.5	4 x M8 / 13	45
6SL3202-0AE31-5SA0	350	440	305	320	156.5	113	4 x M8 / 13	63
6SL3202-0AE31-8SA0	350	468	305	320	156.5	113	4 x M8 / 13	80

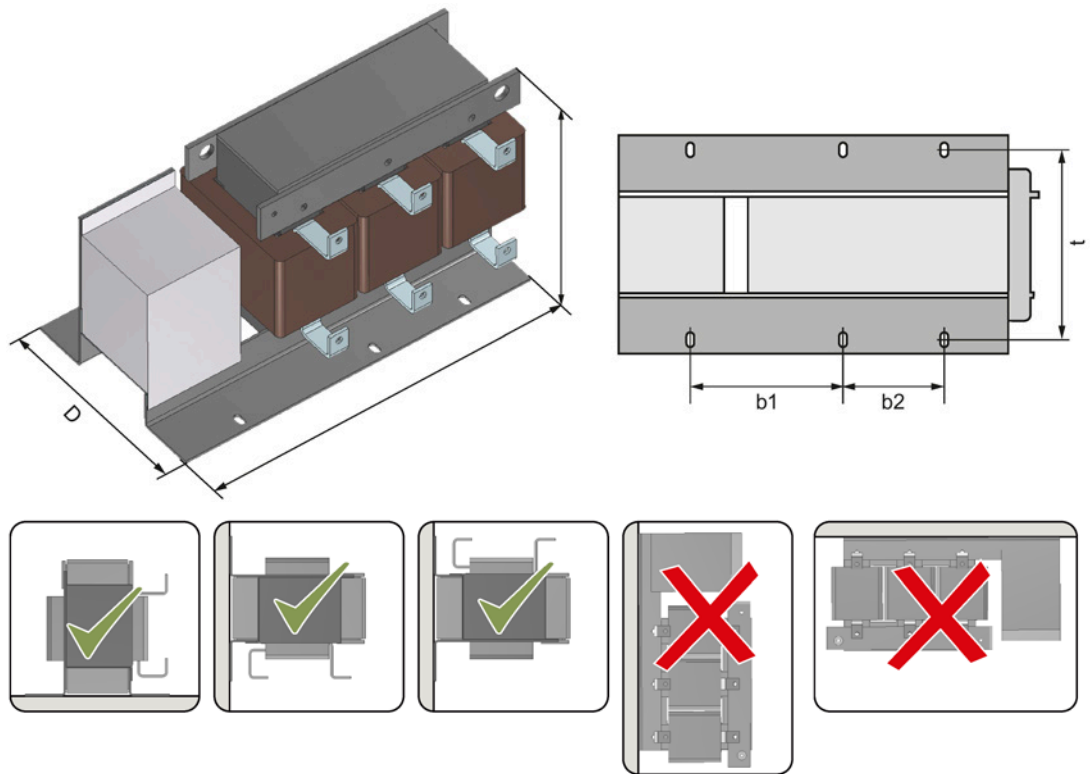

Sine-wave filter	Overall dimensions (mm)			Drilling dimensions (mm)			Fixing/torque (Nm)	Weight (kg)
	W	H	D	b1	b2	t		
6SL3000-2CE32-3AA0	620	300	320	225	150	280	6 x M10 / 20	124
6SL3000-2CE32-8AA0	620	300	320	225	150	280	6 x M10 / 20	127
6SL3000-2CE33-3AA0	620	370	360	225	150	320	6 x M10 / 20	136
6SL3000-2CE34-1AA0	620	370	360	225	150	320	6 x M10 / 20	198

## Technical data

Article number	$P_{\text{loss}}^{1)}$ (W)	Connection		Degree of protection
		Power Module	Motor	
6SL3202-0AE24-6SA0	80	Screw terminals 25 ... 50 mm <sup>2</sup>		IP00
6SL3202-0AE26-2SA0	65	Screw terminals 25 ... 50 mm <sup>2</sup>		IP00
6SL3202-0AE28-8SA0	100	Screw terminals 25 ... 95 mm <sup>2</sup>		IP00
6SL3202-0AE31-5SA0	180	Screw terminals 50 ... 150 mm <sup>2</sup>		IP00
6SL3202-0AE31-8SA0	190	Screw terminals 50 ... 150 mm <sup>2</sup>		IP00
6SL3000-2CE32-3AA0	200	Flat connector for M10 cable lug		IP00
6SL3000-2CE32-8AA0	230	Flat connector for M10 cable lug		IP00
6SL3000-2CE33-3AA0	180	Flat connector for M10 cable lug		IP00
6SL3000-2CE34-1AA0	230	Flat connector for M10 cable lug		IP00


<sup>1)</sup> Power loss at 50 Hz

## 8.12 dv/dt filter plus VPL



A combination of dv/dt filter and a voltage peak limiter (VPL) – dv/dt filter plus VPL – is available to suppress voltage peaks.

When using a dv/dt filter plus VPL, observe the following restrictions:

- The output frequency must not exceed 150 Hz.
- The pulse frequency must not exceed 4 kHz.



Further information is provided on the Internet:

-  Voltage limiter and dv/dt filter ([https://www.mdexx.com/wp-content/uploads/2019/11/BAF-18-001-76\\_Instruction\\_manual.pdf](https://www.mdexx.com/wp-content/uploads/2019/11/BAF-18-001-76_Instruction_manual.pdf))
-  FAQ of dv/dt filter plus VPL (<https://support.industry.siemens.com/cs/ww/en/ps/13224/faq>)

### dv/dt filters plus VPL for PM240-2 Power Modules, 380 V ... 480 V

Power Module		Power	dv/dt filter plus VPL
FSD	6SL3210-1PE23-8 .L0	18.5 kW	JTA:TEF1203-0HB
	6SL3210-1PE24-5 .L0	22 kW, 30 kW	JTA:TEF1203-0JB
	6SL3210-1PE26-0 .L0		
FSD FSE	6SL321 .-1PE27-5 .L0 6SL3210-1PE28-8 .L0	37 kW, 45 kW	JTA:TEF1203-0KB
FSE FSF	6SL321 .-1PE31-1 .L0 6SL3210-1PE31-5 .L0	55 kW, 75 kW	JTA:TEF1203-0LB
FSF	6SL3210-1PE31-8 .L0 6SL3210-1PE32-1 .L0 6SL321 .-1PE32-5 .L0	90 kW ... 132 kW	JTA:TEF1203-0MB

### dv/dt filters plus VPL for PM240-2 Power Modules, 500 V ... 690 V

Power Module		Power	dv/dt filter plus VPL
FSD	6SL3210-1PH21-4 .L0	11 kW ... 18.5 kW	JTA:TEF1203-0GB
	6SL3210-1PH22-0 .L0		
	6SL3210-1PH22-3 .L0		
	6SL3210-1PH22-7 .L0	22 kW ... 37 kW	JTA:TEF1203-0HB
	6SL3210-1PH23-5 .L0		
	6SL3210-1PH24-2 .L0		
FSE	6SL3210-1PH25-2 .L0 6SL3210-1PH26-2 .L0	45 kW, 55 kW	JTA:TEF1203-0JB
FSF	6SL3210-1PH28-0 .L0	75 kW, 90 kW	JTA:TEF1203-0KB
	6SL3210-1PH31-0 .L0		
	6SL3210-1PH31-2 .L0 6SL3210-1PH31-4 .L0	110 kW, 132 kW	JTA:TEF1203-0LB
FSG	6SL3210-1PH31-7CLO 6SL3210-1PH32-1CLO 6SL3210-1PH32-5CLO	160 kW ... 250 kW	JTA:TEF1203-0MB

## Dimensions

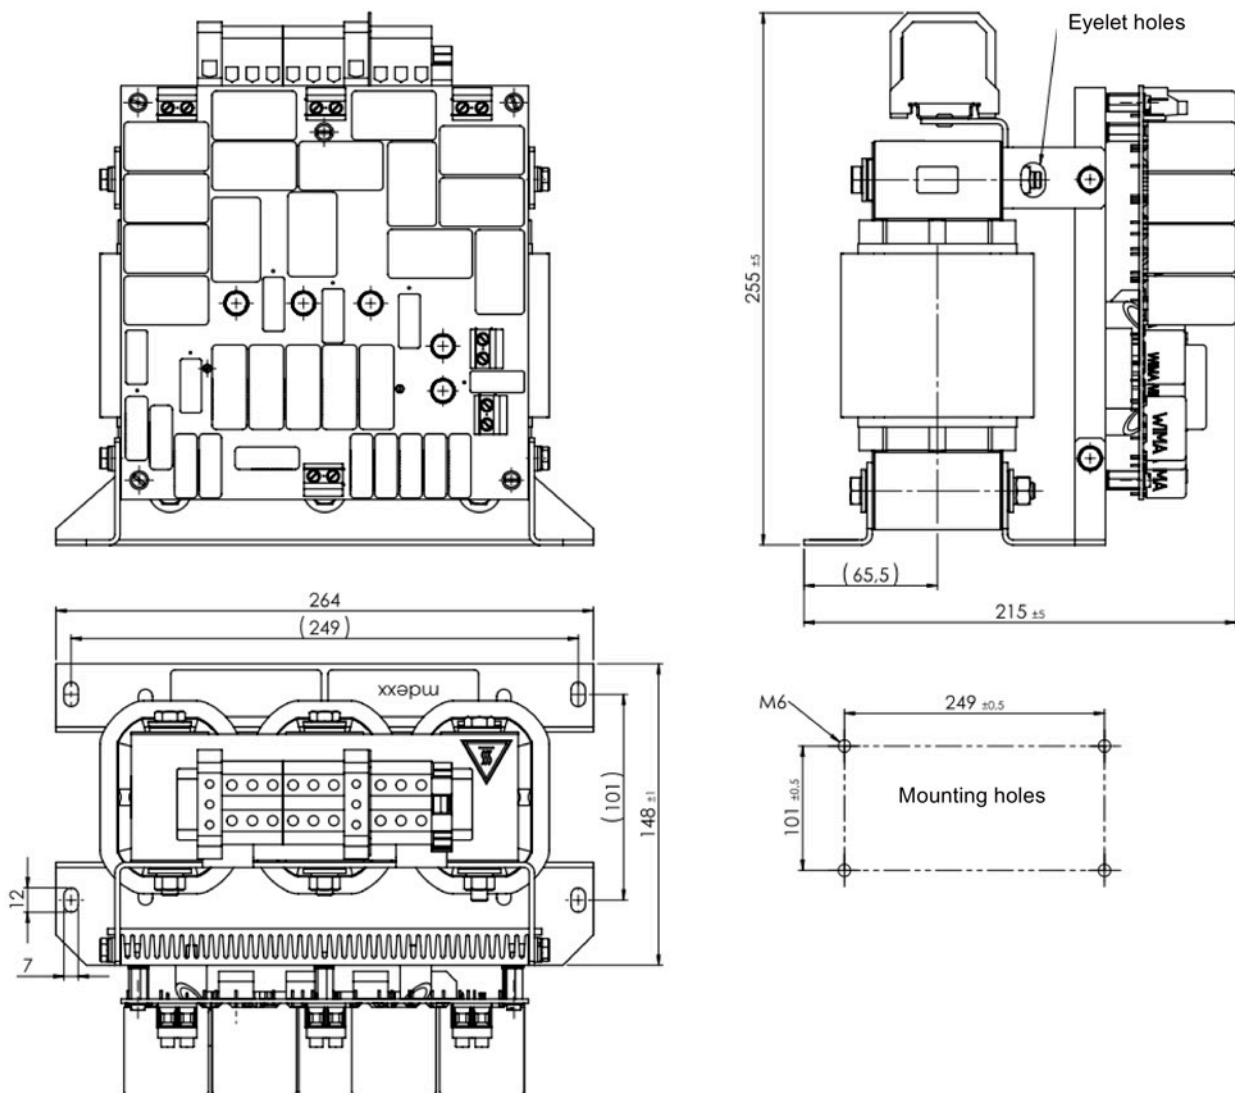


Figure 8-8 Dimensions for JTA:TEF1203-0GB

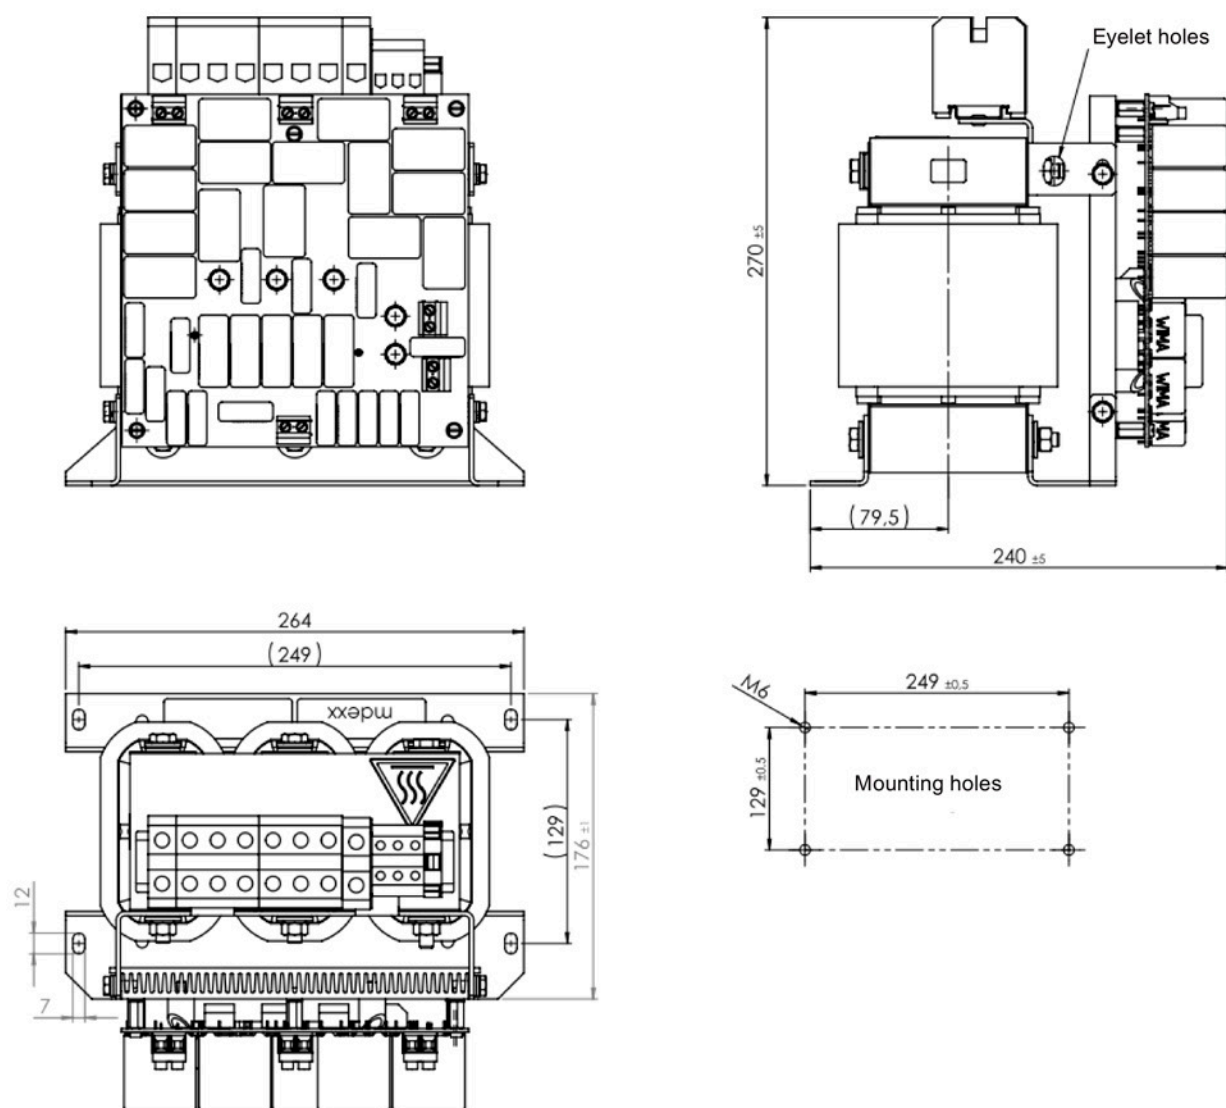


Figure 8-9 Dimensions for JTA:TEF1203-0HB

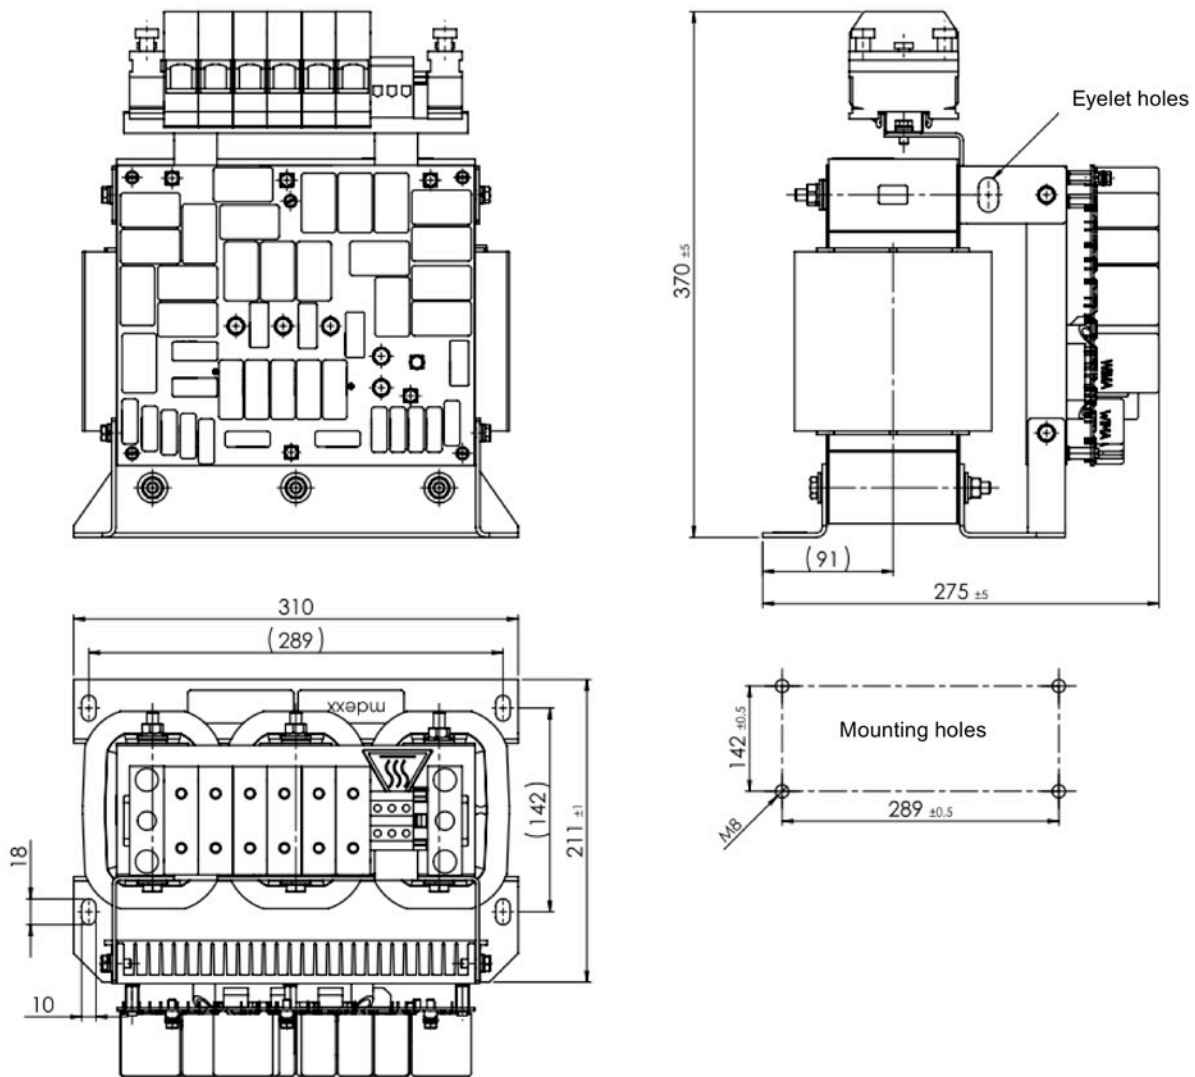


Figure 8-10 Dimensions for JTA:TEF1203-0JB

Eyelet holes

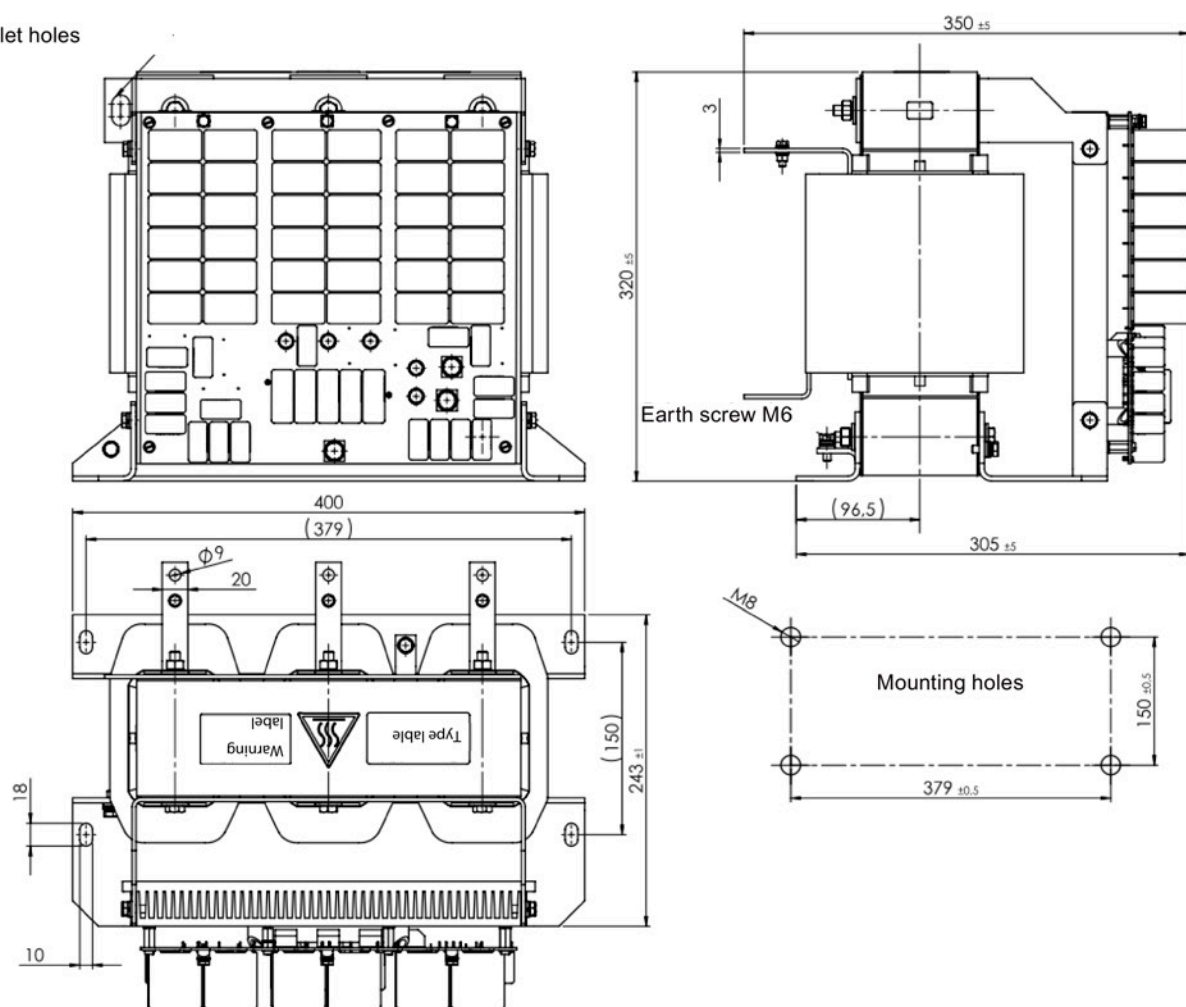


Figure 8-11 Dimensions for JTA:TEF1203-0KB

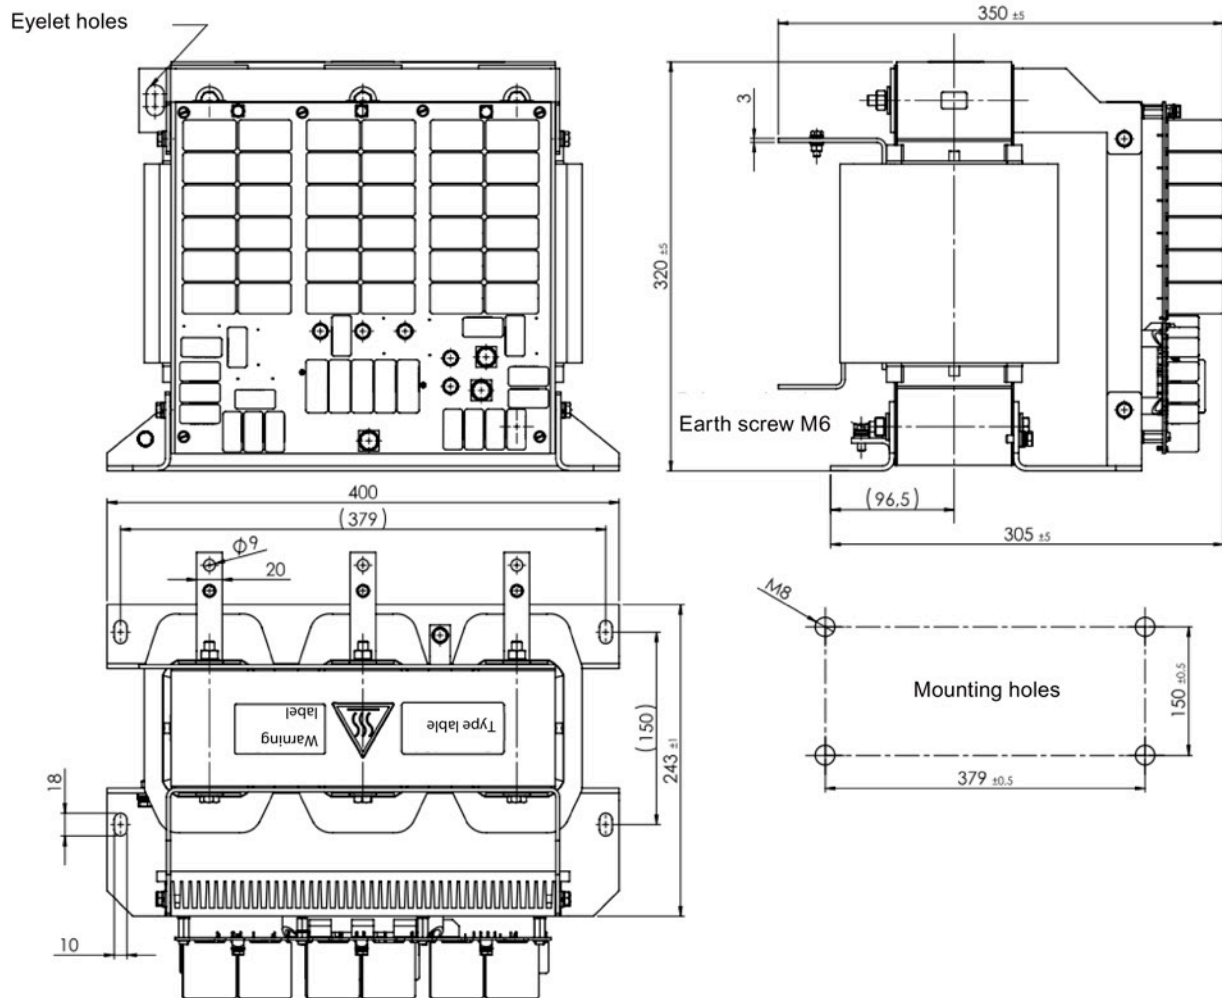


Figure 8-12 Dimensions for JTA:TEF1203-0LB

## 8.12 dv/dt filter plus VPL

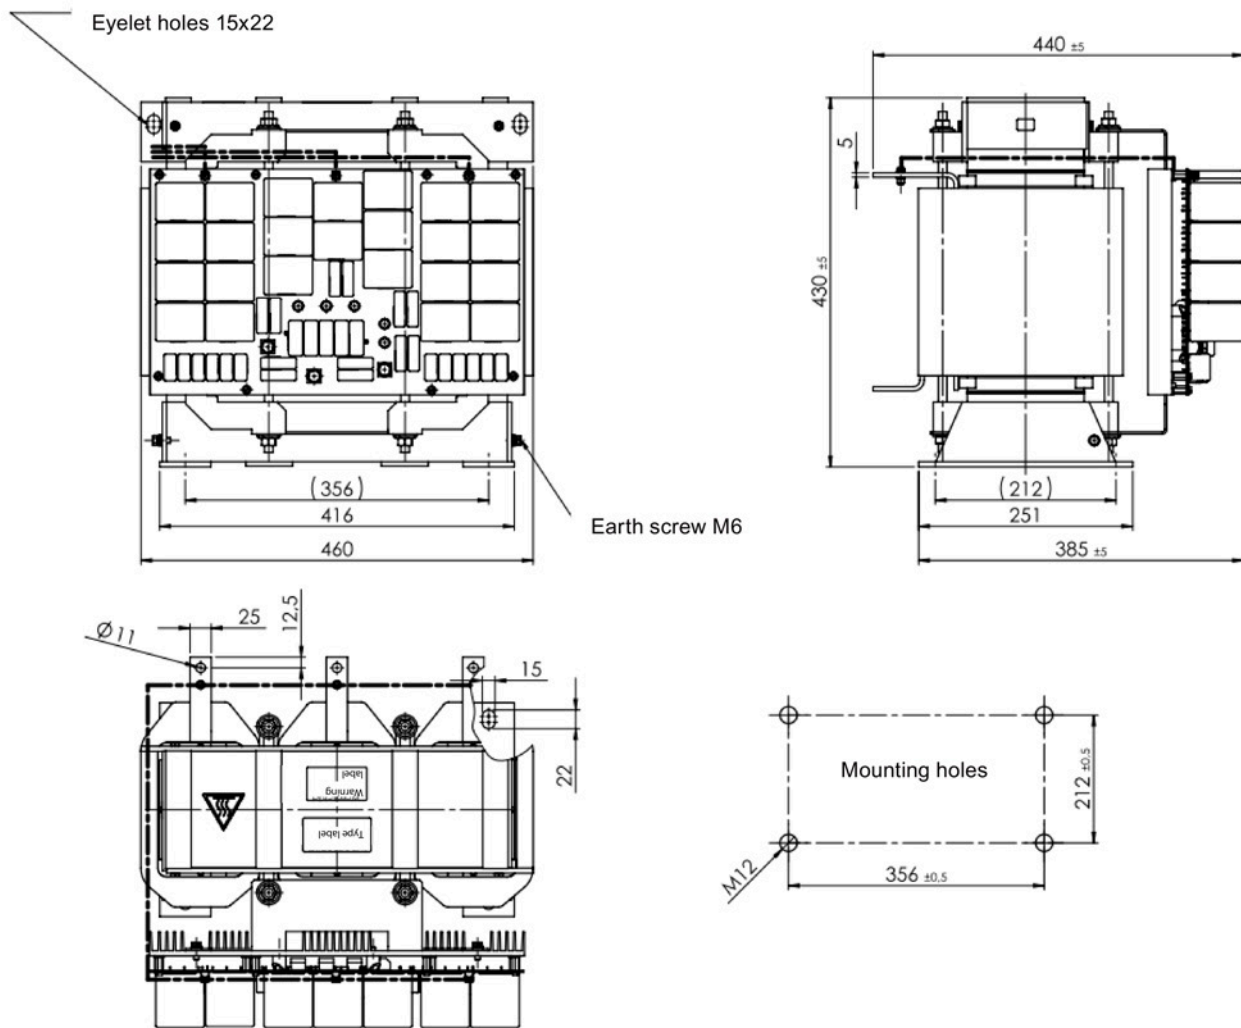


Figure 8-13 Dimensions for JTA:TEF1203-0MB

## Technical data

Article number JTA: TEF1203	-0GB	-0HB	-0JB
Rated power	18.5 kW	37 kW	55 kW
Rated voltage (phase to phase)	690 V (+10%)	690 V (+10%)	690 V (+10%)
Rated output current (rms)	24 A	44 A	64 A
Maximum output current (rms)	38 A	70 A	104 A
Inductance (Tolerance $\pm 5\%$ )	1.5 mH	1.2 mH	0.9 mH
Winding resistance	3 x 20.9 m $\Omega$	3 x 14.6 m $\Omega$	3 x 10.24 m $\Omega$
Nominal pulse frequency	2 kHz	2 kHz	2 kHz
Maximum pulse frequency	4 kHz	4 kHz	4 kHz
Output current maximum pulse frequency	14.4 A	26.4 A	38.4 A
Maximum output frequency	150 Hz	150 Hz	150 Hz

Article number JTA: TEF1203	-0GB	-0HB	-0JB
Voltage drop	17.15 V	17.13 V	17.97 V
Rated DC link voltage	935 V	935 V	935 V
Maximum voltage rise at motor terminals <sup>1)</sup>	< 500 V/μs	< 500 V/μs	< 500 V/μs
Maximum peak voltage at motor terminals (phase to phase) <sup>2)</sup>	1350 V	1350 V	1350 V
Maximum peak voltage at motor terminals (phase to earth) <sup>2)</sup>	1100 V	1100 V	1100 V
Maximum cable length filter - motor (screened / unscreened)	350 m / 525 m	350 m / 525 m	350 m / 525 m
Terminal type	Screw terminals	Screw terminals	Screw terminals
Rated terminal cross section (load circuit)	16 mm <sup>2</sup>	35 mm <sup>2</sup>	50 mm <sup>2</sup>
Rated terminal cross section (DC link feedback) <sup>3)</sup>	16 mm <sup>2</sup>	16 mm <sup>2</sup>	16 mm <sup>2</sup>
Degree of protection <sup>4)</sup>	IP00	IP00	IP00
Ambient temperature <sup>5)</sup>	-20°C to 40°C	-20°C to 40°C	-20°C to 40°C
Weight	20 kg	29 kg	46 kg
Connection	Metrical (mm <sup>2</sup> / Nm) Imperial (AWG / lbf.in) Stripping length (mm)		
Line / motor cable	16 / 1.2 6 / 11.0 13	35 / 2.5 2 / 22 17	70 / 6.0 2/0 / 53 24
DC link	16 / 1.2 6 / 11.0 13	16 / 1.2 6 / 11 13	16 / 1.2 6 / 11 13
Ground	16 / 1.2 6 / 11.0 13	35 / 2.5 2 / 22 17	70 / 10.0 2/0 / 86 24

<sup>1)</sup> Voltage rise according IEC/TS 60034-17

<sup>2)</sup> Under nominal DC link voltage

<sup>3)</sup> Short-circuit-proof wiring is required

<sup>4)</sup> Installing the filter in an enclosure is required

<sup>5)</sup> Higher ambient temperatures up to 60°C allowed with current derating at 40°C, in the range 40...50°C with 1.5% per 1K and in the range 50...60°C with 1.9% per 1K

## 8.12 dv/dt filter plus VPL

Article number JTA: TEF1203	-0KB	-0LB	-0MB
Rated power	90 kW	132 kW	250 kW
Rated voltage (phase to phase)	690 V (+10%)	690 V (+10%)	690 V (+10%)
Rated output current (rms)	103 A	230 A	416 A
Maximum output current (rms)	160 A	70 A	104 A
Inductance (Tolerance $\pm 5\%$ )	0.53 mH	0.37 mH	0.22 mH
Winding resistance	3 x 4.9 m $\Omega$	3 x 3.25 m $\Omega$	3 x 1.4 m $\Omega$
Nominal pulse frequency	2 kHz	2 kHz	2 kHz
Maximum pulse frequency	4 kHz	4 kHz	4 kHz
Output current maximum pulse frequency	61.8 A	87.6 A	156 A
Maximum output frequency	150 Hz	150 Hz	150 Hz
Voltage drop	17.2 V	17.1 V	18.0 V
Rated DC link voltage	935 V	935 V	935 V
Maximum voltage rise at motor terminals <sup>1)</sup>	< 500 V/ $\mu$ s	< 500 V/ $\mu$ s	< 500 V/ $\mu$ s
Maximum peak voltage at motor terminals (phase to phase) <sup>2) 3)</sup>	1350 V ... 1500 V	1350 V ... 1500 V	1350 V ... 1500 V
Maximum peak voltage at motor terminals (phase to earth) <sup>2)</sup>	1100 V	1100 V	1100 V
Maximum cable length filter - motor (screened / unscreened) <sup>3)</sup>	450 m / 650 m 525 m / 800 m	450 m / 650 m 525 m / 800 m	450 m / 650 m 525 m / 800 m
Terminal type	Busbar M8	Busbar M10	Busbar M10
Rated terminal cross section (load circuit)	95 mm <sup>2</sup>	120 mm <sup>2</sup>	2x120 mm <sup>2</sup> 1x185 mm <sup>2</sup>
Rated terminal cross section (DC link feedback) <sup>4)</sup>	25 mm <sup>2</sup>	25 mm <sup>2</sup>	50 mm <sup>2</sup>
Degree of protection <sup>5)</sup>	IP00	IP00	IP00
Ambient temperature <sup>6)</sup>	-20°C to 40°C	-20°C to 40°C	-20°C to 40°C
Weight	77 kg	97 kg	172 kg
Connection	Metrical (mm <sup>2</sup> / Nm) Imperial (AWG / lbf.in)		
Line / motor cable	95 / 13.0 3/0 / 115	120 / 13.0 4/0 / 115	2 x 120 / 13.0 2 x 4/0 / 115 185 / 13.0 6/0 / 13.0
DC link	25 / 9.0 4 / 80	25 / 9.0 4 / 80	50 / 9.0 1 / 80
Ground	50 / 6.0 1 / 53	70 / 6.0 2/0 / 53	95 / 6.0 3/0 / 53

<sup>1)</sup> Voltage rise according IEC/TS 60034-17

<sup>2)</sup> Under nominal DC link voltage

<sup>3)</sup> Maximum peak voltage at motor terminals < 1350V at cable length up to 450m screened or 650m unscreened Maximum peak voltage at motor terminals < 1500V at cable length up to 525m screened or 800m unscreened

<sup>4)</sup> Short-circuit-proof wiring is required

<sup>5)</sup> Installing the filter in an enclosure is required

<sup>6)</sup> Higher ambient temperatures up to 60°C allowed with current derating at 40°C, in the range 40...50°C with 1.5% per 1K and in the range 50...60°C with 1.9% per 1K

## Appendix

### A.1 Manuals and technical support

#### A.1.1 Manuals for your converter



##### Manuals with additional information that can be downloaded:

- Power Module Installation Manual  
(<https://support.industry.siemens.com/cs/ww/en/ps/13224/man>)  
Installing Power Modules, reactors and filters. Technical specifications, maintenance (this manual)



- CU230P-2 Compact Operating Instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/109477360>)  
Commissioning the converter



- CU240B/E-2 Compact Operating Instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/109477361>)  
Commissioning the converter



- CU250S-2 Compact Operating Instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/99730303>)  
Commissioning the converter.





- CU230P-2 operating instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/109478827>)  
Installing, commissioning and maintaining the converter. Advanced commissioning






- CU240B/E-2 operating instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/109478828>)  
Installing, commissioning and maintaining the converter. Advanced commissioning



- CU250S-2 operating instructions  
(<https://support.industry.siemens.com/cs/ww/en/view/109478829>)  
Installing, commissioning and maintaining the converter. Advanced commissioning  
  

- "Safety Integrated" function manual  
(<https://support.industry.siemens.com/cs/ww/en/view/109751320>)  
Configuring PROFIsafe. Installing, commissioning and operating fail-safe functions of the frequency converter.  
  

- CU230P-2 List Manual (<https://support.industry.siemens.com/cs/ww/en/view/109477248>)  
Parameter list, alarms and faults. Graphic function diagrams  
  


- CU240B/E-2 List Manual  
(<https://support.industry.siemens.com/cs/ww/en/view/109477251>)  
Parameter list, alarms and faults. Graphic function diagrams  
  

- CU250S-2 List Manual (<https://support.industry.siemens.com/cs/ww/en/view/109477253>)  
Parameter list, alarms and faults. Graphic function diagrams  
  

- EMC installation guideline  
(<http://support.automation.siemens.com/WW/view/en/60612658>)  
EMC-compliant control cabinet design, equipotential bonding and cable routing  
  

- Accessories manual (<https://support.industry.siemens.com/cs/ww/en/ps/13225/man>)  
Installation descriptions for converter components, e.g. line reactors and line filters. The printed installation descriptions are supplied together with the components.  
  


## A.1.2 Download a Manual
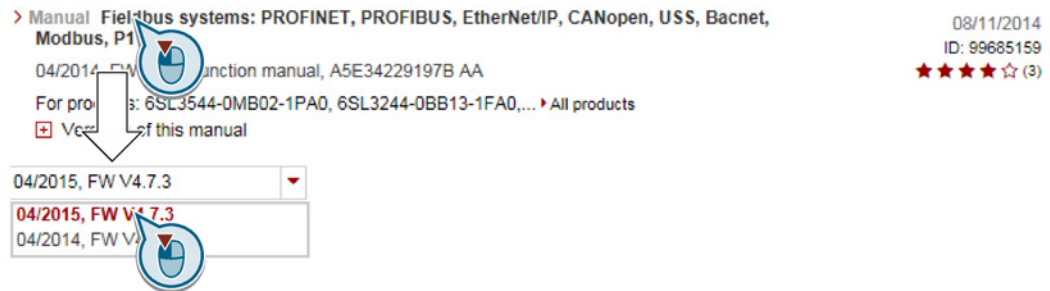
### Finding the most recent edition of a manual

If there are multiple editions of a manual, select the latest edition:



### Configuring a manual


Further information about the configurability of manuals is available in the Internet:



MyDocumentationManager

(<https://www.industry.siemens.com/topics/global/en/planning-efficiency/documentation/Pages/default.aspx>).

Select "Display and configure" and add the manual to your "mySupport-documentation":

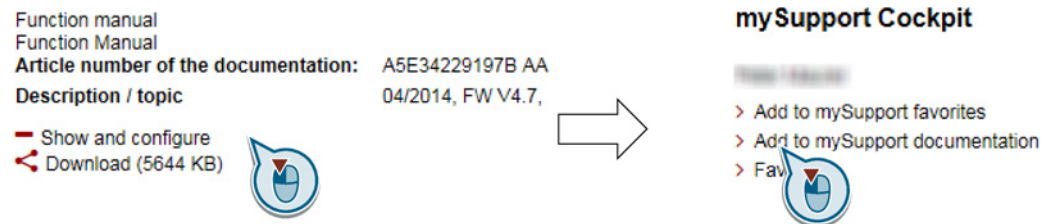

Not all manuals can be configured.

The configured manual can be exported in RTF, PDF or XML format.

## A.1.3 Configuring support

### Catalog

Ordering data and technical information for the converters SINAMICS G.



Catalogs for download or online catalog (Industry Mall):



All about SINAMICS G120 ([www.siemens.com/sinamics-g120](http://www.siemens.com/sinamics-g120))

## SIZER

The configuration tool for SINAMICS, MICROMASTER and DYNAVERT T drives, motor starters, as well as SINUMERIK, SIMOTION controllers and SIMATIC technology



SIZER on DVD:

Article number: 6SL3070-0AA00-0AG0



Download SIZER

(<http://support.automation.siemens.com/WW/view/en/10804987/130000>)

## EMC (electromagnetic compatibility) technical overview

Standards and guidelines, EMC-compliant control cabinet design



EMC overview (<https://support.industry.siemens.com/cs/ww/en/view/103704610>)

## EMC Guidelines configuration manual

EMC-compliant control cabinet design, potential equalization and cable routing



EMC installation guideline

(<http://support.automation.siemens.com/WW/view/en/60612658>)

## Safety Integrated for novices technical overview

Application examples for SINAMICS G drives with Safety Integrated



Safety Integrated for novices

(<https://support.industry.siemens.com/cs/ww/en/view/80561520>)

## A.1.4 Product Support

### Overview


You can find additional information about the product on the Internet:

 Product support (<https://support.industry.siemens.com/cs/ww/en/>)

This URL provides the following:

- Up-to-date product information (product announcements)
- FAQs
- Downloads
- The Newsletter contains the latest information on the products you use.
- The Knowledge Manager (Intelligent Search) helps you find the documents you need.
- Users and specialists from around the world share their experience and knowledge in the Forum.
- You can find your local representative for Automation & Drives via our contact database under "Contact & Partner".
- Information about local service, repair, spare parts and much more can be found under "Services".

If you have any technical questions, use the online form in the "Support Request" menu:

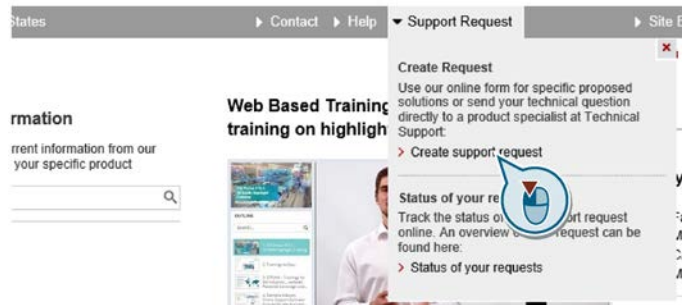

## A.2 Directives and standards

Relevant directives and standards

The following directives and standards are relevant for the converters:



### European Low Voltage Directive

The converters fulfil the requirements stipulated in Low Voltage Directive 2014/35/EU insofar as they are covered by the scope of application of this Directive.

### European Machinery Directive

The converters fulfil the requirements stipulated in Machinery Directive 2006/42/EU insofar as they are covered by the scope of application of this Directive.

Use of the converters in a typical machine application has been fully assessed for compliance with the main regulations in this Directive concerning health and safety.

### Directive 2011/65/EU

The converter fulfills the requirements of Directive 2011/65/EU relating to the restriction of the use of certain hazardous substances in electrical and electronic devices (RoHS).

### European EMC Directive

By completely complying with IEC/EN 61800-3, it has been proven that the converter is in compliance with Directive 2014/30/EU.



### Underwriters Laboratories (North American market)

Converters bearing one of the certification marks shown on the left meet the requirements for the North American market as a component of drive applications and are listed correspondingly.



### EMC requirements for South Korea

The converters with the KC marking on the rating plate satisfy the EMC requirements for South Korea.



### Eurasian conformity

The converters comply with the requirements of the Russia/Belarus/Kazakhstan customs union (EAC).



#### Australia and New Zealand (RCM formerly C-Tick)

The converters bearing the certification mark shown here meet the EMC requirements for Australia and New Zealand.

#### Specification for semiconductor process equipment voltage drop immunity

The converters comply with the requirements of standard SEMI F47-0706.

#### Quality systems

Siemens AG employs a quality management system that meets the requirements of ISO 9001 and ISO 14001.

#### DNV GL

The converters comply with the requirements of DNV GL for classification – ships, offshore units, and high speed and light crafts.

### Certificates for download



- EC Declaration of Conformity:  
(<https://support.industry.siemens.com/cs/ww/en/view/58275445>)
- Certificates for the relevant directives, prototype test certificates, manufacturers declarations and test certificates for functions relating to functional safety ("Safety Integrated"):  
(<http://support.automation.siemens.com/WW/view/en/22339653/134200>)
- UL certificates:  
(<http://database.ul.com/cgi-bin/XYV/template/LISEXT/1FRAME/index.html>)
  - FSA, FSB, FSC: 200 V                      UL File E121068, Vol. 2 Sec. 29
  - FSA, FSB, FSC: 400 V                      UL File E121068, Vol. 2 Sec. 27
  - FSD, FSE, FSF: 200 V / 400 V / 690 V    UL File E192450, Vol. 13 Sec. 4
  - FSG: 400 V / 690 V                      UL File E192450, Vol. 13 Sec. 4
- DNV GL certificate:  
(<https://support.industry.siemens.com/cs/ww/en/view/109776500>)

### Standards that are not relevant



#### China Compulsory Certification

The converters do not fall in the area of validity of the China Compulsory Certification (CCC).

## A.3 Abbreviations

Abbreviation	Explanation
AC	Alternating current
CE	Communauté Européenne
CU	Control Unit
DC	Direct current
DI	Digital input
DIP switch	DIP switches are small switches, found mostly on PBCs, for making basic device settings
DO	Digital output
ECD	Equivalent circuit diagram
EEC	European Economic Community
ELCB	Earth leakage circuit breaker
EMC	Electromagnetic compatibility (EMC)
EMI	Electromagnetic interference
FS...	Frame size ...
HO	High overload
I/O	Input/Output
IGBT	Insulated gate bipolar transistor
LED	Light emitting diode
LO	Low overload
NC	NC contact
NEMA	National Electrical Manufacturers Association
NO	NO contact
OPI	Operating instructions
PELV	Protective extra low voltage
PM	Power Module
PPE	Personnel protective equipment
PT	Push-through technology
RCCB	Residual-current operated circuit breaker
RCD	Residual current device
RFI	Radio frequency interference
SELV	Safety extra-low voltage
VPL	Voltage Peak Limiter; component for limiting voltage peaks

# Index

## 8

87 Hz characteristic, 65, 65

## A

Air barrier, 28

## B

Base load, 76  
Base load input current, 76  
Base load output current, 76  
Base load power, 76  
Brake Relay, 141  
Braking resistor  
    Clearances, 133  
    Dimension drawings, 135  
    Installation, 133

## C

Catalog, 166  
Category C2, 56  
Category C3, 56  
Clearances, 133  
Commutation dips, 130  
Configuring support, 166  
Cooling, 28

## D

Degree of protection, 19  
Delta connection, 64  
Derating  
    Installation altitude, 107  
Dimension drawings, 131, 135, 144, 146, 148  
Drilling pattern, 131, 135, 146, 148

## E

Electrical installation, 43  
EMC, 22

## F

Field weakening, 64  
Function Manual, 163

## G

Getting Started, 163

## H

Hardware Installation Manual, 163  
Harmonic currents, 111  
Harmonics, 111, 130  
High Overload, 77  
Hotline, 167

## I

Industry Mall, 166  
Installation altitude, 107  
Installing, 29  
IT system, 46

## L

Line reactor  
    Dimension drawings, 131  
Line supply type, 46  
List Manual, 163  
Low Overload, 77

## M

Maintenance  
    Cleaning, 68  
    Dirt, 68  
    Pollution, 68  
    Terminals, 68  
    Ventilation, 68

## **N**

Neutral conductor, 46  
Number of starting operations, 73

## **O**

Operating instructions, 163  
Output reactor  
    Dimension drawings, 144, 146, 148  
Overvoltage protection, 130

## **P**

Power distribution systems, 46  
Protective conductor, 46

## **Q**

Questions, 167

## **S**

Safe Brake Relay, 141  
Safety notes  
    Electrical installation, 43  
Service life of the fan, 70  
SIZER, 166  
Standards  
    EN 61800-3, 168  
Star connection (Y), 64  
Support, 167

## **T**

Tightening torque, 131  
TN system, 46  
TT system, 46



## Further information

SINAMICS converters:

**[www.siemens.com/sinamics](http://www.siemens.com/sinamics)**

Industry Online Support (Service and Support):

**[www.siemens.com/online-support](http://www.siemens.com/online-support)**

Industry Mall:

**[www.siemens.com/industrymall](http://www.siemens.com/industrymall)**

Siemens AG

Digital Industries

Motion Control

Postfach 3180

91050 ERLANGEN

Germany

For further  
information about  
SINAMICS G120,  
scan the QR code.

